

# **PROBLEM SUMMARY**


# INDIANA CROSSROADS II [46004111] T26 (S/N W-124690)

New (Unused) Oil

**FUCHS RENOLIN CLP ISO 320 (--- LTR)** 

# Sample Rating Trend ISO

### **COMPONENT CONDITION SUMMARY**

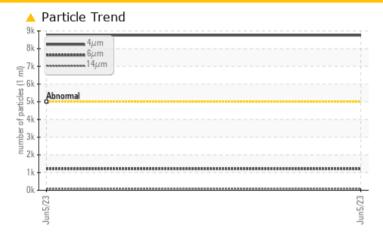

#### RECOMMENDATION

This is a baseline read-out on the submitted sample.

PROBLEMATIC TEST	RESULTS				
Sample Status			ATTENTION	 	
Particles >4µm	ASTM D7647	>5000	<b>A</b> 8752	 	
Oil Cleanliness	ISO 4406 (c)	>19/17/14	<b>20/17/14</b>	 	

Customer Id: NORDEX Sample No.: NX013297 Lab Number: 05878516 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Jonathan Hester +1 919-379-4092 x4092 jhester@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

# RECOMMENDED ACTIONS

There are no recommended actions for this sample.

# HISTORICAL DIAGNOSIS




# **OIL ANALYSIS REPORT**

INDIANA CROSSROADS II [46004111]
T26 (S/N W-124690)

Component

New (Unused) Oil

**FUCHS RENOLIN CLP ISO 320 (--- LTR)** 

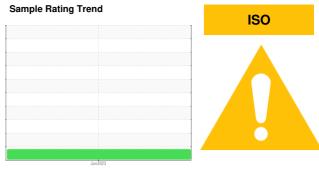

## DIAGNOSIS

#### Recommendation

This is a baseline read-out on the submitted sample.

#### Contamination

There is a moderate amount of silt (particulates < 6 microns in size) present in the oil.

				Jun2023		
SAMPLE INFORMA	ATION	method	limit/base	current	history 1	history 2
Sample Number		Client Info		NX013297		
Sample Date		Client Info		05 Jun 2023		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Not Changd		
Sample Status				ATTENTION		
WEAR METALS		method	limit/base	current	history 1	history 2
PQ		ASTM D8184	>80	13		
Iron	ppm	ASTM D5185m	>150	2		
Chromium	ppm	ASTM D5185m	>5	<1		
Nickel	ppm	ASTM D5185m	>10	<1		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m	>5	0		
	ppm	ASTM D5185m	>10	<1		
	ppm	ASTM D5185m		1		
	ppm	ASTM D5185m	>50	- <1		
	ppm	ASTM D5185m		<1		
	ppm	ASTM D5185m		<1		
	ppm	ASTM D5185m		<1		
	ррпп					
ADDITIVES		method	limit/base	current	history 1	history 2
	ppm	ASTM D5185m		14		
Barium	ppm	ASTM D5185m		<1		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		6		
Calcium	ppm	ASTM D5185m		22		
Phosphorus	ppm	ASTM D5185m		236		
Zinc	ppm	ASTM D5185m		4		
Sulfur	ppm	ASTM D5185m		6075		
CONTAMINANTS		method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	>50	5		
Sodium	ppm	ASTM D5185m	>20	2		
Potassium	ppm	ASTM D5185m	>20	1		
Water	%	ASTM D6304	>0.05	0.003		
ppm Water	ppm	ASTM D6304	>500	26.6		
FLUID CLEANLINE	SS	method	limit/base	current	history 1	history 2
Particles >4μm		ASTM D7647	>5000	<b>▲</b> 8752		
Particles >6µm		ASTM D7647	>1300	1208		
Particles >14µm		ASTM D7647	>160	90		
Particles >21µm		ASTM D7647	>40	22		
Particles >38µm		ASTM D7647	>10	1		
Particles >71µm		ASTM D7647		0		
Oil Cleanliness		ISO 4406 (c)	>19/17/14	<u>^</u> 20/17/14		
FLUID DEGRADAT	ION	method	limit/base	current	history 1	history 2
			III III DAGO		Thistory 1	- Motory 2
Acid Number (AN)	ma KUH/a	ASTM D8045		0.39		


Acid Number (AN)

mg KOH/g ASTM D8045

Contact/Location: KEVIN REGAN - NORDEX



# **OIL ANALYSIS REPORT**

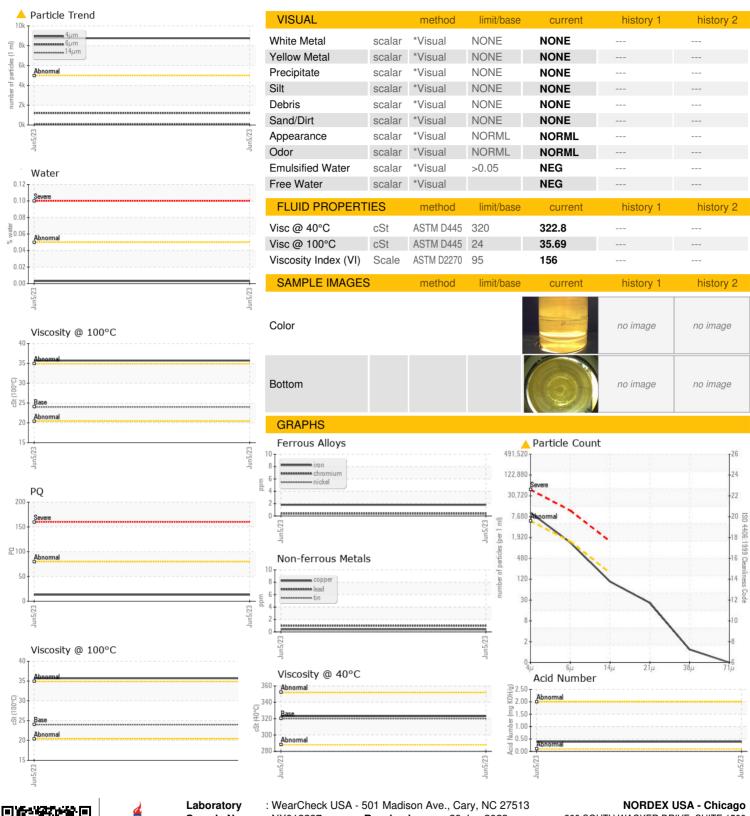



ANABA C C R E D I T E D

Laboratory Sample No. Lab Number Unique Number

: WearCheck : NX013297 : 05878516 : 10523619

X013297 Received
Diagnosed

Received : 20 Jun 2023
Diagnosed : 27 Jun 2023
Diagnostician : Jonathan Hester

300 SOUTH WACKER DRIVE, SUITE 1500 CHICAGO, IL

US 60606

Certificate L2367 Test Package : IND 2 ( Additional Tests: FT-IR, ICP-NewOil, KF, KV100, PQ, PrtCount, VI ) Contact: KEVIN REGAN To discuss this sample report, contact Customer Service at 1-800-237-1369. KRegan@nordex-online.com

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: (312)386-7102