


# **PROBLEM SUMMARY**

## Machine Id 831907 (S/N 1627)

Component Compressor Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

### COMPONENT CONDITION SUMMARY

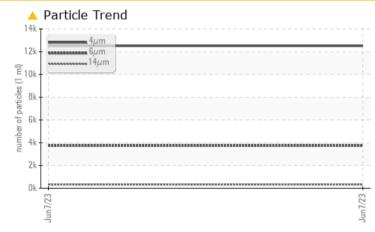

#### RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status		ABNORMAL							
Particles >6µm	ASTM D7647 >1300	<b>A</b> 3738							
Particles >14µm	ASTM D7647 >80	<b>A</b> 317							
Particles >21µm	ASTM D7647 >20	<u> </u>							
Oil Cleanliness	ISO 4406 (c) >/17/13	<u> </u>							


Customer Id: ALPSTP Sample No.: KC120567 Lab Number: 05878970 Test Package: IND 2



To manage this report scan the QR code

*To discuss the diagnosis or test data:* Don Baldridge +1 <u>don.b505@comcast.net</u>

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

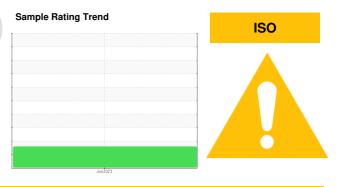

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS



## **OIL ANALYSIS REPORT**

#### Sample Rating Trend

ISO

#### Machine Id 831907 (S/N 1627) Component

#### Compressor Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

#### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a high amount of particulates present in the oil.


#### Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC120567		
Sample Date		Client Info		07 Jun 2023		
Machine Age	hrs	Client Info		1111		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	2		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m	210	0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES	I- I-	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	10		
Molybdenum		ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m	0	0		
Magnesium	ppm ppm	ASTM D5185m	100	61		
Calcium		ASTM D5185m	0	<1		
Phosphorus	ppm	ASTM D5185m	0	<1		
Zinc	ppm ppm	ASTM D5185m		4		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		10		
Potassium	ppm	ASTM D5185m	>20	10		
Water	%	ASTM D6304	>0.05	0.021		
ppm Water	ppm	ASTM D6304	>500	217.5		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		12513		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	<b>A</b> 317		
Particles >21µm		ASTM D7647	>20	<mark>/</mark> 96		
Particles >38µm		ASTM D7647	>4	2		
Particles >71µm		ASTM D7647	>3	1		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>A</b> 21/19/15		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.42		




### Built for a lifetime








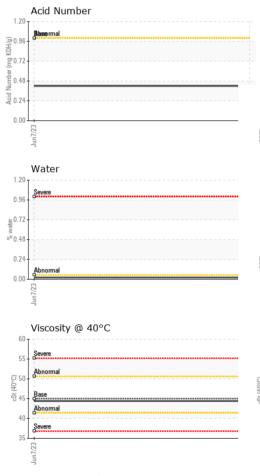

Certificate L2367

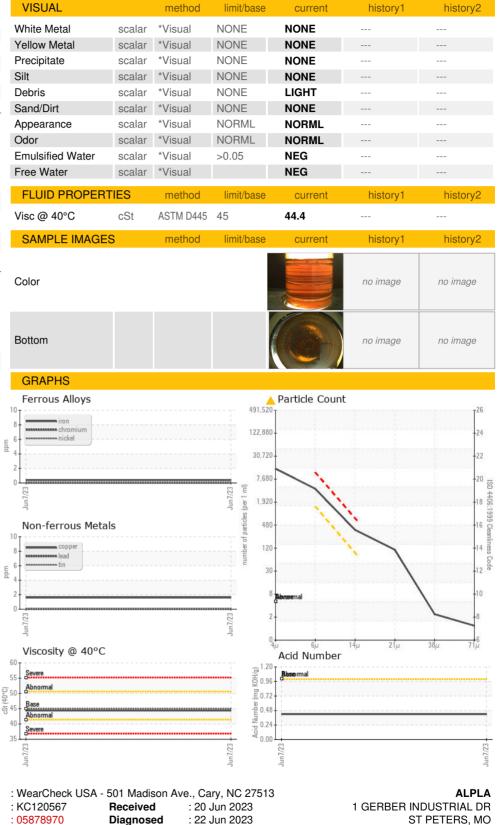



: Don Baldridge Diagnostician Contact: JAMES BAGOT To discuss this sample report, contact Customer Service at 1-800-237-1369. james.bagot@alpha.com \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Laboratory

Sample No.

Lab Number

Unique Number

Test Package

: 10524073

: IND 2

Contact/Location: JAMES BAGOT - ALPSTP

US 63376

T:

F: