

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id 8291218 (S/N 1031) Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Dec2022	Jun2023		
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA003302	KCP49866	
Sample Date		Client Info		12 Jun 2023	14 Dec 2022	
Machine Age	hrs	Client Info		5744	2631	
Oil Age	hrs	Client Info		0	2000	
Oil Changed		Client Info		N/A	Changed	
Sample Status				NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	<1	
Nickel	ppm	ASTM D5185m	>3	0	<1	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	<1	
Aluminum	ppm	ASTM D5185m		0	<1	
Lead	ppm	ASTM D5185m	>10	0	1	
Copper		ASTM D5185m		2	5	
Tin	ppm		>10	2 <1	<1	
Vanadium	ppm		>10	0	<1	
Cadmium	ppm ppm	ASTM D5185m ASTM D5185m		0	< 1	
	ррш			-	-	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	10	0	
Molybdenum	ppm	ASTM D5185m	0	0	<1	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	100	54	7	
Calcium	ppm	ASTM D5185m	0	0	0	
Phosphorus	ppm	ASTM D5185m	0	1	21	
Zinc	ppm	ASTM D5185m	0	10	0	
Sulfur	ppm	ASTM D5185m	23500	22222	9487	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	
Sodium	ppm	ASTM D5185m		10	4	
Potassium	ppm	ASTM D5185m	>20	2	14	
Water	%	ASTM D6304	>0.05	0.025	0.017	
ppm Water	ppm	ASTM D6304	>500	251.3	177.7	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1162	327	
Particles >6µm		ASTM D7647	>1300	294	101	
Particles >14µm		ASTM D7647	>80	29	15	
Particles >21µm		ASTM D7647	>20	9	5	
Particles >38µm		ASTM D7647	>4	1	0	
Particles >71µm		ASTM D7647		0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/15/12	16/14/11	
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.43	0.39	
AGIG NUMBER (AN)	niy NOLi/g	AG TWI DOU40	1.0	0.73	0.00	



OIL ANALYSIS REPORT

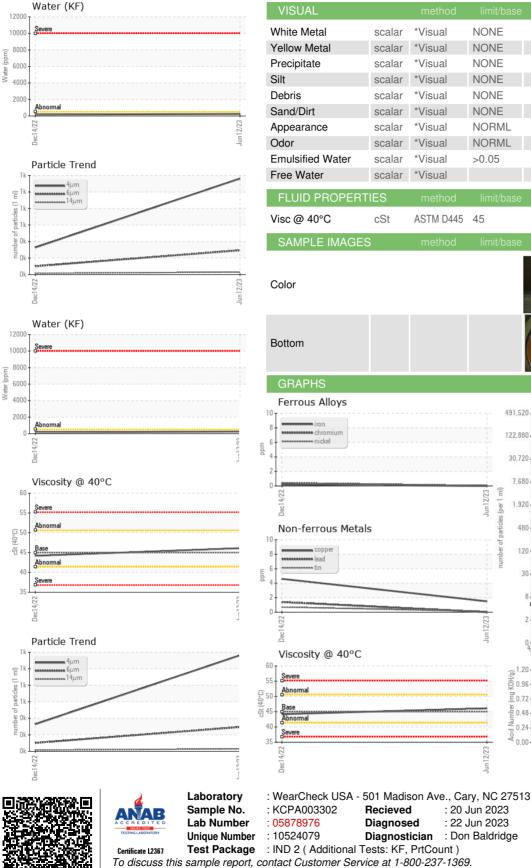

NORML NORML NORML NORML NORML NORML >0.05 NEG NEG NEG NEG ASTM D445 45 46.1 44.2 no image no image Particle Count 491,52 122,880 30.720 7,680 4406 per 1 1,920 :1999 Cle 480 120 14

30

(B/H0) MOX 0.96

Ê 0.72

- e 0.48

0.24 Acid

0.00

Dec1

Jun12/23

Acid Number

NONE

Report Id: GROSAN [WUSCAR] 05878976 (Generated: 02/07/2024 07:42:32) Rev: 1

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: Service Manager - GROSAN

214

28

GROUP MFG SERVICE INC

Contact: Service Manager

dpmcoach33@yahoo.com

1928 HARTOG DR

SAN JOSE, CA

US 95131

T: F: