

# **OIL ANALYSIS REPORT**

KAESER 8199262

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

# Sample Rating Trend



# Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

# Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


# **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Feb 2023	Jun 2023		
SAMPLE INFORM	MATION	method	limit/base	current	history 1	history 2
Sample Number		Client Info		KCPA002026	KCP55401	
Sample Date		Client Info		15 Jun 2023	03 Feb 2023	
Machine Age	hrs	Client Info		4402	3104	
Oil Age	hrs	Client Info		0	600	
Oil Changed		Client Info		N/A	Not Changd	
Sample Status				NORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	0	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	2	<1	
Tin	ppm	ASTM D5185m	>10	0	<1	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	42	25	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	100	56	54	
Calcium	ppm	ASTM D5185m	0	<1	1	
Phosphorus	ppm	ASTM D5185m	0	25	<u>^</u> 223	
Zinc	ppm	ASTM D5185m	0	8	<1	
Sulfur	ppm	ASTM D5185m	23500	21413	14308	
CONTAMINANTS	3	method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	>25	8	3	
Sodium	ppm	ASTM D5185m		13	0	
Potassium	ppm	ASTM D5185m	>20	2	1	
Water	%	ASTM D6304	>0.05	0.020	0.021	
ppm Water	ppm	ASTM D6304	>500	209.6	211.7	
FLUID CLEANLIN	IESS	method	limit/base	current	history 1	history 2
Particles >4µm		ASTM D7647		2172	30554	
Particles >6µm		ASTM D7647	>1300	468	<u> </u>	
Particles >14µm		ASTM D7647	>80	26	<u>1148</u>	
Particles >21µm		ASTM D7647	>20	10	<u>134</u>	
Particles >38µm		ASTM D7647	>4	2	1	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/12	<u>22/21/17</u>	
FLUID DEGRADA	ATION	method	limit/base	current	history 1	history 2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.37	0.26	



# **OIL ANALYSIS REPORT**

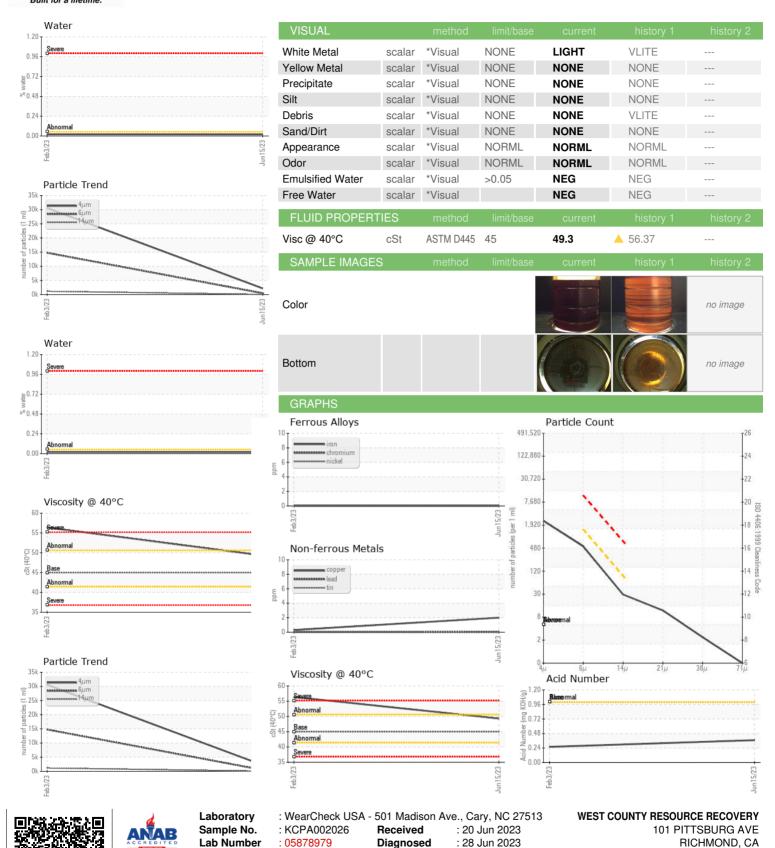

Diagnostician : Don Baldridge



Certificate L2367

**Unique Number** 

: 10524082

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Test Package : IND 2 ( Additional Tests: KF, PrtCount )

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

US 94801

T: F:

Contact: Service Manager