

OIL ANALYSIS REPORT

Sample Rating Trend **NORMAL**

8507719 (S/N 1040)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jun 2023		
SAMPLE INFORM	MATION	method	limit/base	current	history 1	history 2
Sample Number		Client Info		KC122825		
Sample Date		Client Info		15 Jun 2023		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	3		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m	>10	0		
Cadmium	ppm	ASTM D5185m		0		
	ррпп	AOTIVI DOTOSIII				
ADDITIVES		method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	2		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	100	58		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	2		
Zinc	ppm	ASTM D5185m	0	15		
CONTAMINANTS	;	method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	>25	1		
Sodium	ppm	ASTM D5185m		18		
Potassium	ppm	ASTM D5185m	>20	6		
Water	%	ASTM D6304	>0.05	0.018		
ppm Water	ppm	ASTM D6304	>500	180.0		
FLUID CLEANLIN	IESS	method	limit/base	current	history 1	history 2
Particles >4μm		ASTM D7647		1838		
Particles >6µm		ASTM D7647	>1300	447		
Particles >14µm		ASTM D7647	>80	38		
Particles >21µm		ASTM D7647	>20	11		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/12		
FLUID DEGRADA	TION	method	limit/base	current	history 1	history 2


Acid Number (AN)

mg KOH/g ASTM D8045 1.0

0.37



OIL ANALYSIS REPORT

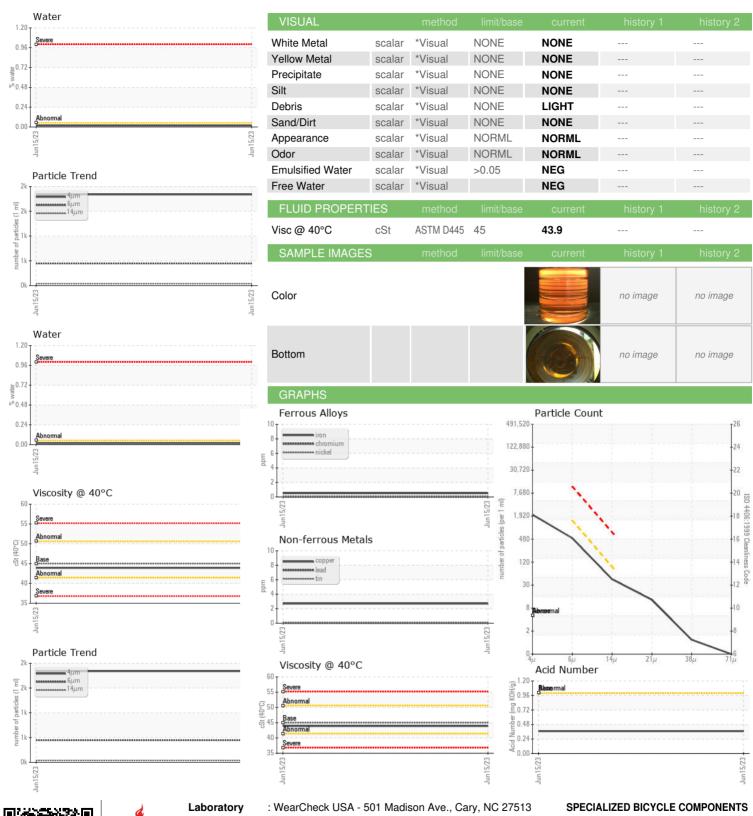



Certificate L2367

Sample No. Lab Number Unique Number

Test Package

: 05878983

: KC122825 : 10524086 : IND 2

Received : 20 Jun 2023 Diagnosed : 28 Jun 2023

: Don Baldridge Diagnostician

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

15740 CONCORD CIR MORGAN HILL, CA

US 95037 Contact: SERVICE MANAGER

swv@specialized.com

T:

F: