


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

KAESER ASD 40 5478718 (S/N 1213)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Moor

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Jul2017 (0ct2018 Jun2019 Feb202	20 Nov2020 Jul2021 Jul2022	Jun2023	
SAMPLE INFORM	MATION	method	limit/base	current	history 1	history 2
Sample Number		Client Info		KC121804	KC103394	KC99304
Sample Date		Client Info		15 Jun 2023	25 Jul 2022	19 Jul 2021
Machine Age	hrs	Client Info		29019	26378	22192
Oil Age	hrs	Client Info		0	1638	2872
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				NORMAL	ATTENTION	ATTENTION
WEAR METALS		method	limit/base	current	history 1	history 2
Iron	ppm	ASTM D5185m	>50	<1	0	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	<1	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	8	13	8
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history 1	history 2
Boron	ppm	ASTM D5185m		0	0	26
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	90	12	0	49
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		5	<1	8
Zinc	ppm	ASTM D5185m		8	0	5
CONTAMINANTS	;	method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	>25	0	0	2
Sodium	ppm	ASTM D5185m		4	0	18
Potassium	ppm	ASTM D5185m	>20	0	0	2
Water	%	ASTM D6304	>0.05	0.008	0.007	0.023
ppm Water	ppm	ASTM D6304	>500	81.8	74.5	237.1
FLUID CLEANLIN	IESS	method	limit/base	current	history 1	history 2
Particles >4µm		ASTM D7647		2760	3647	3344
Particles >6µm		ASTM D7647	>1300	1023	<u>▲</u> 1437	1226
Particles >14µm		ASTM D7647	>80	76	52	▲ 117
Particles >21µm		ASTM D7647	>20	24	10	△ 26
Particles >38μm		ASTM D7647	>4	4	0	2
Particles >71μm		ASTM D7647	>3	1	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/13	▲ 19/18/13	▲ 17/14
FLUID DEGRADA	TION	method	limit/base	current	history 1	history 2
Acid Number (AN)	ma KOH/a	ASTM D8045	0.4	0.43	0.41	0.304

Acid Number (AN)

mg KOH/g ASTM D8045 0.4


0.41

0.43

0.304



OIL ANALYSIS REPORT

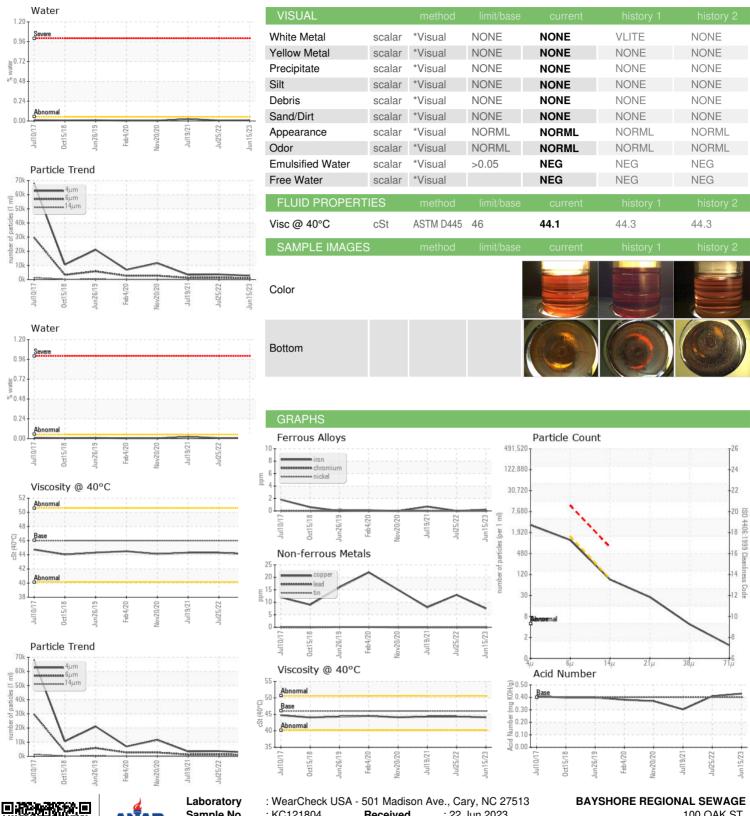





Certificate L2367

Sample No. Lab Number **Unique Number** Test Package

: KC121804 : 05880901 : 10526004 : IND 2

Received Diagnosed Diagnostician

: 22 Jun 2023 : 26 Jun 2023 : Don Baldridge

100 OAK ST. UNION BEACH, NJ US 07735

Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: