




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

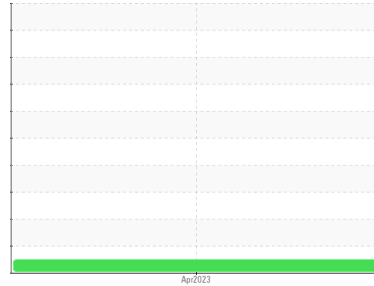

Area

**CFG-546**

Machine Id

**GARDNER DENVER S097781 - E&J GACCO**

Component

**Compressor**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH05881004</b>	---	---
Sample Date	Client Info		<b>24 Apr 2023</b>	---	---
Machine Age	hrs	Client Info	<b>23225</b>	---	---
Oil Age	hrs	Client Info	<b>1213</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>NORMAL</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>&lt;1</b>	---	---
Chromium	ppm	ASTM D5185m >10	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185m	<b>0</b>	---	---
Silver	ppm	ASTM D5185m	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >25	<b>0</b>	---	---
Lead	ppm	ASTM D5185m >25	<b>&lt;1</b>	---	---
Copper	ppm	ASTM D5185m >50	<b>0</b>	---	---
Tin	ppm	ASTM D5185m >15	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	---	---
Barium	ppm	ASTM D5185m 0	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m 0	<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m 1.2	<b>0</b>	---	---
Calcium	ppm	ASTM D5185m 0	<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m 295	<b>186</b>	---	---
Zinc	ppm	ASTM D5185m 0	<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m 253	<b>1375</b>	---	---

## CONTAMINANTS




	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	---	---
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>2</b>	---	---
Water	%	ASTM D6304 >0.1	<b>0.068</b>	---	---
ppm Water	ppm	ASTM D6304 >1000	<b>680</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.252	<b>0.15</b>	---	---



# OIL ANALYSIS REPORT

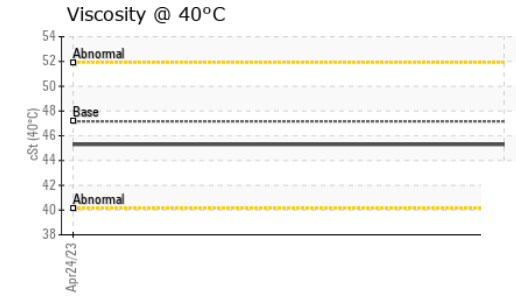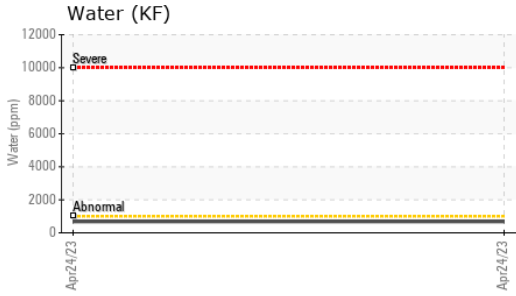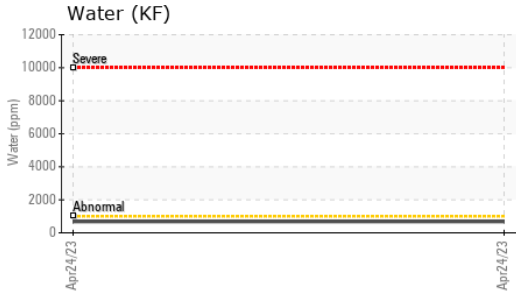





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	*Visual	>0.1	<b>0.2%</b>	---	---
Free Water	scalar	*Visual		<b>NEG</b>	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	47.16	<b>45.3</b>	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

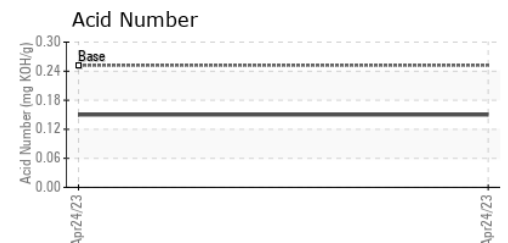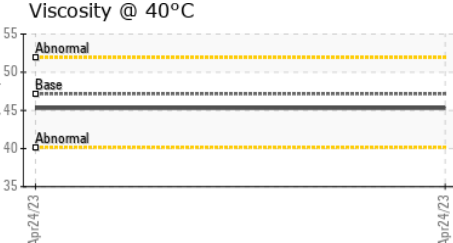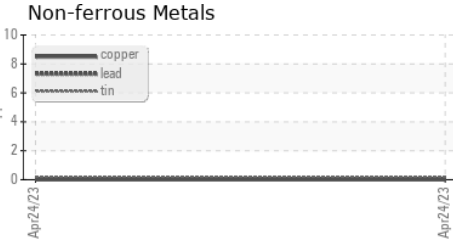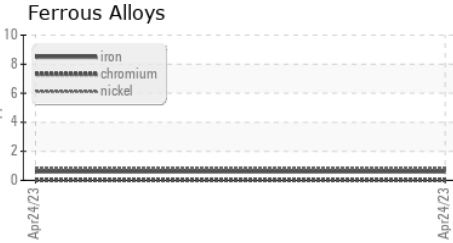

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH05881004    **Received** : 22 Jun 2023  
**Lab Number** : **05881004**    **Diagnosed** : 26 Jun 2023  
**Unique Number** : 10526107    **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF )

**CISCO AIR SYSTEMS**  
 2373 LINCOLN AVE  
 HAYWARD, CA  
 US 94545  
 Contact: ANDREW DATTOLICO  
 adattolico@ciscoair.com  
 T: (916)414-0331  
 F: x:

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)