




PROBLEM SUMMARY

Sample Rating Trend

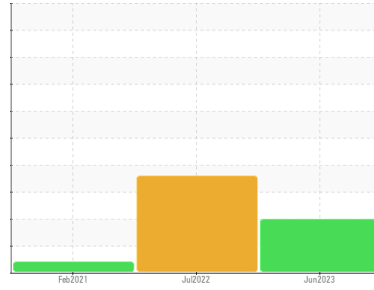


Machine Id
5523600 (S/N 1052)

Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

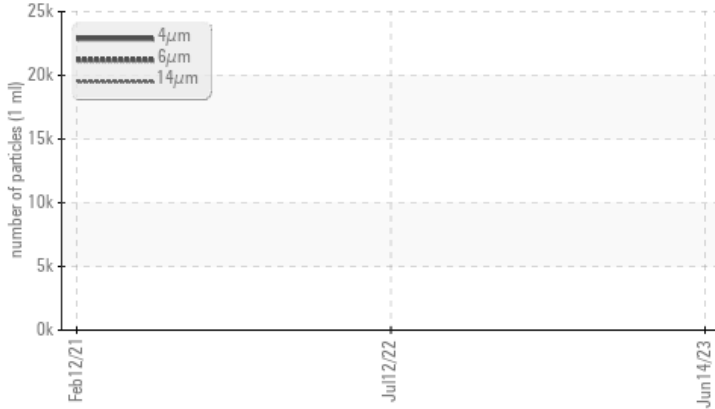

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	ABNORMAL
Particles >6µm	ASTM D7647	>1300	▲ 6370	---	---
Particles >14µm	ASTM D7647	>80	▲ 483	---	---
Particles >21µm	ASTM D7647	>20	▲ 136	---	---
Particles >38µm	ASTM D7647	>4	▲ 6	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 21/20/16	---	---

Customer Id: FRELEXNC
Sample No.: KCPA005322
Lab Number: 05881541
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

WATER



12 Jul 2022 Diag: Jonathan Hester

Oil and filter change at the time of sampling has been noted. We were unable to perform a particle count due to a high concentration of particles present in this sample. We recommend an early resample in 500 hours to monitor this condition. All component wear rates are normal. Free water present. There is a light concentration of water present in the oil. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



VIS DEBRIS



12 Feb 2021 Diag: Don Baldrige


No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

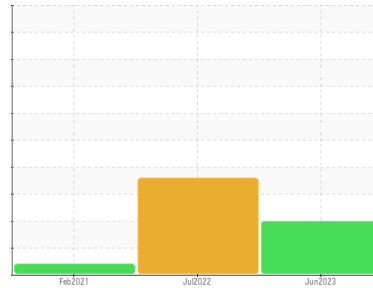

ISO



Machine Id
5523600 (S/N 1052)

Component

Compressor

Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA005322	KCP40567	KCP27077
Sample Date	Client Info		14 Jun 2023	12 Jul 2022	12 Feb 2021
Machine Age	hrs	Client Info	10787	8783	7043
Oil Age	hrs	Client Info	0	3000	3600
Oil Changed	Client Info		N/A	Changed	Changed
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	0	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	<1	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	<1	0
Aluminum	ppm	ASTM D5185m >10	0	<1	<1
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	15	10	24
Tin	ppm	ASTM D5185m >10	0	0	0
Antimony	ppm	ASTM D5185m	---	---	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	8	12
Barium	ppm	ASTM D5185m 90	30	0	0
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	<1	0	0
Magnesium	ppm	ASTM D5185m 100	57	23	15
Calcium	ppm	ASTM D5185m 0	3	0	0
Phosphorus	ppm	ASTM D5185m 0	2	<1	4
Zinc	ppm	ASTM D5185m 0	0	17	18
Sulfur	ppm	ASTM D5185m 23500	26858	23302	17507

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	<1	2
Sodium	ppm	ASTM D5185m	19	10	7
Potassium	ppm	ASTM D5185m >20	5	<1	0
Water	%	ASTM D6304 >0.05	0.021	▲ 0.261	0.009
ppm Water	ppm	ASTM D6304 >500	216.0	▲ 2610	98.6






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		19880	---	---
Particles >6µm	ASTM D7647	>1300	▲ 6370	---	---
Particles >14µm	ASTM D7647	>80	▲ 483	---	---
Particles >21µm	ASTM D7647	>20	▲ 136	---	---
Particles >38µm	ASTM D7647	>4	▲ 6	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 21/20/16	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.32	0.30	0.309


OIL ANALYSIS REPORT

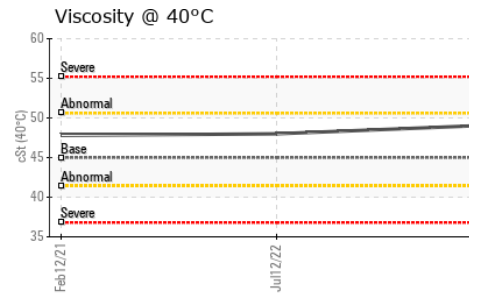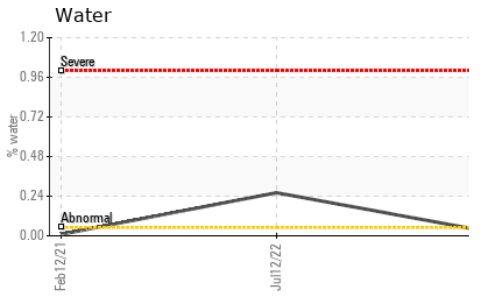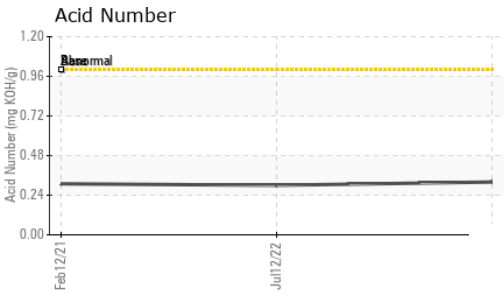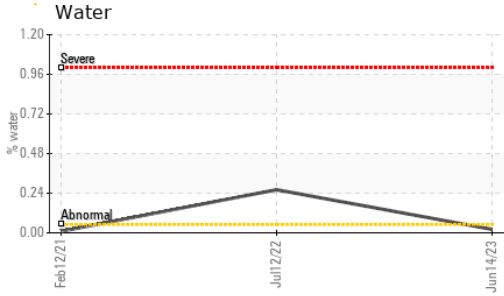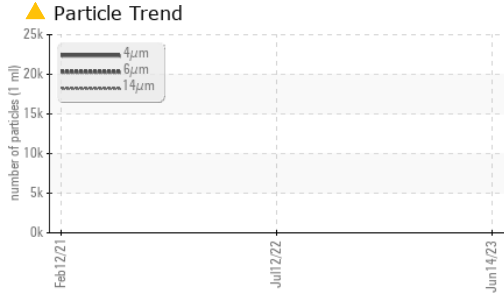






PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%
Free Water	scalar	*Visual		NEG	1.0

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	49.1	48.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

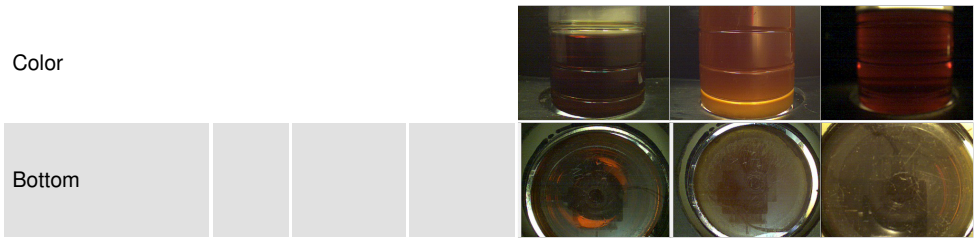

GRAPHS

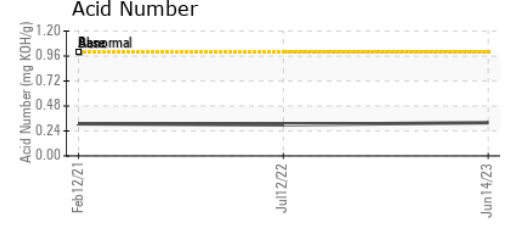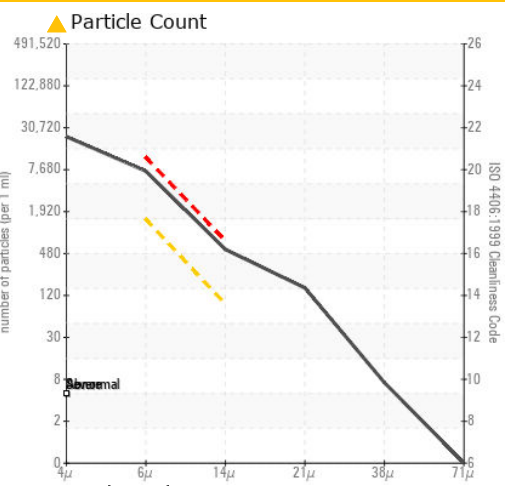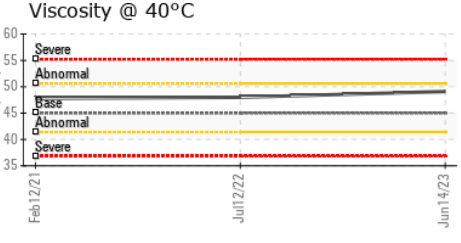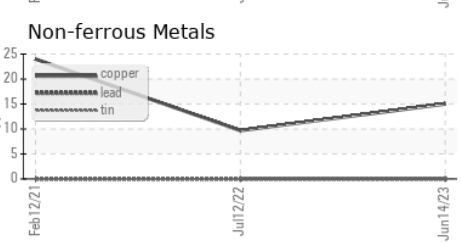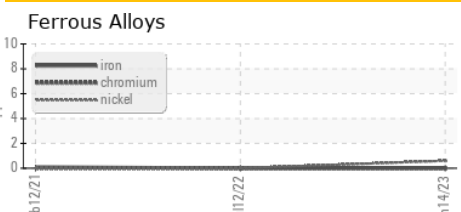

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA005322 **Received** : 22 Jun 2023
Lab Number : 05881541 **Diagnosed** : 25 Jun 2023
Unique Number : 10526644 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: KF, PrtCount)

FRENZELIT INC
 4165 OLD SALISBURY RD
 LEXINGTON, NC
 US 27295
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: