


OIL ANALYSIS REPORT

Sample Rating Trend



ISO

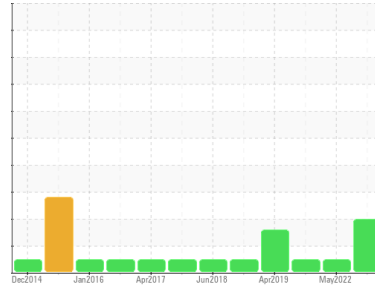

Machine Id
KAESER CSU 150 4153374 (S/N 1007)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA002015	KCP45042	KCP26461
Sample Date	Client Info		08 Jun 2023	02 May 2022	30 Jan 2020
Machine Age	hrs	Client Info	69840	60769	48285
Oil Age	hrs	Client Info	0	5000	5053
Oil Changed	Client Info		N/A	Not Changd	Not Changd
Sample Status			ABNORMAL	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	<1	3
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	1	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	<1	<1	1
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	2	6	2
Tin	ppm	ASTM D5185m >10	0	0	0
Antimony	ppm	ASTM D5185m	---	---	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<1	<1
Barium	ppm	ASTM D5185m 90	32	97	56
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	0	<1
Magnesium	ppm	ASTM D5185m 90	117	116	132
Calcium	ppm	ASTM D5185m 2	6	1	9
Phosphorus	ppm	ASTM D5185m	13	0	4
Zinc	ppm	ASTM D5185m	0	0	0
Sulfur	ppm	ASTM D5185m	20873	13997	11833

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	0	<1	4
Sodium	ppm	ASTM D5185m	65	23	42
Potassium	ppm	ASTM D5185m >20	6	<1	3
Water	%	ASTM D6304 >0.05	0.042	0.038	0.034
ppm Water	ppm	ASTM D6304 >500	429.9	383.5	343.8

FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		12076	2120	4102
Particles >6µm	ASTM D7647	>1300	▲ 3970	383	735
Particles >14µm	ASTM D7647	>80	▲ 477	43	28
Particles >21µm	ASTM D7647	>20	▲ 175	14	12
Particles >38µm	ASTM D7647	>4	▲ 15	2	0
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 21/19/16	18/16/13	17/12

FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.37	0.27	0.464

OIL ANALYSIS REPORT


▲ Particle Trend

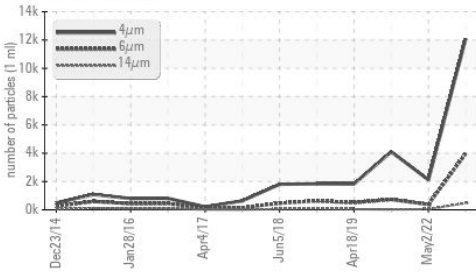


Water (KF)

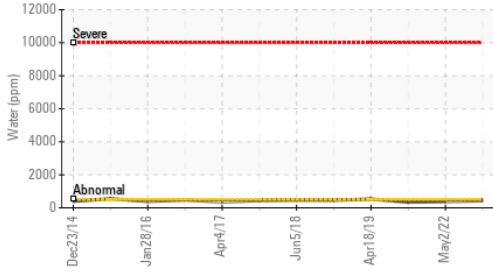


Acid Number

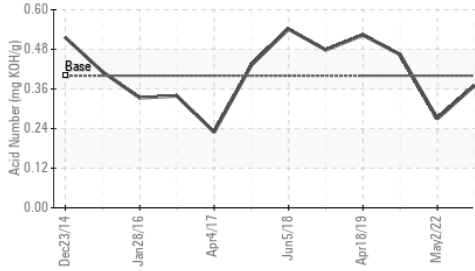

Water (KF)

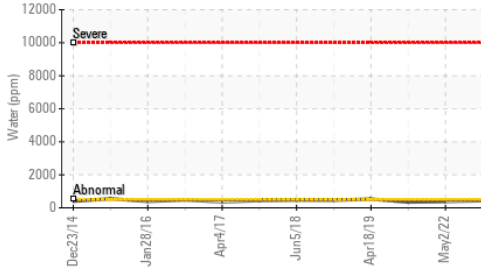

Viscosity @ 40°C

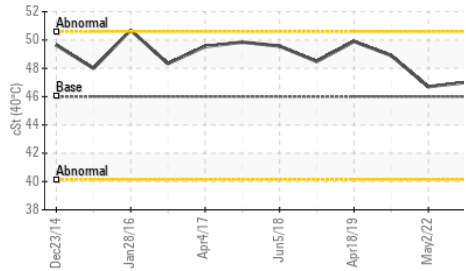


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	47.0	46.7	48.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color




Bottom




GRAPHS


Ferrous Alloys

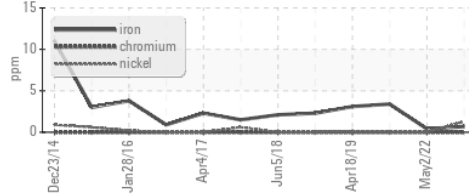


Non-ferrous Metals

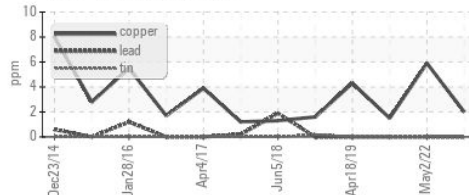


Viscosity @ 40°C

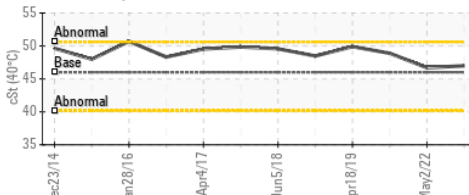

▲ Particle Count

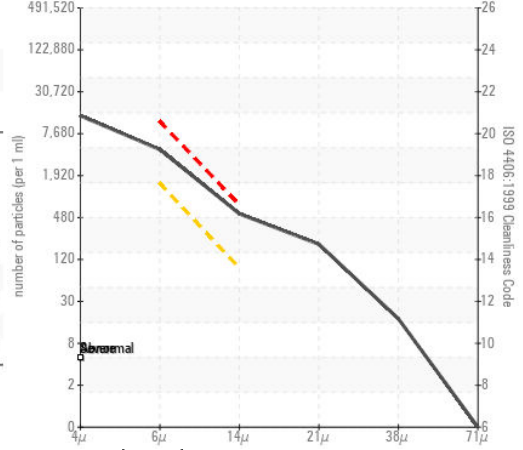

Acid Number

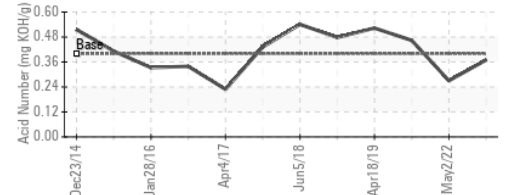

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : KCPA002015

Lab Number : 05881554

Unique Number : 10526657

Test Package : IND 2 (Additional Tests: KF, PrtCount)

Received : 22 Jun 2023

Tested : 26 Jun 2023

Diagnosed : 26 Jun 2023 - Don Baldrige

B-WAY PACKAGING CORP.

1601 VALDOSTA HWY

HOMERVILLE, GA

US 31634

Contact: JESSY CARTER

jessy.carter@mauserpackaging.com

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)