


# **OIL ANALYSIS REPORT**



**NORMAL** 



KAESER 6291320

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

#### Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

#### Contamination

The amount and size of particulates present in the system are acceptable.

#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

				Jun2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA005433		
Sample Date		Client Info		30 Jun 2023		
Machine Age	hrs	Client Info		3000		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
ron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	<1		
_ead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	<1		
Γin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	11		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	85		
Calcium	ppm	ASTM D5185m	2	1		
Phosphorus	ppm	ASTM D5185m		2		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		23817		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1		
Sodium	ppm	ASTM D5185m		6		
Potassium	ppm	ASTM D5185m	>20	3		
Nater	%	ASTM D6304	>0.05	0.026		
opm Water	ppm	ASTM D6304	>500	268.6		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1064		
Particles >6µm		ASTM D7647	>1300	129		
Particles >14µm		ASTM D7647	>80	12		
Particles >21µm		ASTM D7647	>20	7		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/14/11		
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2


Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.43



## **OIL ANALYSIS REPORT**

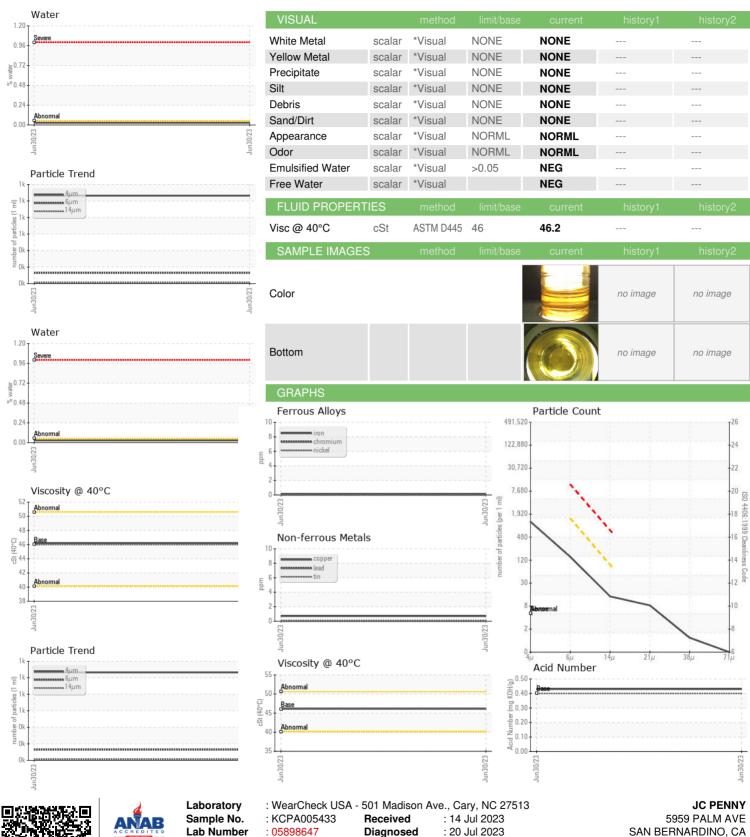





Certificate L2367

Lab Number **Unique Number** 

: 05898647

: 10560003

Diagnosed Diagnostician : Angela Borella Test Package : IND 2 ( Additional Tests: KF, PrtCount )

: 20 Jul 2023

US 92407 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: