

OIL ANALYSIS REPORT

Sample Rating Trend





Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA005424		
Sample Date		Client Info		30 Jun 2023		
Machine Age	hrs	Client Info		3000		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	1		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	<1		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium		ASTM D5185m	210	u <1		
Cadmium	ppm ppm	ASTM D5185m		<1		
ADDITIVES	ppm	method	limit/base	-		history2
Boron	nnm	ASTM D5185m	iimii/base	current 0	history1	nistory2
	ppm	ASTM D5185m	90	7		
Barium	ppm		90			
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m	0.0	<1		
Magnesium	ppm	ASTM D5185m	90	85		
Calcium	ppm	ASTM D5185m	2	<1		
Phosphorus	ppm	ASTM D5185m		2		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		23584		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1		
Sodium	ppm	ASTM D5185m		8		
Potassium	ppm	ASTM D5185m	>20	3		
Water	%	ASTM D6304	>0.05	0.030		
ppm Water	ppm	ASTM D6304	>500	304.9		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3356		
Particles >6µm		ASTM D7647	>1300	642		
Particles >14µm		ASTM D7647	>80	11		
Particles >21µm		ASTM D7647	>20	3		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/11		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.43		



2²0.48

0.2

0.00

52

50

48

75 44

47

particles

흫 21

0

Abnorm 40 38 :0/02

Particle Trend

OIL ANALYSIS REPORT

scalar

scalar

scalar

scalar

scalar

scalar

scalar

scalar

cSt

*Visual

*Visual

*Visua

*Visual

*Visual

*Visual

*Visual

*Visual

ASTM D445

scalar *Visual

scalar *Visual

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

>0.05

46

NONE

NONE

NONE

NONE

NONE

NONE


NORML


NORML

NEG

NEG

46.7

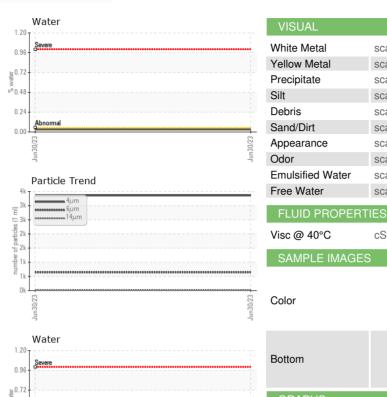

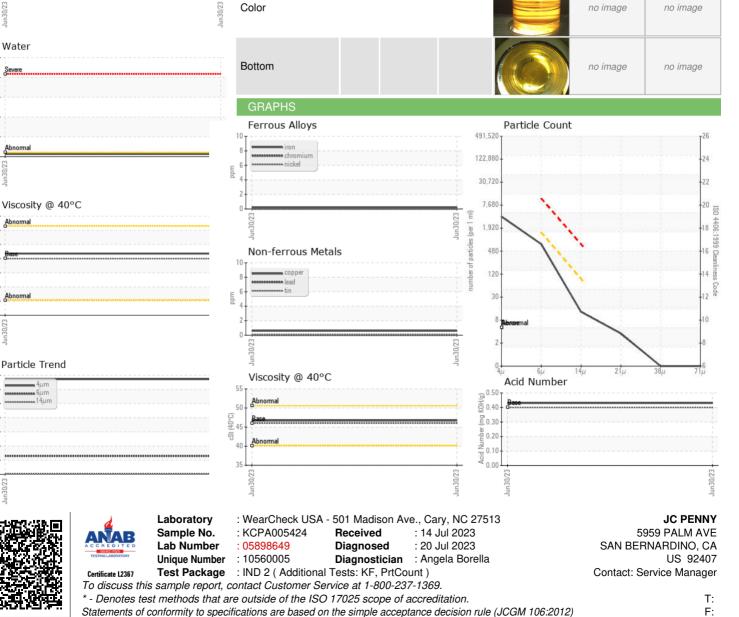

Contact/Location: Service Manager - JCPSAN