# OIL ANALYSIS REPORT

Sample Rating Trend

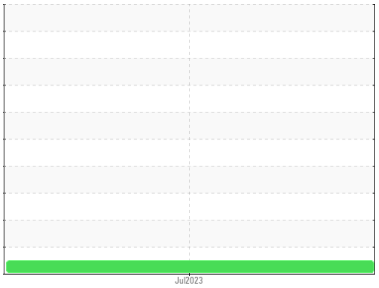


NORMAL

Machine Id
## TREN_U2 TREN_U2_M2
Component
**Drive End Bearing**
Fluid
**ROYAL PURPLE SYNFILM GT 32 (--- GAL)**

## DIAGNOSIS

**Recommendation**
Resample at the next service interval to monitor.

**Wear**
All component wear rates are normal.

**Contamination**
There is no indication of any contamination in the oil.

**Fluid Condition**
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|---|---|---|---|---|---|---|
| Sample Number | | Client Info | | **RP0032298** | --- | --- |
| Sample Date | | Client Info | | **13 Jul 2023** | --- | --- |
| Machine Age | hrs | Client Info | | **0** | --- | --- |
| Oil Age | hrs | Client Info | | **0** | --- | --- |
| Oil Changed | | Client Info | | **N/A** | --- | --- |
| Sample Status | | | | **NORMAL** | --- | --- |

| WEAR METALS | | method | limit/base | current | history1 | history2 |
|---|---|---|---|---|---|---|
| Iron | ppm | ASTM D5185m | >20 | **0** | --- | --- |
| Chromium | ppm | ASTM D5185m | >20 | **0** | --- | --- |
| Nickel | ppm | ASTM D5185m | >20 | **<1** | --- | --- |
| Titanium | ppm | ASTM D5185m | | **0** | --- | --- |
| Silver | ppm | ASTM D5185m | | **0** | --- | --- |
| Aluminum | ppm | ASTM D5185m | >20 | **<1** | --- | --- |
| Lead | ppm | ASTM D5185m | >20 | **0** | --- | --- |
| Copper | ppm | ASTM D5185m | >20 | **<1** | --- | --- |
| Tin | ppm | ASTM D5185m | >20 | **0** | --- | --- |
| Vanadium | ppm | ASTM D5185m | | **0** | --- | --- |
| Cadmium | ppm | ASTM D5185m | | **0** | --- | --- |

| ADDITIVES | | method | limit/base | current | history1 | history2 |
|---|---|---|---|---|---|---|
| Boron | ppm | ASTM D5185m | | **0** | --- | --- |
| Barium | ppm | ASTM D5185m | | **2** | --- | --- |
| Molybdenum | ppm | ASTM D5185m | | **0** | --- | --- |
| Manganese | ppm | ASTM D5185m | | **0** | --- | --- |
| Magnesium | ppm | ASTM D5185m | | **86** | --- | --- |
| Calcium | ppm | ASTM D5185m | | **1** | --- | --- |
| Phosphorus | ppm | ASTM D5185m | | **1** | --- | --- |
| Zinc | ppm | ASTM D5185m | | **0** | --- | --- |

| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|---|---|---|---|---|---|---|
| Silicon | ppm | ASTM D5185m | >15 | **<1** | --- | --- |
| Sodium | ppm | ASTM D5185m | | **<1** | --- | --- |
| Potassium | ppm | ASTM D5185m | >20 | **<1** | --- | --- |
| Water | % | ASTM D6304 | >2 | **0.017** | --- | --- |
| ppm Water | ppm | ASTM D6304 | | **179.9** | --- | --- |

| FLUID DEGRADATION | | method | limit/base | current | history1 | history2 |
|---|---|---|---|---|---|---|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | | **0.34** | --- | --- |

| VISUAL | | method | limit/base | current | history1 | history2 |
|---|---|---|---|---|---|---|
| White Metal | scalar | *Visual | NONE | **LIGHT** | --- | --- |
| Yellow Metal | scalar | *Visual | NONE | **NONE** | --- | --- |
| Precipitate | scalar | *Visual | NONE | **NONE** | --- | --- |
| Silt | scalar | *Visual | NONE | **NONE** | --- | --- |
| Debris | scalar | *Visual | NONE | **NONE** | --- | --- |
| Sand/Dirt | scalar | *Visual | NONE | **NONE** | --- | --- |
| Appearance | scalar | *Visual | NORML | **NORML** | --- | --- |
| Odor | scalar | *Visual | NORML | **NORML** | --- | --- |
| Emulsified Water | scalar | *Visual | >2 | **NEG** | --- | --- |
| Free Water | scalar | *Visual | | **NEG** | --- | --- |

# OIL ANALYSIS REPORT

Water

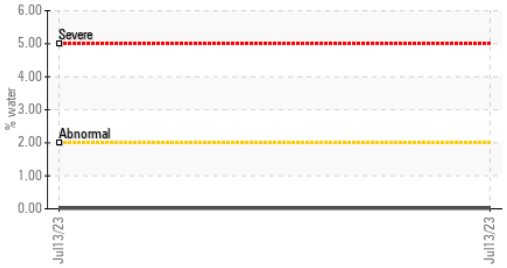


Water


Viscosity @ 40°C

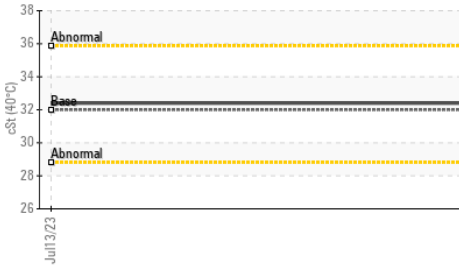


| FLUID PROPERTIES | | method | limit/base | current | history1 | history2 |
|---|---|---|---|---|---|---|
| Visc @ 40°C | cSt | ASTM D445 | 32 | **32.4** | --- | --- |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---|---|---|---|---|---|
| Color | | |  | *no image* | *no image* |
| Bottom | | |  | *no image* | *no image* |

GRAPHS

Ferrous Alloys

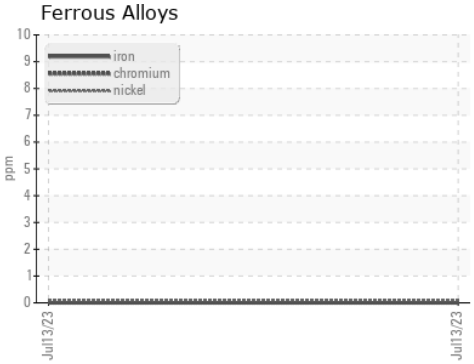


Non-ferrous Metals

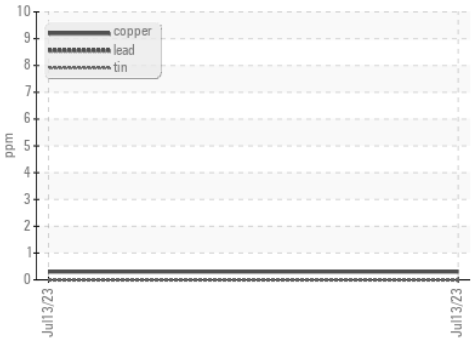


Viscosity @ 40°C

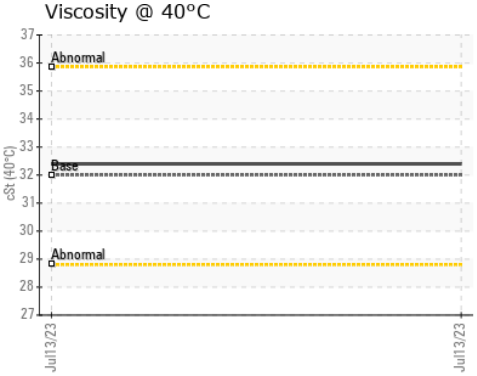


Acid Number

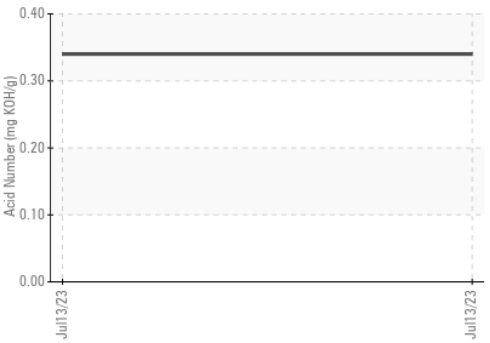


Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513
**Sample No.** : RP0032298
**Lab Number** : 05898658
**Unique Number** : 10560014
**Test Package** : IND 2

**Received** : 14 Jul 2023
**Diagnosed** : 17 Jul 2023
**Diagnostician** : Doug Bogart

*To discuss this sample report, contact Customer Service at 1-800-237-1369.*
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
*Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)*

**ENERGY TRANSFER - TRENTON**
US RTE 130 SOUTH BOUND
HAMILTON, NJ
US 08610
Contact: QUITA MORGAN

T: (610)220-8386
F: