


# PROBLEM SUMMARY

Sample Rating Trend




**WEAR**

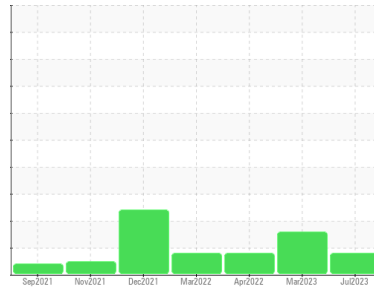

Machine Id  
**MHTF\_1B MHTF\_1B\_M1**  
 Component  
**Drive End Bearing**  
 Fluid  
**ROYAL PURPLE SYNFILM GT 32 (--- GAL)**

## COMPONENT CONDITION SUMMARY

### ▲ Non-ferrous Metals

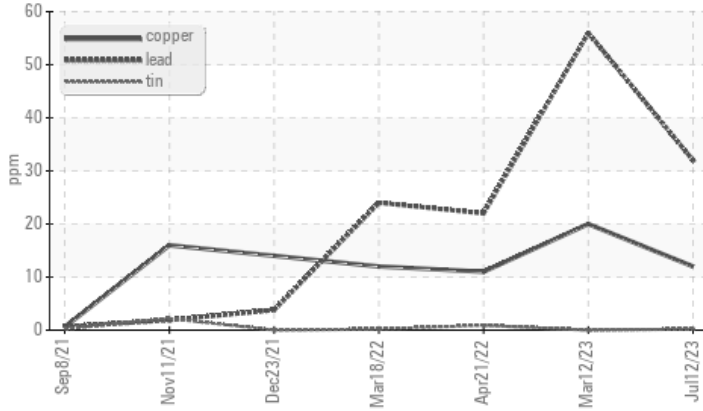

## RECOMMENDATION

No corrective action is recommended at this time.  
 Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

| Sample Status |     |             |     | <b>ABNORMAL</b> | ABNORMAL | ABNORMAL |
|---------------|-----|-------------|-----|-----------------|----------|----------|
| Lead          | ppm | ASTM D5185m | >20 | <b>▲ 32</b>     | ▲ 56     | ▲ 22     |

**Customer Id:** ENEAST  
**Sample No.:** RP0033011  
**Lab Number:** 05898674  
**Test Package:** IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Jonathan Hester +1 919-379-4092 x4092  
[jhester@wearcheckusa.com](mailto:jhester@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

### 12 Mar 2023 Diag: Don Baldrige

#### WEAR



No corrective action is recommended at this time. Resample at the next service interval to monitor. Bearing wear is indicated. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 21 Apr 2022 Diag: Jonathan Hester

#### WEAR



No corrective action is recommended at this time. Resample at the next service interval to monitor. Bearing wear is indicated. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 18 Mar 2022 Diag: Don Baldrige

#### WEAR



No corrective action is recommended at this time. Resample at the next service interval to monitor. The lead level is abnormal. All other component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

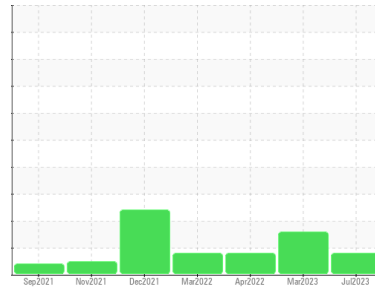

**WEAR**



Machine Id  
**MHTF\_1B MHTF\_1B\_M1**  
 Component  
**Drive End Bearing**  
 Fluid  
**ROYAL PURPLE SYNFILM GT 32 (--- GAL)**

**DIAGNOSIS**

- Recommendation**  
No corrective action is recommended at this time. Resample at the next service interval to monitor.
- Wear**  
Bearing wear is indicated.
- Contamination**  
There is no indication of any contamination in the oil.
- Fluid Condition**  
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

**SAMPLE INFORMATION**

| method        | limit/base  | current            | history1    | history2    |
|---------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | <b>RP0033011</b>   | RP0012611   | RP0012602   |
| Sample Date   | Client Info | <b>12 Jul 2023</b> | 12 Mar 2023 | 21 Apr 2022 |
| Machine Age   | hrs         | Client Info        | 0           | 0           |
| Oil Age       | hrs         | Client Info        | 0           | 0           |
| Oil Changed   | Client Info | <b>N/A</b>         | N/A         | N/A         |
| Sample Status |             | <b>ABNORMAL</b>    | ABNORMAL    | ABNORMAL    |

**WEAR METALS**

| method   | limit/base | current         | history1    | history2 |      |
|----------|------------|-----------------|-------------|----------|------|
| Iron     | ppm        | ASTM D5185m >20 | <1          | 0        | <1   |
| Chromium | ppm        | ASTM D5185m >20 | 0           | 0        | 0    |
| Nickel   | ppm        | ASTM D5185m >20 | <1          | 0        | <1   |
| Titanium | ppm        | ASTM D5185m     | 0           | 0        | 0    |
| Silver   | ppm        | ASTM D5185m     | 0           | 0        | <1   |
| Aluminum | ppm        | ASTM D5185m >20 | <1          | <1       | <1   |
| Lead     | ppm        | ASTM D5185m >20 | ▲ <b>32</b> | ▲ 56     | ▲ 22 |
| Copper   | ppm        | ASTM D5185m >20 | <b>12</b>   | ▲ 20     | 11   |
| Tin      | ppm        | ASTM D5185m >20 | <1          | 0        | <1   |
| Vanadium | ppm        | ASTM D5185m     | 0           | <1       | 0    |
| Cadmium  | ppm        | ASTM D5185m     | 0           | 0        | 0    |

**ADDITIVES**

| method     | limit/base | current     | history1 | history2 |    |
|------------|------------|-------------|----------|----------|----|
| Boron      | ppm        | ASTM D5185m | 0        | 0        | 0  |
| Barium     | ppm        | ASTM D5185m | 2        | 0        | 0  |
| Molybdenum | ppm        | ASTM D5185m | 0        | 0        | 0  |
| Manganese  | ppm        | ASTM D5185m | 0        | <1       | <1 |
| Magnesium  | ppm        | ASTM D5185m | 65       | 38       | 76 |
| Calcium    | ppm        | ASTM D5185m | 0        | 0        | 0  |
| Phosphorus | ppm        | ASTM D5185m | 2        | 12       | 13 |
| Zinc       | ppm        | ASTM D5185m | 4        | 5        | 2  |

**CONTAMINANTS**

| method    | limit/base | current         | history1     | history2 |       |
|-----------|------------|-----------------|--------------|----------|-------|
| Silicon   | ppm        | ASTM D5185m >15 | 2            | 5        | 6     |
| Sodium    | ppm        | ASTM D5185m     | <1           | <1       | 2     |
| Potassium | ppm        | ASTM D5185m >20 | <1           | 0        | 0     |
| Water     | %          | ASTM D6304 >2   | <b>0.026</b> | 0.023    | 0.027 |
| ppm Water | ppm        | ASTM D6304      | <b>260.3</b> | 233.9    | 273.7 |





**FLUID DEGRADATION**

| method           | limit/base | current    | history1     | history2 |      |
|------------------|------------|------------|--------------|----------|------|
| Acid Number (AN) | mg KOH/g   | ASTM D8045 | <b>0.383</b> | 0.506    | 0.44 |

**VISUAL**

| method           | limit/base | current       | history1     | history2 |       |
|------------------|------------|---------------|--------------|----------|-------|
| White Metal      | scalar     | *Visual NONE  | <b>NONE</b>  | VLITE    | LIGHT |
| Yellow Metal     | scalar     | *Visual NONE  | <b>NONE</b>  | NONE     | NONE  |
| Precipitate      | scalar     | *Visual NONE  | <b>NONE</b>  | NONE     | NONE  |
| Silt             | scalar     | *Visual NONE  | <b>NONE</b>  | NONE     | NONE  |
| Debris           | scalar     | *Visual NONE  | <b>NONE</b>  | NONE     | NONE  |
| Sand/Dirt        | scalar     | *Visual NONE  | <b>NONE</b>  | NONE     | NONE  |
| Appearance       | scalar     | *Visual NORML | <b>NORML</b> | NORML    | NORML |
| Odor             | scalar     | *Visual NORML | <b>NORML</b> | NORML    | NORML |
| Emulsified Water | scalar     | *Visual >2    | <b>NEG</b>   | NEG      | NEG   |
| Free Water       | scalar     | *Visual       | <b>NEG</b>   | NEG      | NEG   |

# OIL ANALYSIS REPORT

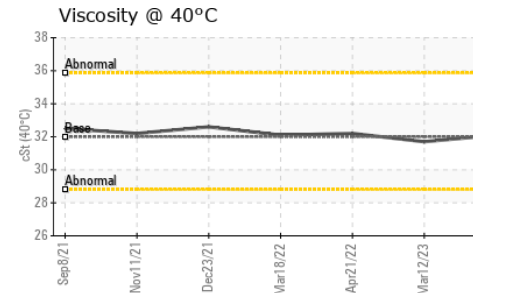
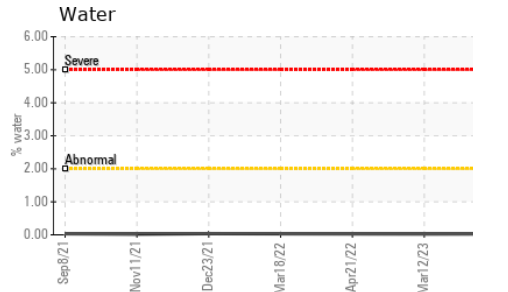
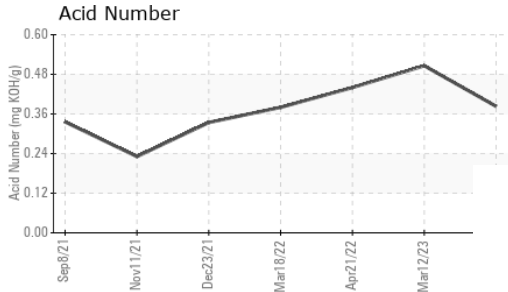
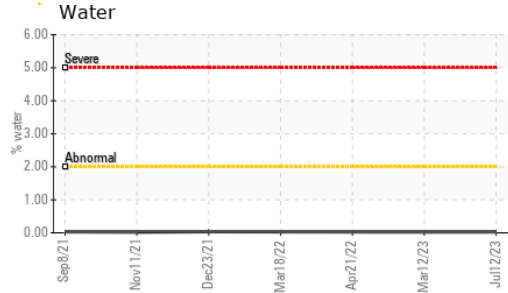


| FLUID PROPERTIES |     | method    | limit/base | current     | history1 | history2 |
|------------------|-----|-----------|------------|-------------|----------|----------|
| Visc @ 40°C      | cSt | ASTM D445 | 32         | <b>32.1</b> | 31.7     | 32.2     |

| SAMPLE IMAGES |  | method | limit/base | current | history1 | history2 |
|---------------|--|--------|------------|---------|----------|----------|
|---------------|--|--------|------------|---------|----------|----------|



## GRAPHS

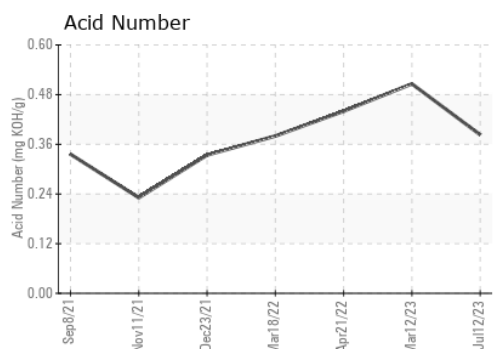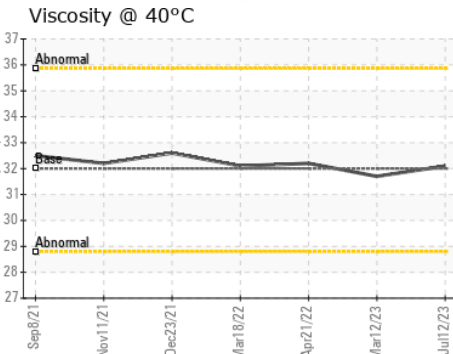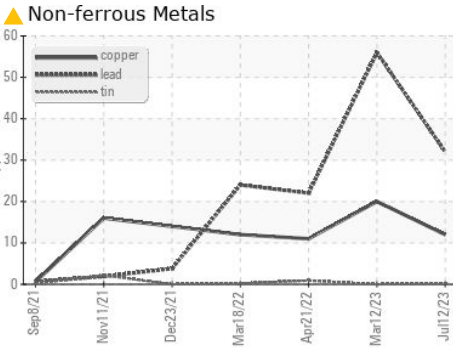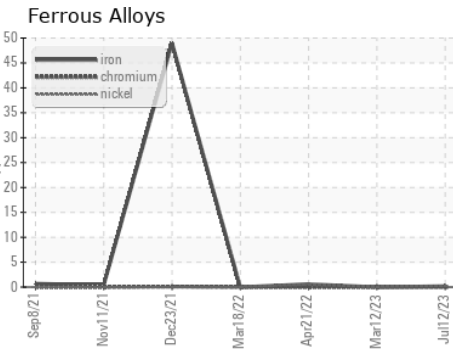

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0033011 **Received** : 14 Jul 2023  
**Lab Number** : **05898674** **Diagnosed** : 18 Jul 2023  
**Unique Number** : 10560030 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2

**ENERGY TRANSFER - MARCUS HOOK TF**  
 7 COMMERC DRIVE  
 ASTON, PA  
 US 19014  
 Contact: QUITA MORGAN

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (610)220-8386  
 F: