



# PROBLEM SUMMARY

Sample Rating Trend



DIRT



Area  
**CS-46 [2793820]**  
 Machine Id  
**SULLAIR 201605310004 - CASCADE DESIGNS**  
 Component  
**Compressor**



## COMPONENT CONDITION SUMMARY

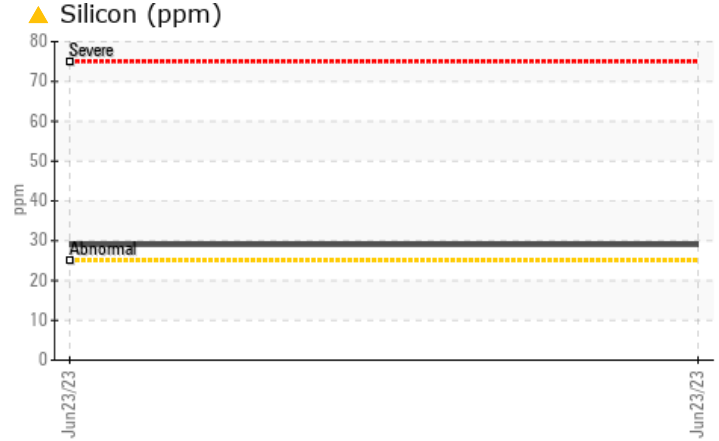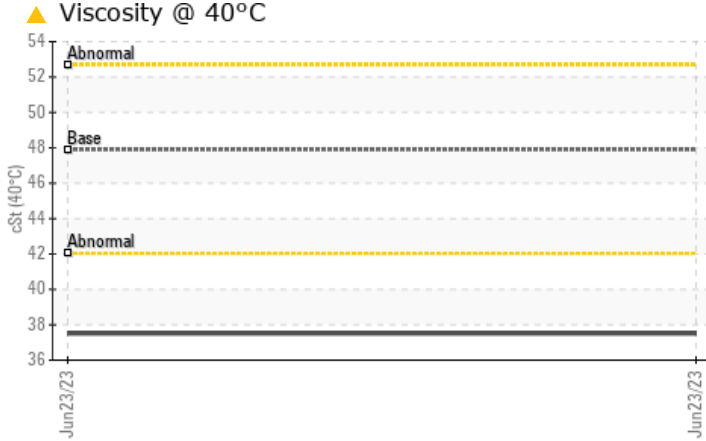

## RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status	ABNORMAL		---	---
Silicon	ppm	ASTM D5185m >25	▲ 29	---
Visc @ 40°C	cSt	ASTM D445 47.9	▲ 37.51	---

Customer Id: UCCISSAC  
 Sample No.: UCH05898698  
 Lab Number: 05898698  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Angela Borella +1 800-237-1369  
[angela.borella@wearcheckusa.com](mailto:angela.borella@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

## HISTORICAL DIAGNOSIS



# OIL ANALYSIS REPORT

Sample Rating Trend



DIRT



Area  
**CS-46 [2793820]**  
 Machine Id  
**SULLAIR 201605310004 - CASCADE DESIGNS**  
 Component  
**Compressor**

## DIAGNOSIS

### ▲ Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

Elemental level of silicon (Si) above normal indicating ingress of seal material.

### ▲ Fluid Condition

The oil viscosity is lower than normal. Confirm oil type.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH05898698</b>	---	---
Sample Date	Client Info		<b>23 Jun 2023</b>	---	---
Machine Age	hrs	Client Info	<b>29853</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>Changed</b>	---	---
Sample Status			<b>ABNORMAL</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m >10	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185m	<b>0</b>	---	---
Silver	ppm	ASTM D5185m	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >25	<b>&lt;1</b>	---	---
Lead	ppm	ASTM D5185m >25	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >50	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m >15	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 1.5	<b>0</b>	---	---
Barium	ppm	ASTM D5185m 0	<b>2</b>	---	---
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m 0.3	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m 0	<b>0</b>	---	---
Calcium	ppm	ASTM D5185m 0	<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m 406	<b>4</b>	---	---
Zinc	ppm	ASTM D5185m 0	<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m 1283	<b>3352</b>	---	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>▲ 29</b>	---	---
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	---	---

## FLUID DEGRADATION




	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.463	<b>0.056</b>	---	---

## VISUAL

	method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	*Visual NONE	<b>NONE</b>	---	---
Precipitate	scalar	*Visual NONE	<b>NONE</b>	---	---
Silt	scalar	*Visual NONE	<b>NONE</b>	---	---
Debris	scalar	*Visual NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	*Visual NONE	<b>NONE</b>	---	---
Appearance	scalar	*Visual NORML	<b>NORML</b>	---	---
Odor	scalar	*Visual NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	*Visual >0.1	<b>NEG</b>	---	---
Free Water	scalar	*Visual	<b>NEG</b>	---	---







# OIL ANALYSIS REPORT

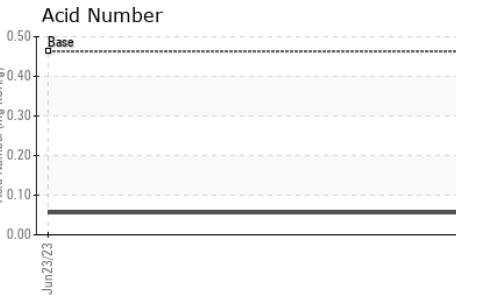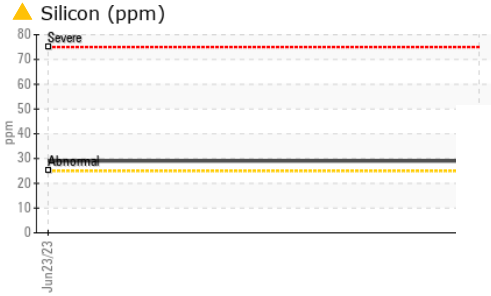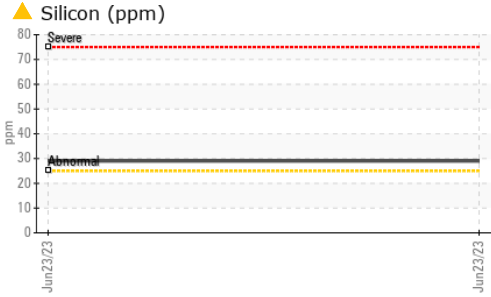

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	47.9	▲ 37.51	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

## GRAPHS

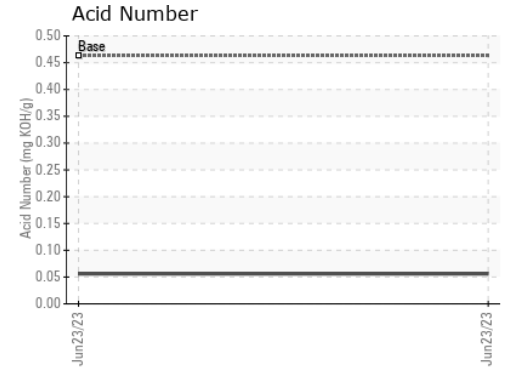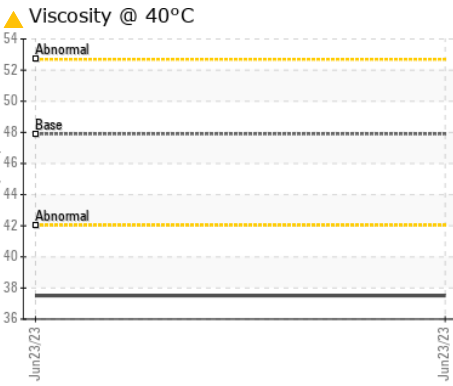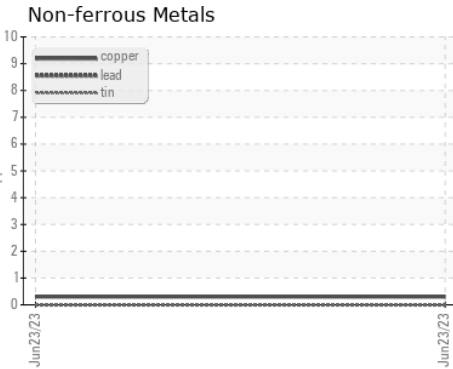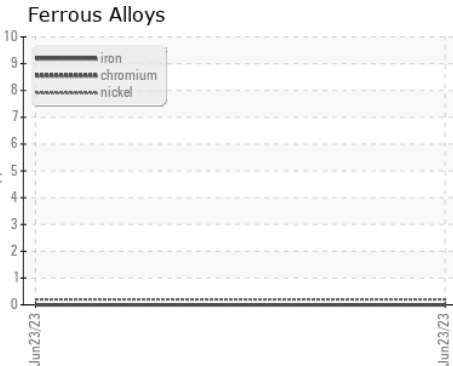

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH05898698 **Received** : 14 Jul 2023  
**Lab Number** : 05898698 **Diagnosed** : 20 Jul 2023  
**Unique Number** : 10560054 **Diagnostician** : Angela Borella  
**Test Package** : IND 2

**CISCO AIR SYSTEMS**  
 214 27TH ST  
 SACRAMENTO, CA  
 US 95816  
 Contact: BARRY FRKOVICH  
 barryfrkovich@ciscoair.com  
 T: (916)444-2525  
 F: x:

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)