

# **PROBLEM SUMMARY**

Sample Rating Trend


ISO ISO

8303271 (S/N 1186)

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

### **COMPONENT CONDITION SUMMARY**

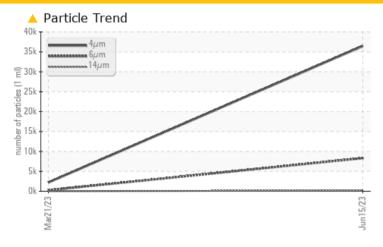

#### RECOMMENDATION

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST	RESULTS				
Sample Status			ABNORMAL	NORMAL	
Particles >6µm	ASTM D7647	>1300	<b>A</b> 8319	261	
Particles >14µm	ASTM D7647	>80	<u> </u>	10	
Particles >21µm	ASTM D7647	>20	<b>4</b> 34	3	
Oil Cleanliness	ISO 4406 (c)	>/17/13	<b>22/20/15</b>	18/15/10	

Customer Id: MAPWIL Sample No.: KC100949 Lab Number: 05899329 Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data: Jonathan Hester +1 919-379-4092 x4092 jhester@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

### **RECOMMENDED ACTIONS**

There are no recommended actions for this sample.

### HISTORICAL DIAGNOSIS

### 21 Mar 2023 Diag: Angela Borella

NORMAL



The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





# **OIL ANALYSIS REPORT**

ISO

8303271 (S/N 1186)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

### **DIAGNOSIS**

#### Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

## Contamination

There is a high amount of particulates present in the oil.

#### **Fluid Condition**


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

	Mar2023	Jun2023	
hod	limit/base	current	

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC100949	KC112386	
Sample Date		Client Info		15 Jun 2023	21 Mar 2023	
Machine Age	hrs	Client Info		693	418	
Oil Age	hrs	Client Info		693	418	
Oil Changed		Client Info		Not Changd	Not Changd	
Sample Status				ABNORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	3	2	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	1	<1	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		<1	0	
Magnesium	ppm	ASTM D5185m	100	41	65	
Calcium	ppm	ASTM D5185m	0	0	0	
Phosphorus	ppm	ASTM D5185m	0	5	2	
Zinc	ppm	ASTM D5185m	0	11	4	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25		,	,
Sodium	PP			<1	0	
	nnm		>20	<1 10	0	
	ppm	ASTM D5185m		10	9	
Potassium	ppm	ASTM D5185m ASTM D5185m	>20	10 28	9 38	
		ASTM D5185m ASTM D5185m		10	9	
Potassium Water	ppm % ppm	ASTM D5185m ASTM D5185m ASTM D6304	>20 >0.05	10 28 0.019	9 38 0.030	
Potassium Water ppm Water FLUID CLEANLIN	ppm % ppm	ASTM D5185m ASTM D5185m ASTM D6304 ASTM D6304	>20 >0.05 >500	10 28 0.019 194.9 current	9 38 0.030 303.0	
Potassium Water ppm Water FLUID CLEANLIN Particles >4µm	ppm % ppm	ASTM D5185m ASTM D5185m ASTM D6304 ASTM D6304 method ASTM D7647	>20 >0.05 >500	10 28 0.019 194.9	9 38 0.030 303.0 history1	   history2
Potassium Water ppm Water FLUID CLEANLIN	ppm % ppm	ASTM D5185m ASTM D5185m ASTM D6304 ASTM D6304 method ASTM D7647	>20 >0.05 >500 limit/base	10 28 0.019 194.9 current 36432	9 38 0.030 303.0 history1 2206	  history2
Potassium Water ppm Water FLUID CLEANLIN Particles >4µm Particles >6µm Particles >14µm	ppm % ppm	ASTM D5185m ASTM D5185m ASTM D6304 ASTM D6304 method ASTM D7647 ASTM D7647	>20 >0.05 >500 limit/base >1300 >80	10 28 0.019 194.9  current 36432  8319  175	9 38 0.030 303.0 history1 2206 261 10	  history2
Potassium Water ppm Water FLUID CLEANLIN Particles >4µm Particles >6µm Particles >14µm Particles >21µm	ppm % ppm	ASTM D5185m ASTM D5185m ASTM D6304 ASTM D6304 method ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647	>20 >0.05 >500 limit/base >1300 >80	10 28 0.019 194.9 current 36432 ▲ 8319 ▲ 175 ▲ 34	9 38 0.030 303.0 history1 2206 261	  history2
Potassium Water ppm Water FLUID CLEANLIN Particles >4µm Particles >6µm Particles >14µm Particles >21µm Particles >38µm	ppm % ppm	ASTM D5185m ASTM D5185m ASTM D6304 ASTM D6304 method ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647	>20 >0.05 >500 limit/base >1300 >80 >20 >4	10 28 0.019 194.9  current 36432  8319  175  34 3	9 38 0.030 303.0 history1 2206 261 10 3 0	history2
Potassium Water ppm Water FLUID CLEANLIN Particles >4µm Particles >6µm Particles >14µm Particles >21µm	ppm % ppm	ASTM D5185m ASTM D5185m ASTM D6304 ASTM D6304 method ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647	>20 >0.05 >500 limit/base >1300 >80 >20 >4	10 28 0.019 194.9 current 36432 ▲ 8319 ▲ 175 ▲ 34	9 38 0.030 303.0 history1 2206 261 10 3	history2
Potassium Water ppm Water FLUID CLEANLIN Particles >4µm Particles >6µm Particles >14µm Particles >21µm Particles >38µm Particles >71µm	ppm % ppm ESS	ASTM D5185m ASTM D5185m ASTM D6304 ASTM D6304 method ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647	>20 >0.05 >500 limit/base >1300 >80 >20 >4 >3	10 28 0.019 194.9  current 36432  ▲ 8319  ▲ 175  ▲ 34 3 0	9 38 0.030 303.0 history1 2206 261 10 3 0	history2



# **OIL ANALYSIS REPORT**

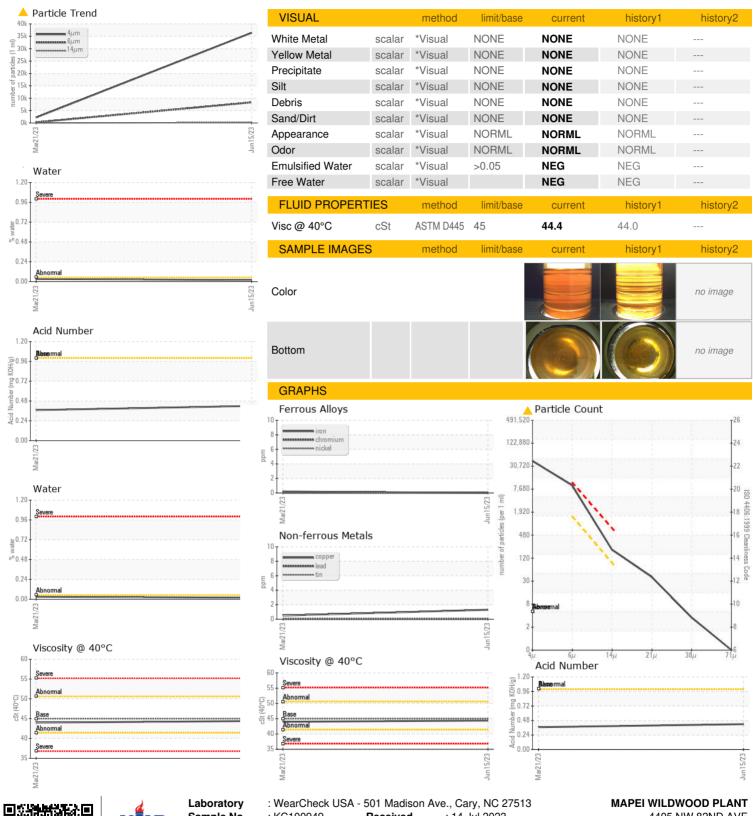





Certificate L2367

Sample No. Lab Number **Unique Number** Test Package

: KC100949 +05899329

: 10560685 : IND 2

: 14 Jul 2023 Received Diagnosed : 18 Jul 2023

Diagnostician : Jonathan Hester

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

4405 NW 82ND AVE WILDWOOD, FL

US 34785

Contact: Service Manager

T: F: