




PROBLEM SUMMARY

Sample Rating Trend

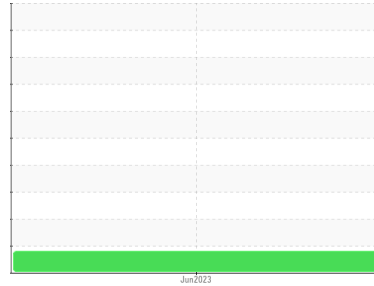


ISO



Machine Id
KAESER ASD 40T 8276307 (S/N 1290)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

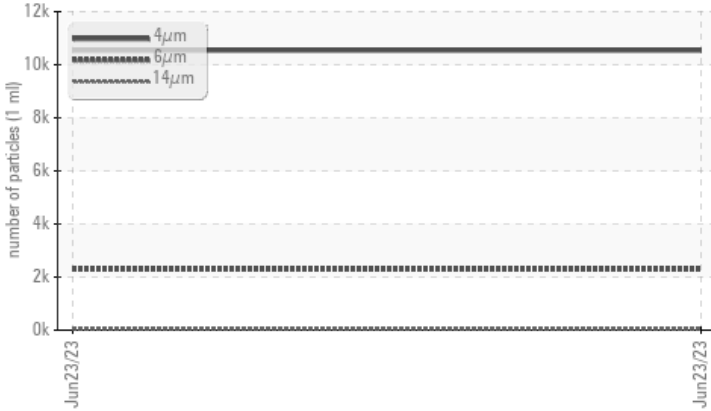

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

| | | | | | |
|-----------------|--------------|-----------|-------------------|-----|-----|
| Sample Status | | | ATTENTION | --- | --- |
| Particles >6µm | ASTM D7647 | >1300 | ▲ 2290 | --- | --- |
| Oil Cleanliness | ISO 4406 (c) | >--/17/13 | ▲ 21/18/13 | --- | --- |

Customer Id: CONAUS
 Sample No.: KCPA002061
 Lab Number: 05899342
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS


There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend

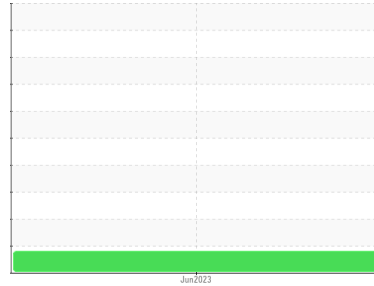

ISO



Machine Id
KAESER ASD 40T 8276307 (S/N 1290)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|----------|----------|
| Sample Number | Client Info | | | KCPA002061 | --- | --- |
| Sample Date | Client Info | | | 23 Jun 2023 | --- | --- |
| Machine Age | hrs | Client Info | | 3468 | --- | --- |
| Oil Age | hrs | Client Info | | 0 | --- | --- |
| Oil Changed | Client Info | | | N/A | --- | --- |
| Sample Status | | | | ATTENTION | --- | --- |

| WEAR METALS | | method | limit/base | current | history1 | history2 |
|-------------|-----|-------------|------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185m | >50 | 1 | --- | --- |
| Chromium | ppm | ASTM D5185m | >10 | 0 | --- | --- |
| Nickel | ppm | ASTM D5185m | >3 | 0 | --- | --- |
| Titanium | ppm | ASTM D5185m | >3 | 0 | --- | --- |
| Silver | ppm | ASTM D5185m | >2 | 0 | --- | --- |
| Aluminum | ppm | ASTM D5185m | >10 | <1 | --- | --- |
| Lead | ppm | ASTM D5185m | >10 | 0 | --- | --- |
| Copper | ppm | ASTM D5185m | >50 | 4 | --- | --- |
| Tin | ppm | ASTM D5185m | >10 | 0 | --- | --- |
| Vanadium | ppm | ASTM D5185m | | <1 | --- | --- |
| Cadmium | ppm | ASTM D5185m | | 0 | --- | --- |

| ADDITIVES | | method | limit/base | current | history1 | history2 |
|------------|-----|-------------|------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185m | 0 | 0 | --- | --- |
| Barium | ppm | ASTM D5185m | 90 | 0 | --- | --- |
| Molybdenum | ppm | ASTM D5185m | 0 | 0 | --- | --- |
| Manganese | ppm | ASTM D5185m | | <1 | --- | --- |
| Magnesium | ppm | ASTM D5185m | 100 | 58 | --- | --- |
| Calcium | ppm | ASTM D5185m | 0 | 0 | --- | --- |
| Phosphorus | ppm | ASTM D5185m | 0 | 5 | --- | --- |
| Zinc | ppm | ASTM D5185m | 0 | 4 | --- | --- |
| Sulfur | ppm | ASTM D5185m | 23500 | 21045 | --- | --- |


| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m | >25 | <1 | --- | --- |
| Sodium | ppm | ASTM D5185m | | 16 | --- | --- |
| Potassium | ppm | ASTM D5185m | >20 | 10 | --- | --- |
| Water | % | ASTM D6304 | >0.05 | 0.026 | --- | --- |
| ppm Water | ppm | ASTM D6304 | >500 | 263.9 | --- | --- |

| FLUID CLEANLINESS | | method | limit/base | current | history1 | history2 |
|-------------------|--|--------------|------------|-------------------|----------|----------|
| Particles >4µm | | ASTM D7647 | | 10540 | --- | --- |
| Particles >6µm | | ASTM D7647 | >1300 | ▲ 2290 | --- | --- |
| Particles >14µm | | ASTM D7647 | >80 | 47 | --- | --- |
| Particles >21µm | | ASTM D7647 | >20 | 8 | --- | --- |
| Particles >38µm | | ASTM D7647 | >4 | 1 | --- | --- |
| Particles >71µm | | ASTM D7647 | >3 | 0 | --- | --- |
| Oil Cleanliness | | ISO 4406 (c) | >--/17/13 | ▲ 21/18/13 | --- | --- |


| FLUID DEGRADATION | | method | limit/base | current | history1 | history2 |
|-------------------|----------|------------|------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 1.0 | 0.35 | --- | --- |

OIL ANALYSIS REPORT


▲ Particle Trend

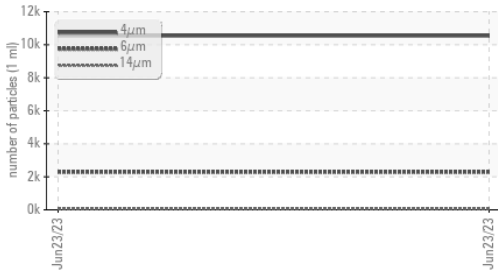


Water

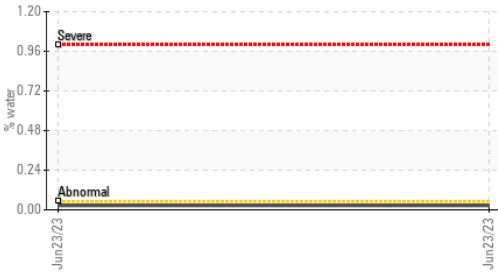

Acid Number

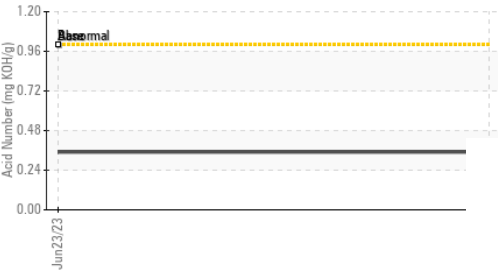

Water

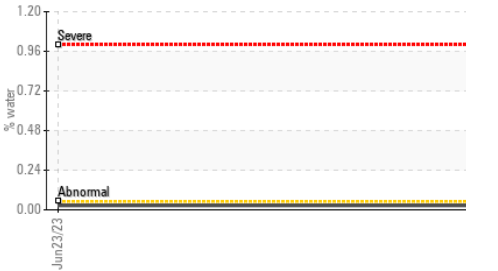

Viscosity @ 40°C



| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | --- |
| Yellow Metal | scalar | *Visual | NONE | NONE | --- |
| Precipitate | scalar | *Visual | NONE | NONE | --- |
| Silt | scalar | *Visual | NONE | NONE | --- |
| Debris | scalar | *Visual | NONE | NONE | --- |
| Sand/Dirt | scalar | *Visual | NONE | NONE | --- |
| Appearance | scalar | *Visual | NORML | NORML | --- |
| Odor | scalar | *Visual | NORML | NORML | --- |
| Emulsified Water | scalar | *Visual | >0.05 | NEG | --- |
| Free Water | scalar | *Visual | | NEG | --- |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 45 | 44.2 | --- |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

| | | | |
|--------|--|----------|----------|
| Color | | no image | no image |
| Bottom | | no image | no image |

GRAPHS


Ferrous Alloys




Non-ferrous Metals



Viscosity @ 40°C

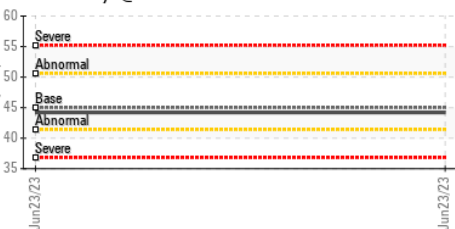

▲ Particle Count

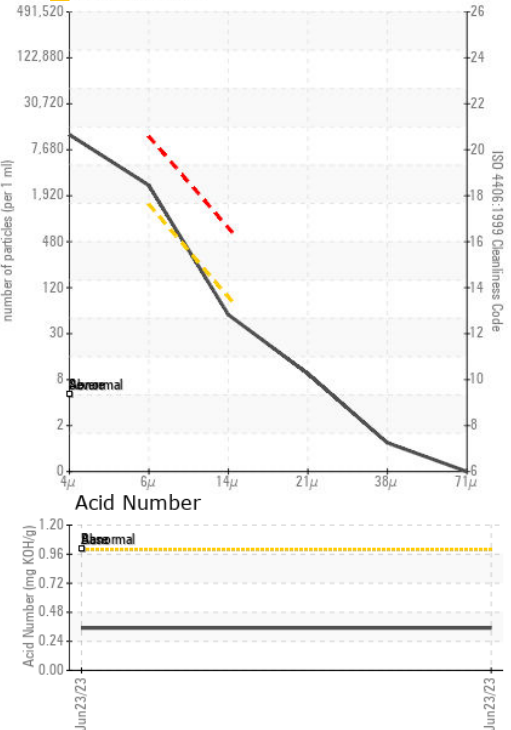

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA002061 **Received** : 14 Jul 2023
Lab Number : 05899342 **Diagnosed** : 18 Jul 2023
Unique Number : 10560698 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

CONTAINER MANUFACTURING
 960 SIX FLAGS RD
 AUSTELL, GA
 US 30168
 Contact: ROBIN
 ROBIN@CONTAINERMFG.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: