




PROBLEM SUMMARY

Sample Rating Trend

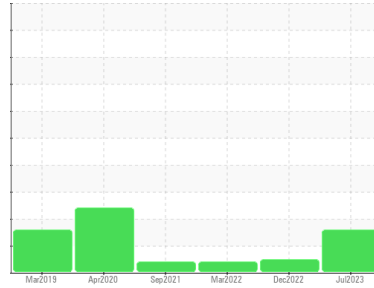


ADDITIVES



Machine Id
KAESER AIRCENTER SM15 6239898 (S/N 1061)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

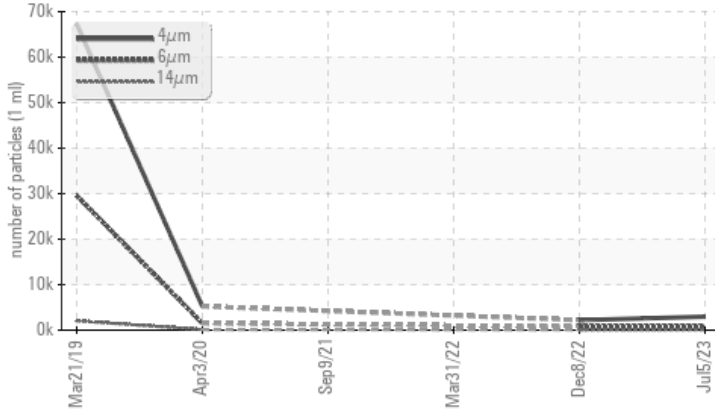

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	NORMAL	ABNORMAL
Magnesium	ppm	ASTM D5185m	100	▲ 37	51	47
Particles >14µm		ASTM D7647	>80	▲ 95	68	---
Particles >21µm		ASTM D7647	>20	▲ 36	22	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 19/17/14	18/17/13	---

Customer Id: CHEBEE
 Sample No.: KCPA004502
 Lab Number: 05899343
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

08 Dec 2022 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



31 Mar 2022 Diag: Angela Borella

VIS DEBRIS



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



09 Sep 2021 Diag: Don Baldrige

VIS DEBRIS




No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

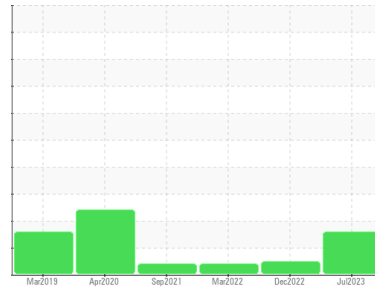

ADDITIVES



Machine Id
KAESER AIRCENTER SM15 6239898 (S/N 1061)

Component

Compressor

Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a moderate amount of particulates present in the oil.

▲ Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA004502	KCP52075	KCP44320
Sample Date	Client Info		05 Jul 2023	08 Dec 2022	31 Mar 2022
Machine Age	hrs	Client Info	20343	34154	31152
Oil Age	hrs	Client Info	0	4825	3656
Oil Changed	Client Info		N/A	Changed	Not Chngd
Sample Status			ABNORMAL	NORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	<1	1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	<1	0
Aluminum	ppm	ASTM D5185m >10	<1	<1	3
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	8	10	6
Tin	ppm	ASTM D5185m >10	0	0	0
Antimony	ppm	ASTM D5185m	---	---	---
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	<1
Barium	ppm	ASTM D5185m 90	0	5	26
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m 100	▲ 37	51	47
Calcium	ppm	ASTM D5185m 0	0	0	0
Phosphorus	ppm	ASTM D5185m 0	5	<1	31
Zinc	ppm	ASTM D5185m 0	24	42	4
Sulfur	ppm	ASTM D5185m 23500	21448	25532	11875

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	2	1
Sodium	ppm	ASTM D5185m	12	7	6
Potassium	ppm	ASTM D5185m >20	2	2	<1
Water	%	ASTM D6304 >0.05	0.020	0.021	0.012
ppm Water	ppm	ASTM D6304 >500	203.1	217.9	121.2






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		2965	2194	---
Particles >6µm	ASTM D7647 >1300		795	728	---
Particles >14µm	ASTM D7647 >80		▲ 95	68	---
Particles >21µm	ASTM D7647 >20		▲ 36	22	---
Particles >38µm	ASTM D7647 >4		1	1	---
Particles >71µm	ASTM D7647 >3		0	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 19/17/14	18/17/13	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.33	0.52	0.34


OIL ANALYSIS REPORT

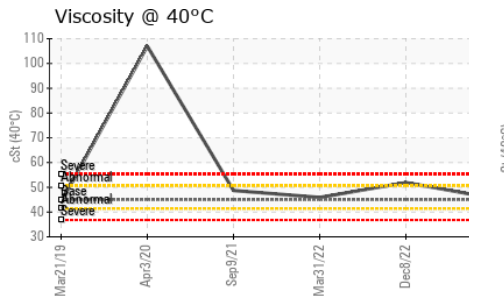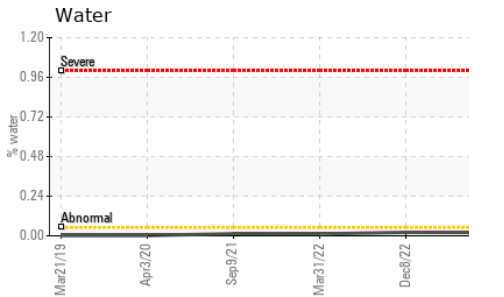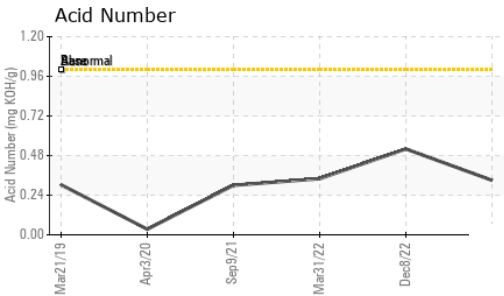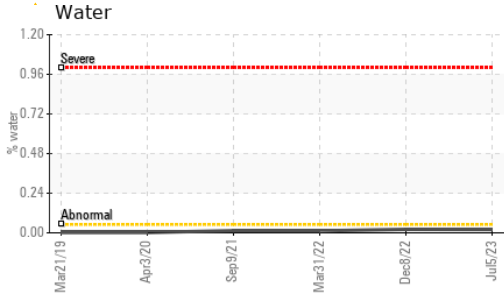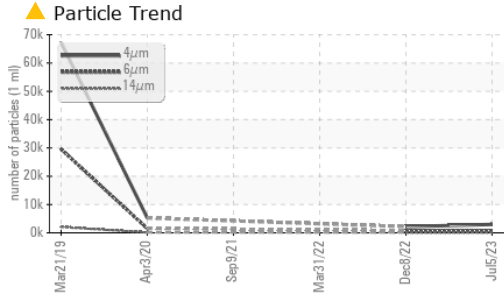






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	LIGHT	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	45.7	51.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

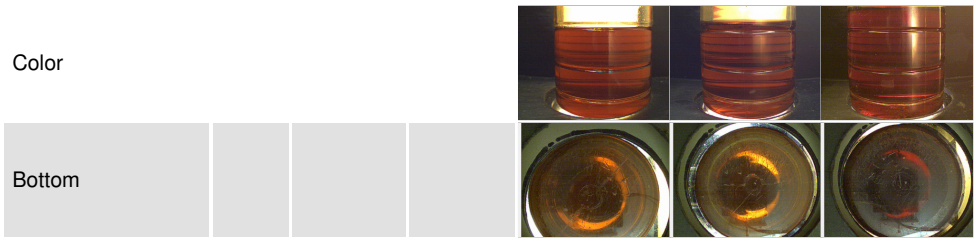

GRAPHS

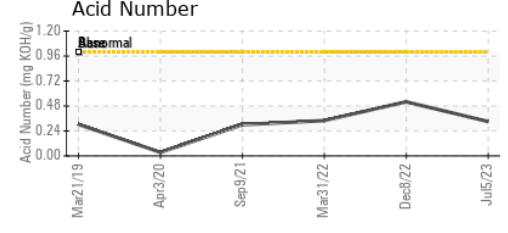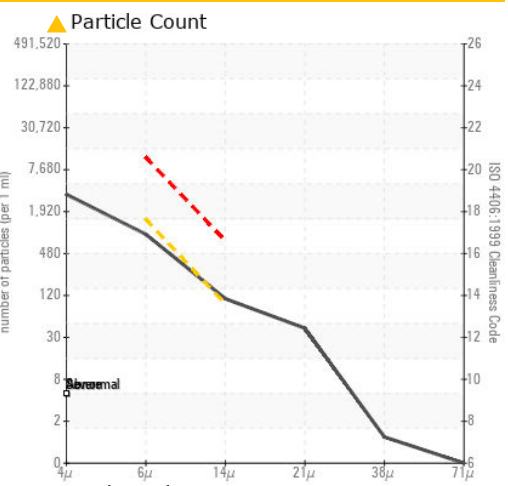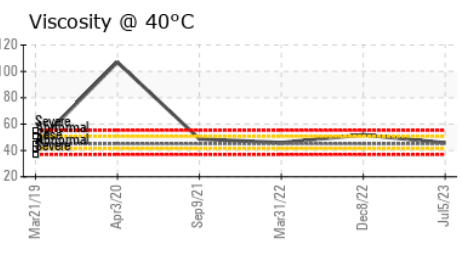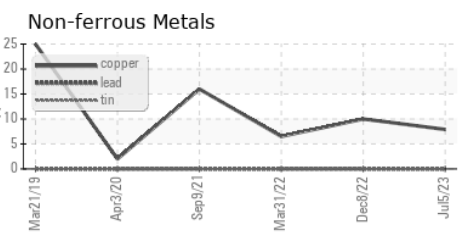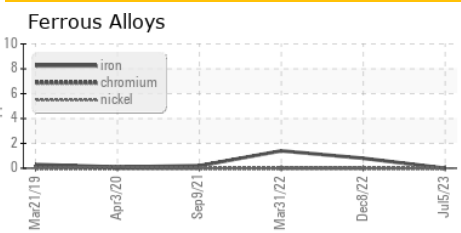

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA004502 **Received** : 14 Jul 2023
Lab Number : 05899343 **Diagnosed** : 18 Jul 2023
Unique Number : 10560699 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

CHEP
 246 OLD JACKSON HWY
 BEECH ISLAND, SC
 US 29842
 Contact: TRAVIS ALLEN
 travis.allen@chep.com
 T:
 F:

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)