

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

Machine Id KAESER CSD 60 8010341 (S/N 1027)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Mar2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC05899347		
Sample Date		Client Info		13 Mar 2023		
Machine Age	hrs	Client Info		6373		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	8		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	30	0		
Manganese		ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	90	<1		
Calcium		ASTM D5185m	2	0		
	ppm	ASTM D5185m	2	-		
Phosphorus	ppm			5 0		
Zinc	ppm	ASTM D5185m		U		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		1		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.05	0.007		
ppm Water	ppm	ASTM D6304	>500	75.6		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		642		
Particles >6µm		ASTM D7647	>1300	121		
Particles >14µm		ASTM D7647	>80	4		
Particles >21µm		ASTM D7647	>20	0		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/14/9		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2


Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.37



OIL ANALYSIS REPORT

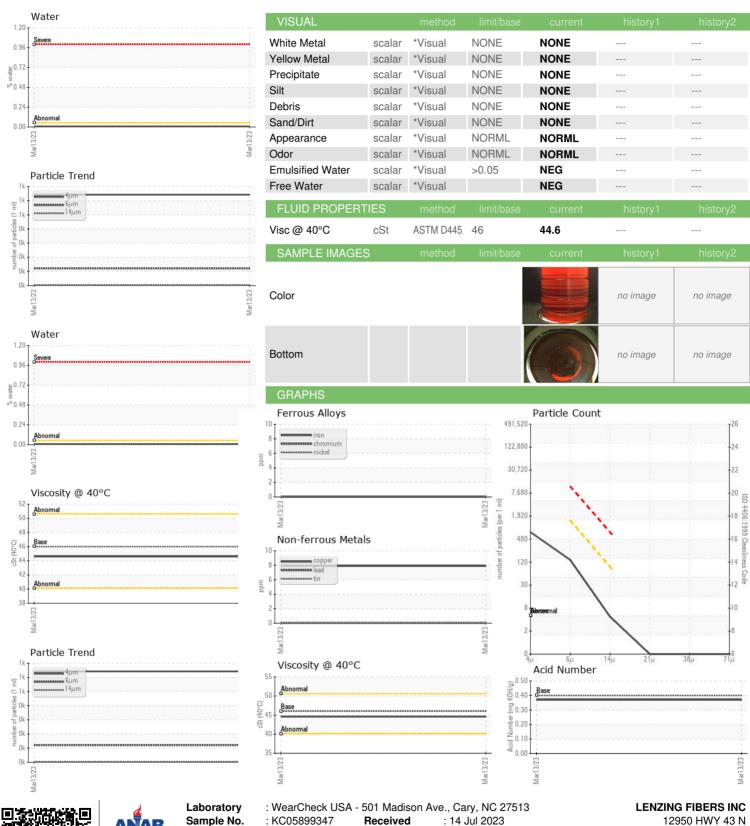





Certificate L2367

Sample No. Lab Number Unique Number Test Package : IND 2

: KC05899347 +05899347

Received Diagnosed : 10560703

: 18 Jul 2023 Diagnostician : Jonathan Hester

12950 HWY 43 N AXIS, FL US 36505

Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: