

OIL ANALYSIS REPORT

Free Water

scalar *Visual

ZT 20 [SR2878791] **ATLAS COPCO S99376402 -**Component

Compressor

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

Viscosity of sample indicates oil is within ISO 68 range, advise investigate. Confirm oil type. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

| - PG&E | | | | | | | |
|----------------------|----------|----------------------------|------------|-------------|----------|----------|--|
| | | | | | | | |
| | | | | Jun2023 | | | |
| SAMPLE INFORM | MATION | method | limit/base | current | history1 | history2 | |
| Sample Number | | Client Info | | UCH05899356 | | | |
| Sample Date | | Client Info | | 20 Jun 2023 | | | |
| Machine Age | hrs | Client Info | | 54503 | | | |
| Oil Age | hrs | Client Info | | 1200 | | | |
| Oil Changed | | Client Info | | Not Changd | | | |
| Sample Status | | | | NORMAL | | | |
| WEAR METALS | | method | limit/base | current | history1 | history2 | |
| Iron | ppm | ASTM D5185m | >50 | 0 | | | |
| Chromium | ppm | ASTM D5185m | >5 | 0 | | | |
| Nickel | ppm | ASTM D5185m | - | 0 | | | |
| Titanium | ppm | ASTM D5185m | | 0 | | | |
| Silver | ppm | ASTM D5185m | | 0 | | | |
| Aluminum | ppm | ASTM D5185m | >15 | ۰ <1 | | | |
| Lead | ppm | ASTM D5185m | >65 | 0 | | | |
| Copper | ppm | ASTM D5185m | >65 | ء <1 | | | |
| Tin | ppm | ASTM D5185m | >10 | 0 | | | |
| Vanadium | ppm | ASTM D5185m | - | ۰ <1 | | | |
| Cadmium | ppm | ASTM D5185m | | 0 | | | |
| ADDITIVES | P. P | method | limit/base | - | history1 | history2 | |
| | 0000 | | | | | | |
| Boron | ppm | ASTM D5185m | | 0 | | | |
| Barium | ppm | ASTM D5185m | | 4 | | | |
| Molybdenum | ppm | ASTM D5185m | | 0 | | | |
| Manganese | ppm | ASTM D5185m | | - | | | |
| Magnesium Calcium | ppm | ASTM D5185m | | <1 0 | | | |
| | ppm | ASTM D5185m ASTM D5185m | | 0 95 | | | |
| Phosphorus Zinc | ppm | ASTM D5185m ASTM D5185m | | 95 0 | | | |
| Zinc Sulfur | ppm | | | 0 587 | | | |
| | ppm | ASTM D5185m | | | | | |
| CONTAMINANTS | 5 | method | limit/base | | history1 | history2 | |
| Silicon | ppm | ASTM D5185m | >35 | 16 | | | |
| Sodium | ppm | ASTM D5185m | | <1 | | | |
| Potassium | ppm | ASTM D5185m | >20 | 0 | | | |
| FLUID DEGRAD | | method | limit/base | | history1 | history2 | |
| Acid Number (AN) | mg KOH/g | ASTM D8045 | | 0.19 | | | |
| VISUAL | | method | limit/base | current | history1 | history2 | |
| White Metal | scalar | *Visual | NONE | NONE | | | |
| Yellow Metal | scalar | *Visual | NONE | NONE | | | |
| Precipitate | scalar | *Visual | NONE | NONE | | | |
| Silt | scalar | *Visual | NONE | NONE | | | |
| Debris | scalar | *Visual | NONE | LIGHT | | | |
| Sand/Dirt | scalar | *Visual | NONE | NONE | | | |
| Appearance | scalar | *Visual | NORML | NORML | | | |
| Odor | scalar | *Visual | NORML | NORML | | | |
| Emulsified Water | scalar | *Visual | >0.1 | NEG | | | |
| Eree Mater | applan | *\/; | | NEC | | | |

Report Id: UCCISSAC [WUSCAR] 05899356 (Generated: 07/18/2023 17:09:27) Rev: 1

Contact/Location: BARRY FRKOVICH - UCCISSAC

NEG

Sample Rating Trend

NORMAL



OIL ANALYSIS REPORT


72.1

no image

no image

no image

no image

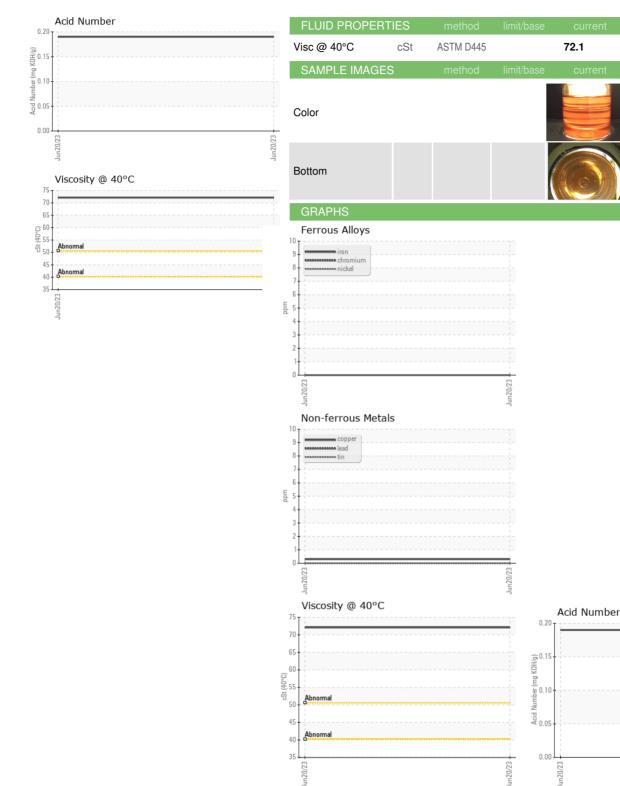

CISCO AIR SYSTEMS 214 27TH ST SACRAMENTO, CA US 95816 Contact: BARRY FRKOVICH barryfrkovich@ciscoair.com T: (916)444-2525 F: x:

Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: UCCISSAC [WUSCAR] 05899356 (Generated: 07/18/2023 17:09:27) Rev: 1

Laboratory

Sample No.

Lab Number

Unique Number : 10560712

Test Package : IND 2

: UCH05899356

: 05899356

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

: 14 Jul 2023

: 18 Jul 2023

Diagnostician : Angela Borella

Received

Diagnosed

Contact/Location: BARRY FRKOVICH - UCCISSAC