




PROBLEM SUMMARY

Sample Rating Trend

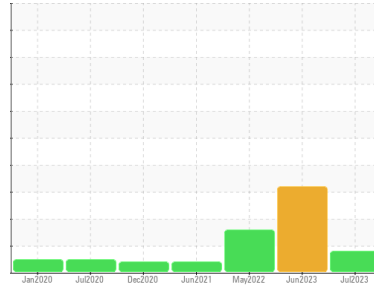

ISO



Area

Formulation-FHG

Machine Id

Sew Euro Drive FHG56MB01 Standardization Tank, Agitator

Component


Gearbox

Fluid

JAX FGG-AW ISO 220 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

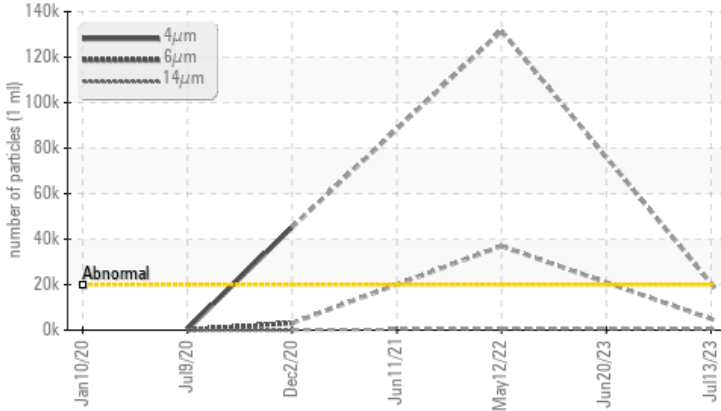

RECOMMENDATION

No corrective action is recommended at this time. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status		ATTENTION	ABNORMAL	ABNORMAL
Particles >4µm	ASTM D7647 >20000	▲ 20532	---	▲ 131541
Oil Cleanliness	ISO 4406 (c) >21/19/16	▲ 22/19/16	---	▲ 24/22/17

Customer Id: NOVFRANC
 Sample No.: WC0808220
 Lab Number: 05899919
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldrige +1
don.b505@comcast.net

To change component or sample information:

Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

20 Jun 2023 Diag: Jonathan Hester

WATER



We recommend you service the filters on this component if applicable. We recommend an early resample to monitor this condition. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. There is a moderate amount of visible silt present in the sample. Sample is layered with different type/density oil. The AN level is acceptable for this fluid.

view report



12 May 2022 Diag: Jonathan Hester

ISO



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



11 Jun 2021 Diag: Don Baldrige

VIS DEBRIS



We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

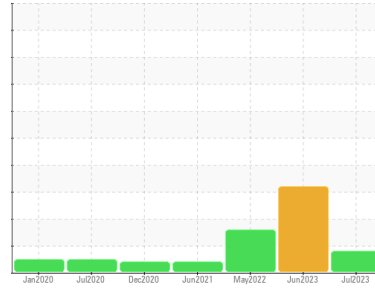

ISO



Area

Formulation-FHG

Machine Id

Sew Euro Drive FHG56MB01 Standardization Tank, Agitator

Component

Gearbox

Fluid

JAX FGG-AW ISO 220 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0808220	WC0782816	WC0675397
Sample Date	Client Info		13 Jul 2023	20 Jun 2023	12 May 2022
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ATTENTION	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >200	1	8	12
Chromium	ppm	ASTM D5185m >15	0	0	0
Nickel	ppm	ASTM D5185m >15	0	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	<1
Aluminum	ppm	ASTM D5185m >25	2	<1	3
Lead	ppm	ASTM D5185m >100	0	0	0
Copper	ppm	ASTM D5185m >200	0	0	0
Tin	ppm	ASTM D5185m >25	0	0	0
Antimony	ppm	ASTM D5185m >5	---	---	---
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	1
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	0	<1
Magnesium	ppm	ASTM D5185m	0	0	0
Calcium	ppm	ASTM D5185m	<1	<1	4
Phosphorus	ppm	ASTM D5185m	533	437	693
Zinc	ppm	ASTM D5185m	0	0	0
Sulfur	ppm	ASTM D5185m	491	323	502

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	4	5	6
Sodium	ppm	ASTM D5185m	<1	2	4
Potassium	ppm	ASTM D5185m >20	<1	0	0
Water	%	ASTM D6304 >0.2	0.004	0.003	0.024
ppm Water	ppm	ASTM D6304 >2000	40.5	26.3	245.5

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	▲ 20532	---	▲ 131541
Particles >6µm	ASTM D7647	>5000	4949	---	▲ 36949
Particles >14µm	ASTM D7647	>640	439	---	▲ 673
Particles >21µm	ASTM D7647	>160	64	---	67
Particles >38µm	ASTM D7647	>40	1	---	0
Particles >71µm	ASTM D7647	>10	0	---	0
Oil Cleanliness	ISO 4406 (c)	>21/19/16	▲ 22/19/16	---	▲ 24/22/17


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.68	0.68	0.71




OIL ANALYSIS REPORT


Particle Trend

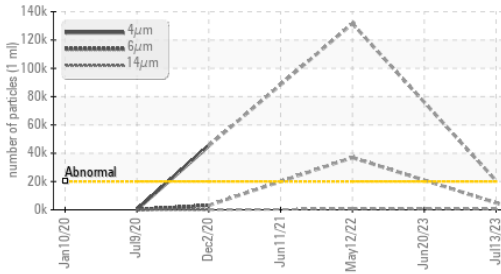


Water

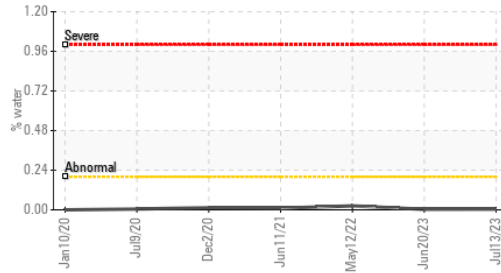


Acid Number

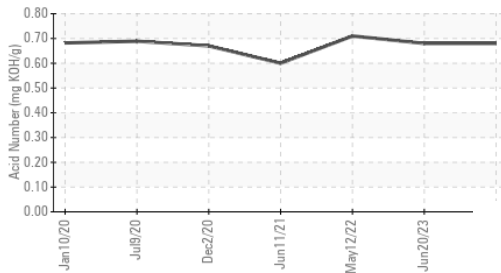

Water

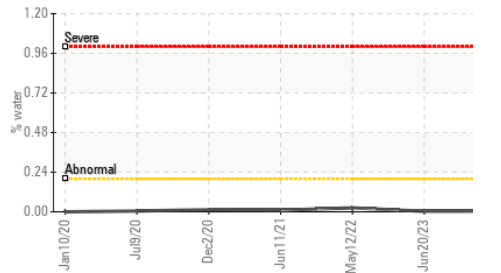

Viscosity @ 40°C

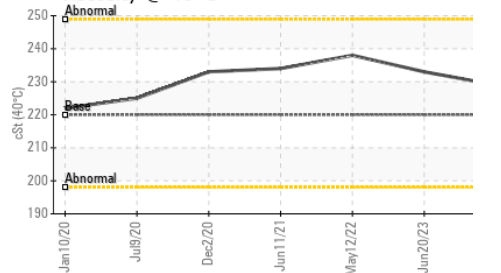

PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	▲ MODER	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	▲ SOLID	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		▲ >10%	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	220	229	233

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------




GRAPHS


Ferrous Alloys

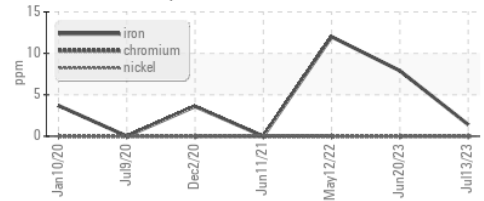


Non-ferrous Metals

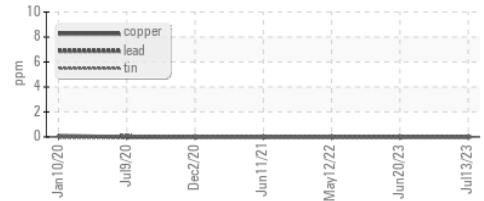


Viscosity @ 40°C

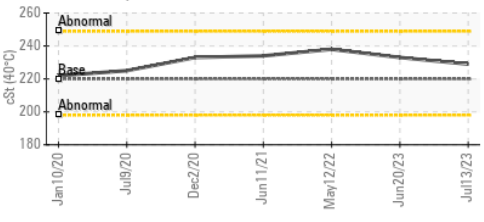

Particle Count

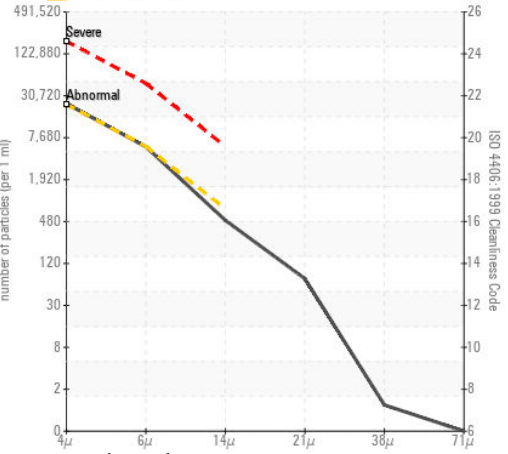

Acid Number

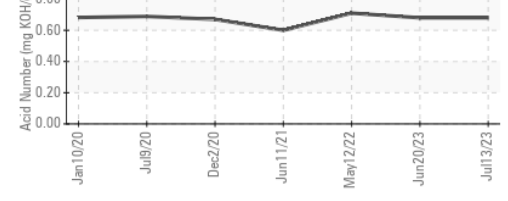

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0808220 **Received** : 17 Jul 2023
Lab Number : 05899919 **Diagnosed** : 18 Jul 2023
Unique Number : 10561275 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

NOVOZYMES
 P.O. BOX 576, 77 PERRY CHAPEL CHURCH ROAD
 FRANKLINTON, NC
 US 27525
 Contact: BRUCE THOMAS
 brct@novozymes.com
 T: (919)494-3146
 F: (919)494-3456

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)