

PROBLEM SUMMARY

Sample Rating Trend

ISO


7053226 (S/N 1216)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

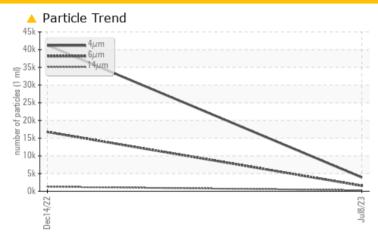

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS										
Sample Status			ABNORMAL	ABNORMAL						
Particles >6µm	ASTM D7647	>1300	1568	<u>▲</u> 16740						
Particles >14µm	ASTM D7647	>80	265	<u></u> 1287						
Particles >21µm	ASTM D7647	>20	4 96	△ 343						
Particles >38µm	ASTM D7647	>4	<u>^</u> 6	<u> </u>						
Oil Cleanliness	ISO 4406 (c)	>/17/13	19/18/15	<u>\$\Delta\$ 23/21/17</u>						

Customer Id: COUSACCA Sample No.: KCP35047 Lab Number: 05899965 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

14 Dec 2022 Diag: Doug Bogart

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend

ISO



7053226 (S/N 1216)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Dec2022	Jul2023		
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCP35047	KCP49417	
Sample Date		Client Info		08 Jul 2023	14 Dec 2022	
Machine Age	hrs	Client Info		7225	5695	
Oil Age	hrs	Client Info		3000	0	
Oil Changed		Client Info		Not Changd	Changed	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	<1	0	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	6	11	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	4	0	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	100	24	0	
Calcium	ppm	ASTM D5185m	0	0	0	
Phosphorus	ppm	ASTM D5185m	0	3	2	
Zinc	ppm	ASTM D5185m	0	<1	0	
Sulfur	ppm	ASTM D5185m	23500	22687	17174	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	2	
Sodium	ppm	ASTM D5185m		6	0	
Potassium	ppm	ASTM D5185m	>20	<1	0	
Water	%	ASTM D6304	>0.05	0.016	0.007	
ppm Water	ppm	ASTM D6304	>500	164.8	70.7	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3915	41271	
Particles >6μm		ASTM D7647	>1300	<u> </u>	<u>▲</u> 16740	
Particles >14μm		ASTM D7647	>80	<u>^</u> 265	<u> </u>	
Particles >21µm		ASTM D7647		<u>^</u> 96	▲ 343	
Particles >38μm		ASTM D7647	>4	<u>^</u> 6	<u> </u>	
Particles >71µm		ASTM D7647		1	1	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u> </u>	<u>△</u> 23/21/17	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	ma KOH/a	ASTM D8045	1.0	0.34	0.36	

Acid Number (AN)


mg KOH/g ASTM D8045 1.0

0.36

0.34



OIL ANALYSIS REPORT

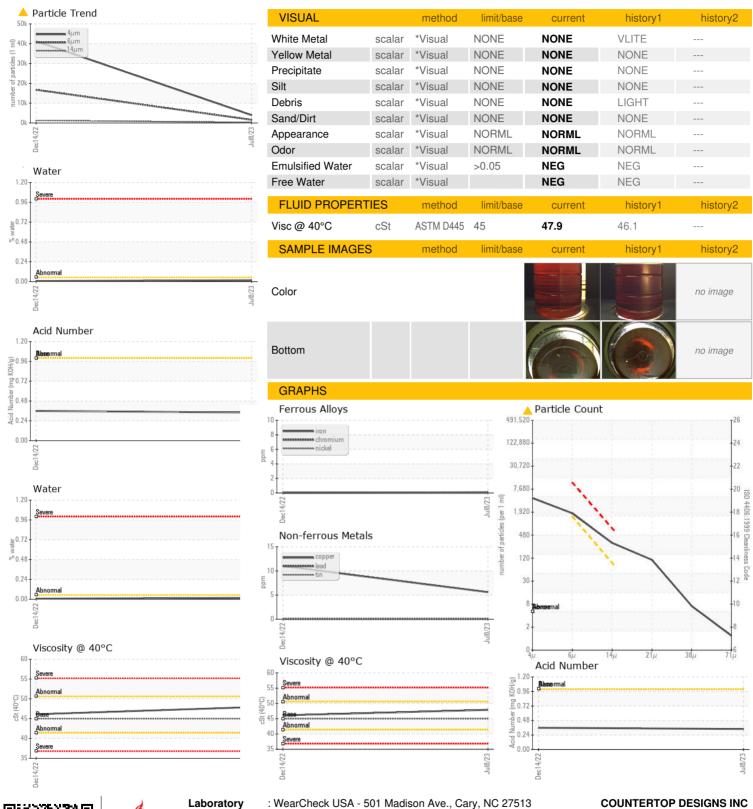





Certificate L2367

Laboratory Sample No. Lab Number **Unique Number**

: KCP35047 : 05899965

: 10561321

Received

: 17 Jul 2023 Diagnosed : 18 Jul 2023 Diagnostician : Don Baldridge

Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

1522 SILICA AVE SACRAMENTO, CA

US 95815

Contact: Service Manager

T: F: