




# OIL ANALYSIS REPORT

Sample Rating Trend

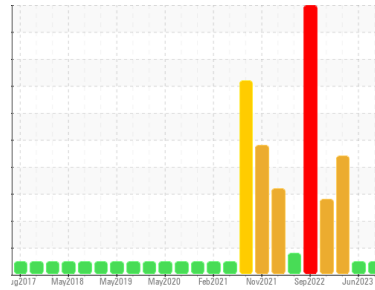

**NORMAL**



Area  
**97**  
Machine Id  
**[97] A97 Fan 901**  
Component  
**Center Gearbox**  
Fluid  
**GEAR LIFE 150 (5 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>HPL0003590</b>	HPL0003165	HPL0001764
Sample Date	Client Info			<b>11 Jul 2023</b>	05 Jun 2023	09 Mar 2023
Machine Age	hrs	Client Info		<b>720</b>	360	720
Oil Age	hrs	Client Info		<b>720</b>	0	720
Oil Changed	Client Info			<b>Not Changed</b>	Changed	Not Changed
Sample Status				<b>NORMAL</b>	NORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	<b>24</b>	24	26
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Silver	ppm	ASTM D5185m		<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m	>25	<b>1</b>	0	1
Lead	ppm	ASTM D5185m	>50	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m	>200	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	<1



ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	<1
Barium	ppm	ASTM D5185m		<b>0</b>	<1	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	2
Magnesium	ppm	ASTM D5185m		<b>1</b>	<1	11
Calcium	ppm	ASTM D5185m		<b>26</b>	22	10
Phosphorus	ppm	ASTM D5185m		<b>196</b>	203	137
Zinc	ppm	ASTM D5185m		<b>28</b>	24	43
Sulfur	ppm	ASTM D5185m		<b>24908</b>	25342	22440

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	<b>2</b>	2	2
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Potassium	ppm	ASTM D5185m	>20	<b>3</b>	2	1

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.68</b>	0.77	0.53

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>LIGHT</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	▲ HAZY
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	<b>NEG</b>	NEG	▲ 0.2%
Free Water	scalar	*Visual		<b>NEG</b>	NEG	▲ 1.0









# OIL ANALYSIS REPORT

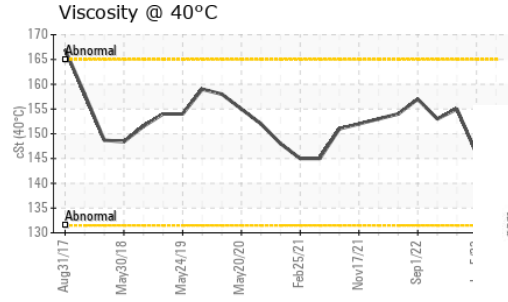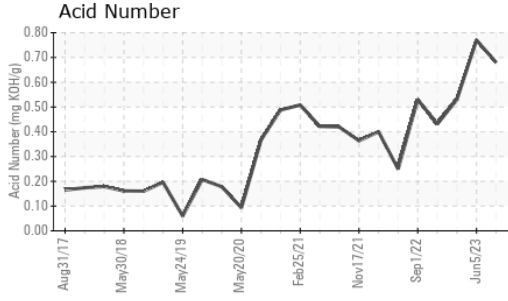

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445		<b>145</b>	146	155

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color				no image	no image	no image
Bottom				no image	no image	no image

## GRAPHS

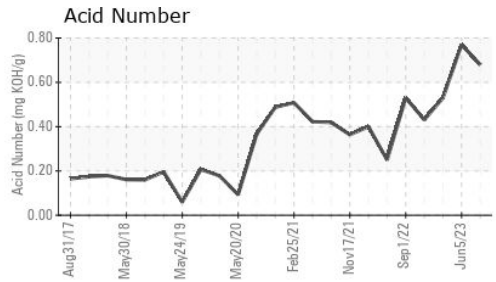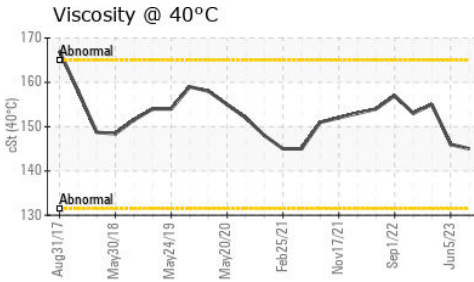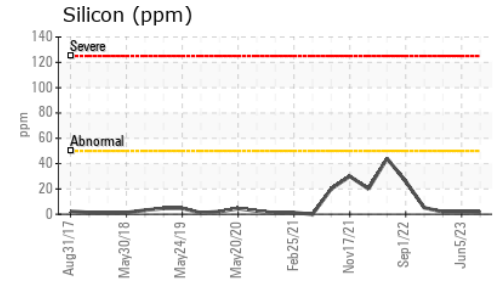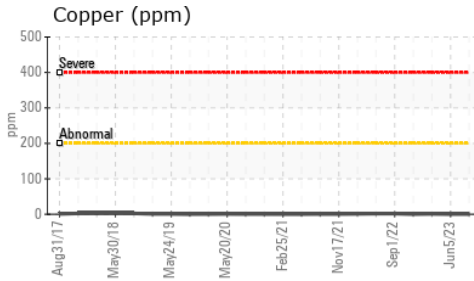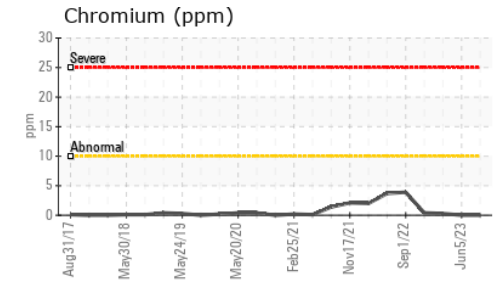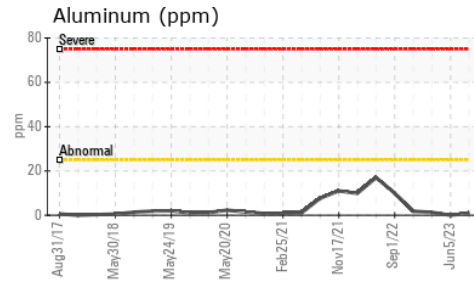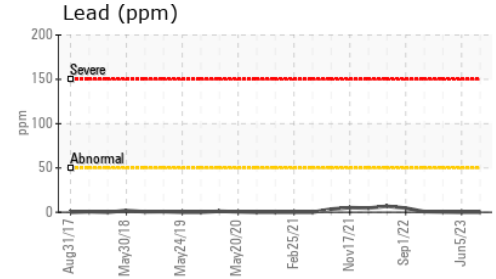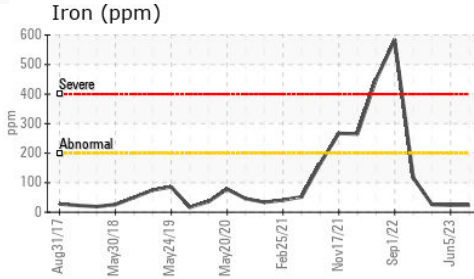

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : HPL0003590 **Received** : 17 Jul 2023  
**Lab Number** : 05900125 **Diagnosed** : 18 Jul 2023  
**Unique Number** : 10561481 **Diagnostician** : Wes Davis  
**Test Package** : MOB 2

**KENSING**  
 2525 S KENSINGTON RD  
 KANKAKEE, IL  
 US 60901

Contact: TIM HUBERT  
 timothy.hubert@kensingolutions.com  
 T: (815)939-8918

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: x: