




PROBLEM SUMMARY

Sample Rating Trend

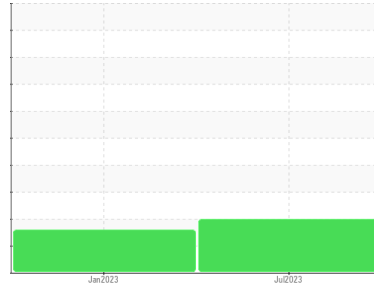

ISO




Machine Id
8223143 (S/N 1343)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- QTS)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

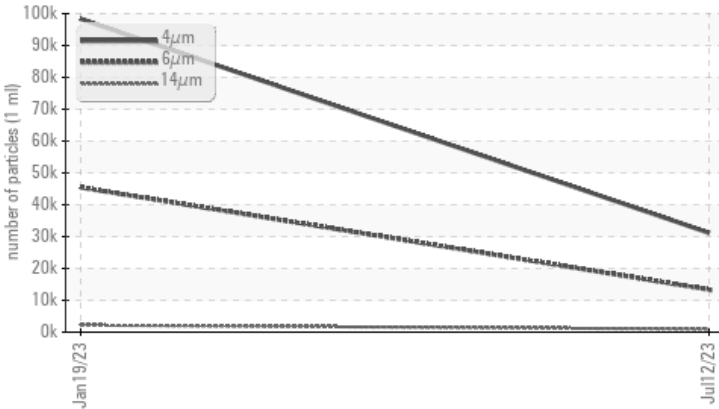

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	---
Particles >6µm	ASTM D7647	>1300	▲ 13340	▲ 45421	---
Particles >14µm	ASTM D7647	>80	▲ 911	▲ 2197	---
Particles >21µm	ASTM D7647	>20	▲ 211	▲ 172	---
Particles >38µm	ASTM D7647	>4	▲ 8	1	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 22/21/17	▲ 24/23/18	---

Customer Id: ROCORL
Sample No.: KC112378
Lab Number: 05900705
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.

HISTORICAL DIAGNOSIS

19 Jan 2023 Diag: Jonathan Hester

ISO




Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

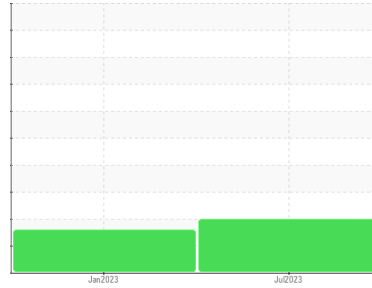

ISO



Machine Id
8223143 (S/N 1343)

Component

Compressor

Fluid

KAESER SIGMA (OEM) M-460 (--- QTS)

DIAGNOSIS

▲ Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KC112378	KC108321	---
Sample Date	Client Info	12 Jul 2023	19 Jan 2023	---
Machine Age	hrs	720	494	---
Oil Age	hrs	0	494	---
Oil Changed	Client Info	Not Changed	Changed	---
Sample Status		ABNORMAL	ABNORMAL	---

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm	ASTM D5185m >50	<1	1	---
Chromium ppm	ASTM D5185m >10	0	0	---
Nickel ppm	ASTM D5185m >3	<1	0	---
Titanium ppm	ASTM D5185m >3	0	0	---
Silver ppm	ASTM D5185m >2	0	0	---
Aluminum ppm	ASTM D5185m >10	0	0	---
Lead ppm	ASTM D5185m >10	<1	0	---
Copper ppm	ASTM D5185m >50	7	8	---
Tin ppm	ASTM D5185m >10	<1	0	---
Vanadium ppm	ASTM D5185m	0	0	---
Cadmium ppm	ASTM D5185m	0	0	---

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm	ASTM D5185m 0	0	0	---
Barium ppm	ASTM D5185m 90	0	3	---
Molybdenum ppm	ASTM D5185m 0	0	0	---
Manganese ppm	ASTM D5185m	0	<1	---
Magnesium ppm	ASTM D5185m 100	35	8	---
Calcium ppm	ASTM D5185m 0	0	0	---
Phosphorus ppm	ASTM D5185m 0	0	19	---
Zinc ppm	ASTM D5185m 0	4	14	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm	ASTM D5185m >25	5	4	---
Sodium ppm	ASTM D5185m	9	1	---
Potassium ppm	ASTM D5185m >20	2	1	---
Water %	ASTM D6304 >0.05	0.015	0.023	---
ppm Water	ASTM D6304 >500	159.7	236.5	---






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	31161	98328	---
Particles >6µm	ASTM D7647 >1300	▲ 13340	▲ 45421	---
Particles >14µm	ASTM D7647 >80	▲ 911	▲ 2197	---
Particles >21µm	ASTM D7647 >20	▲ 211	▲ 172	---
Particles >38µm	ASTM D7647 >4	▲ 8	1	---
Particles >71µm	ASTM D7647 >3	0	0	---
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 22/21/17	▲ 24/23/18	---

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g	ASTM D8045 1.0	0.31	0.26	---


OIL ANALYSIS REPORT

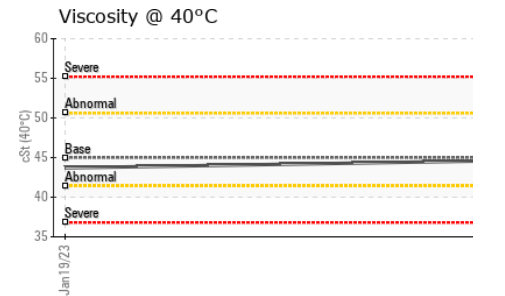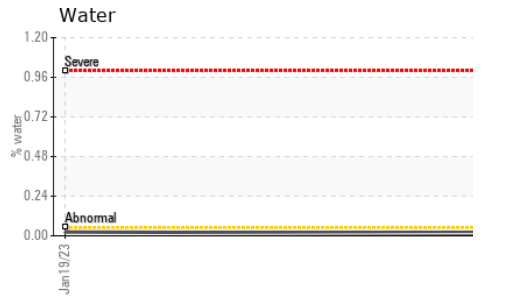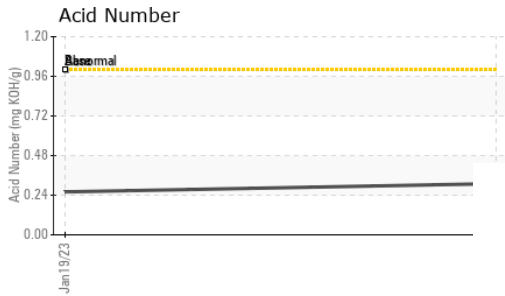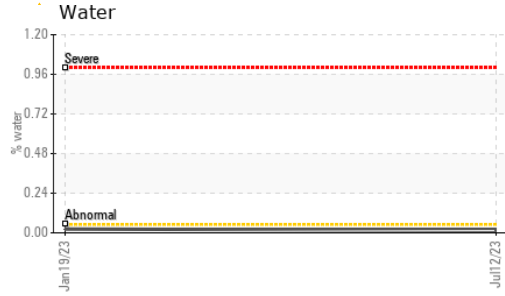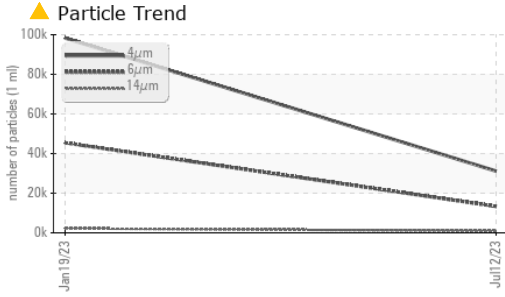





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	LIGHT	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	44.6	43.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

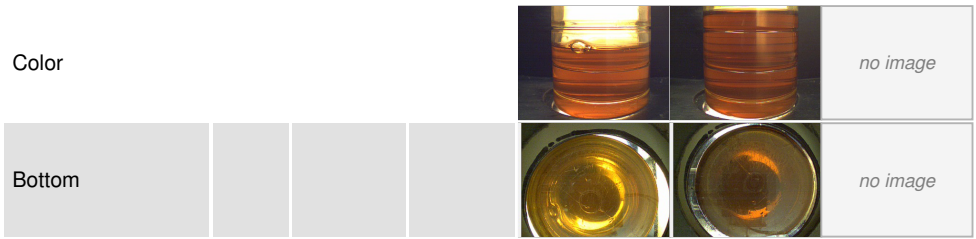

GRAPHS

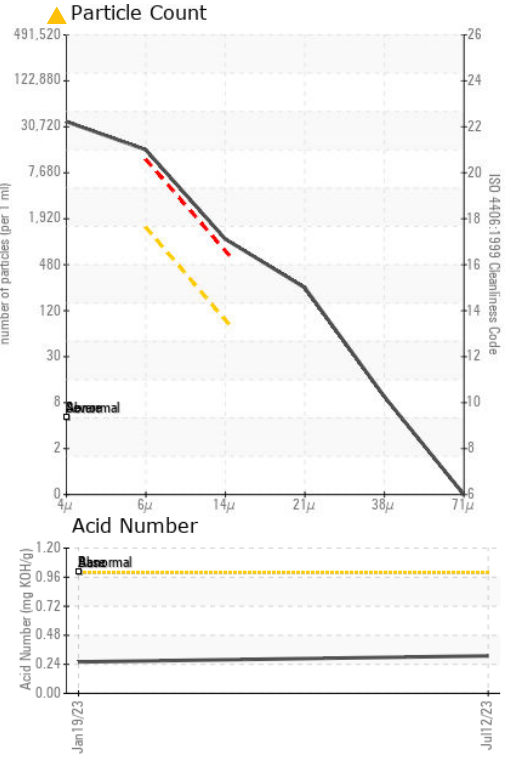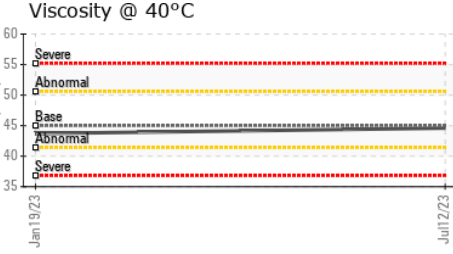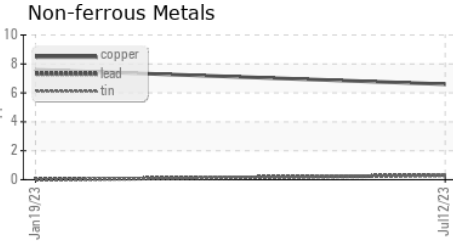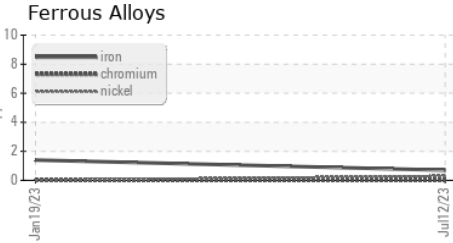

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC112378
Lab Number : 05900705
Unique Number : 10562061
Test Package : IND 2

ROCK EM APPAREL
 5051 LB MCLEOD RD
 ORLANDO, FL
 US 32811
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)