

PROBLEM SUMMARY

Sample Rating Trend

ISO

Machine Id


KAESER ASD25 8014979 (S/N 1148)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

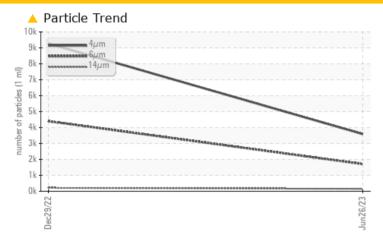

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ATTENTION	ABNORMAL					
Particles >6µm	ASTM D7647	>1300	1707	4398					
Particles >14μm	ASTM D7647	>80	151	<u>^</u> 216					
Particles >21µm	ASTM D7647	>20	<u>^</u> 29	<u>^</u> 24					
Oil Cleanliness	ISO 4406 (c)	>/17/13	19/18/14	20/19/15					

Customer Id: MARINDIN Sample No.: KC05900714 Lab Number: 05900714 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

29 Dec 2022 Diag: Don Baldridge

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

2T

Sample Rating Trend

ISO

Machine Id

KAESER ASD25 8014979 (S/N 1148)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a moderate amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Dec2022	Jun 2 023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC05900714	KC103269	
Sample Date		Client Info		26 Jun 2023	29 Dec 2022	
Machine Age	hrs	Client Info		2898	0	
Oil Age	hrs	Client Info		0	795	
Oil Changed		Client Info		N/A	Not Changd	
Sample Status				ATTENTION	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	<1	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	<1	0	
Lead	ppm	ASTM D5185m	>10	0	2	
Copper	ppm	ASTM D5185m	>50	4	2	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	0	8	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	90	34	68	
Calcium	ppm	ASTM D5185m	2	0	1	
Phosphorus	ppm	ASTM D5185m		0	6	
Zinc	ppm	ASTM D5185m		19	11	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	2	
Sodium	ppm	ASTM D5185m		8	15	
Potassium	ppm	ASTM D5185m	>20	7	11	
Water	%	ASTM D6304	>0.05	0.018	0.016	
ppm Water	ppm	ASTM D6304	>500	183.7	160.4	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3590	9278	
Particles >6µm		ASTM D7647	>1300	<u> </u>	▲ 4398	
Particles >14μm		ASTM D7647	>80	<u> </u>	<u>^</u> 216	
Particles >21µm		ASTM D7647		<u>^</u> 29	<u>^</u> 24	
Particles >38µm		ASTM D7647	>4	1	1	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u> </u>	<u>\$\text{\Delta}\$ 20/19/15</u>	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.46	0.48	



OIL ANALYSIS REPORT

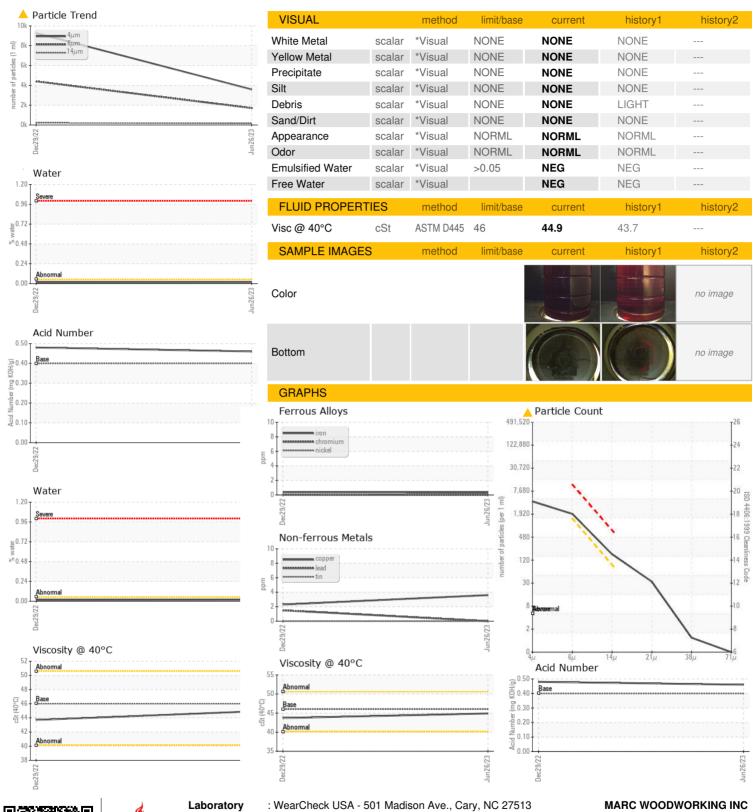





Certificate L2367

Sample No. Lab Number **Unique Number** Test Package

: KC05900714 : 05900714

: 10562070 : IND 2

Received : 17 Jul 2023 Diagnosed : 19 Jul 2023 Diagnostician : Don Baldridge 1719 ENGLISH AVE INDIANAPOLIS, IN US 46201

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: