




PROBLEM SUMMARY

Sample Rating Trend


ISO

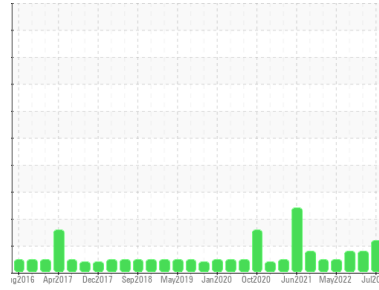

Machine Id
COMP 13 ASSET 4289 (S/N 10241E42577092)
 Component
Refrigeration Compressor
 Fluid
USPI 1009-68 SC (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

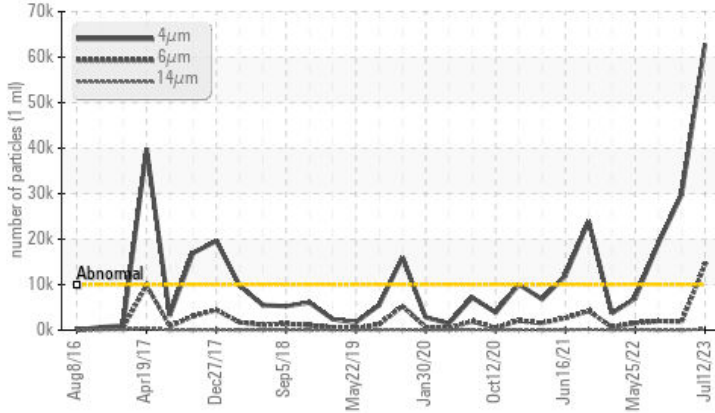

RECOMMENDATION

Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	ATTENTION
Particles >4µm	ASTM D7647	>10000	▲ 62832	▲ 29817	▲ 19099
Particles >6µm	ASTM D7647	>2500	▲ 14376	1903	2003
Oil Cleanliness	ISO 4406 (c)	>20/18/15	▲ 23/21/15	▲ 22/18/11	▲ 21/18/12

Customer Id: TYSNEWTEN
 Sample No.: USP248368
 Lab Number: 05901283
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

02 Nov 2022 Diag: Doug Bogart

ISO



Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 6 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



10 Aug 2022 Diag: Doug Bogart

ISO



Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 6 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



25 May 2022 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the component. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

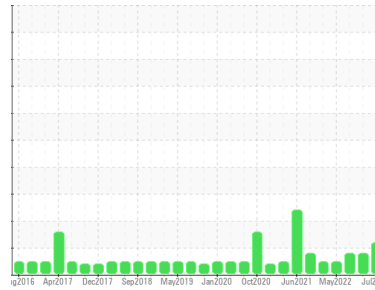

ISO



Machine Id
COMP 13 ASSET 4289 (S/N 10241E42577092)

Component
Refrigeration Compressor
Fluid
USPI 1009-68 SC (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2	
Sample Number	Client Info	USP248368	USP241655	USP231924	
Sample Date	Client Info	12 Jul 2023	02 Nov 2022	10 Aug 2022	
Machine Age	hrs	Client Info	64083	63580	61626
Oil Age	hrs	Client Info	0	63580	61626
Oil Changed	Client Info	N/A	N/A	N/A	
Sample Status		ABNORMAL	ABNORMAL	ATTENTION	

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >8	0	<1	<1
Chromium	ppm	ASTM D5185m >2	0	0	0
Nickel	ppm	ASTM D5185m	0	0	0
Titanium	ppm	ASTM D5185m	<1	0	0
Silver	ppm	ASTM D5185m >2	0	1	0
Aluminum	ppm	ASTM D5185m >3	<1	<1	<1
Lead	ppm	ASTM D5185m >2	0	0	0
Copper	ppm	ASTM D5185m >8	<1	0	0
Tin	ppm	ASTM D5185m >4	0	0	0
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	<1
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	<1	0
Magnesium	ppm	ASTM D5185m	<1	0	0
Calcium	ppm	ASTM D5185m	0	0	0
Phosphorus	ppm	ASTM D5185m	0	1	<1
Zinc	ppm	ASTM D5185m	0	0	0
Sulfur	ppm	ASTM D5185m 50	40	11	13

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >15	2	3	2
Sodium	ppm	ASTM D5185m	<1	0	<1
Potassium	ppm	ASTM D5185m >20	0	<1	0
Water	%	ASTM D6304 >0.01	0.007	0.003	0.008
ppm Water	ppm	ASTM D6304 >100	76.6	31.5	89.2


FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	▲ 62832	▲ 29817	▲ 19099
Particles >6µm	ASTM D7647 >2500	▲ 14376	1903	2003
Particles >14µm	ASTM D7647 >320	217	14	32
Particles >21µm	ASTM D7647 >80	25	3	5
Particles >38µm	ASTM D7647 >20	0	0	0
Particles >71µm	ASTM D7647 >4	0	0	0
Oil Cleanliness	ISO 4406 (c) >20/18/15	▲ 23/21/15	▲ 22/18/11	▲ 21/18/12


FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D974 0.005	0.014	0.014	0.014


▲ Particle Trend

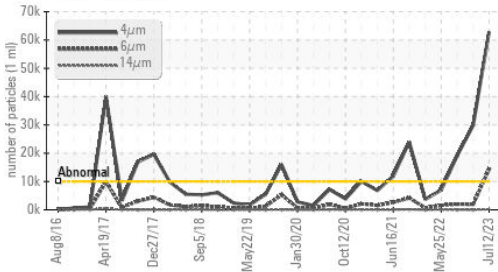


Water

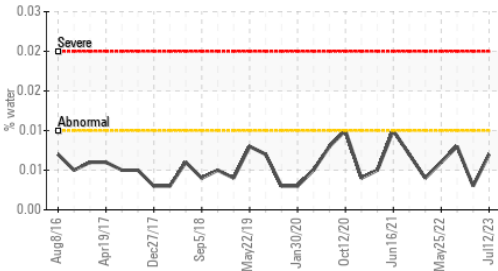


Acid Number

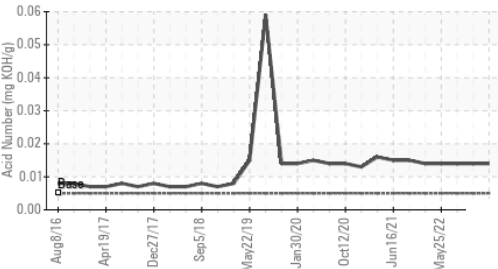

Water

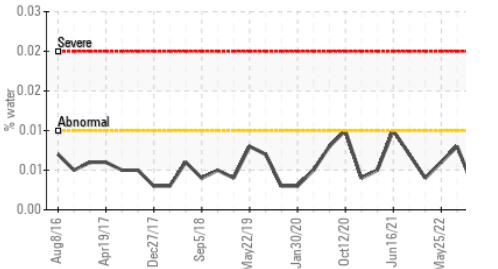

Viscosity @ 40°C

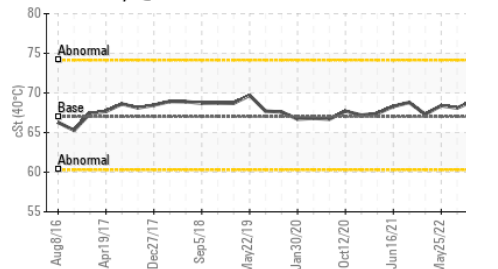

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 67	72.5	69.0	68.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color




Bottom




GRAPHS


Ferrous Alloys

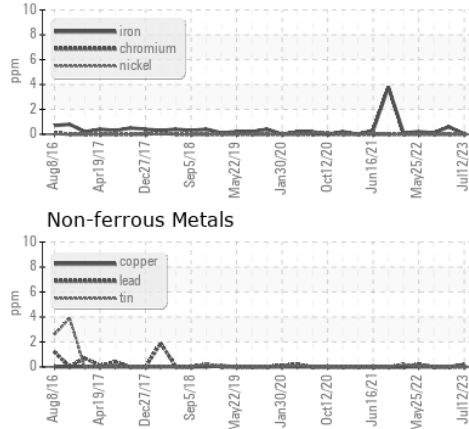


Non-ferrous Metals

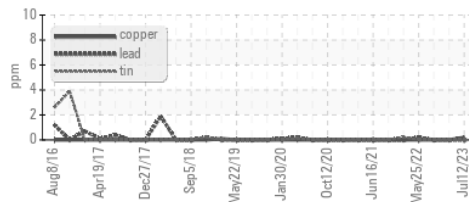


Viscosity @ 40°C

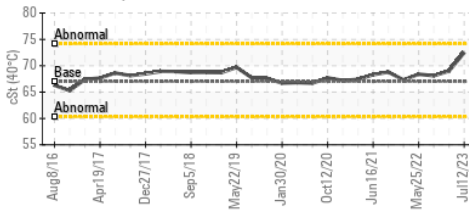

▲ Particle Count

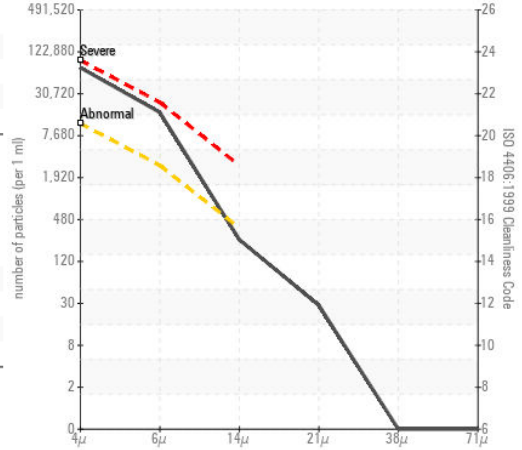

Acid Number

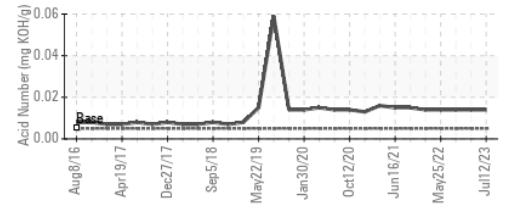

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : USP248368
 Lab Number : 05901283
 Unique Number : 10562639
 Test Package : IND 2

Received : 18 Jul 2023
 Diagnosed : 19 Jul 2023
 Diagnostician : Doug Bogart

TYSON - NEWBERN TN
 2000 BIFFLE RD
 NEWBERN, TN
 US 38059
 Contact: ROBBIE SCOTT

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: