


OIL ANALYSIS REPORT

DT S



NORMAL



8127511 (S/N 1813)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Aug2022	Jui2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC106868	KC98685	
Sample Date		Client Info		06 Jul 2023	09 Aug 2022	
Machine Age	hrs	Client Info		6730	3419	
Oil Age	hrs	Client Info		3321	1981	
Oil Changed		Client Info		Changed	Changed	
Sample Status				NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	<1	0	
Silver	ppm	ASTM D5185m	>2	0	<1	
Aluminum	ppm	ASTM D5185m	>10	1	<1	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	7	10	
Tin	ppm	ASTM D5185m	>10	0	<1	
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		<1	0	
Magnesium	ppm	ASTM D5185m	90	34	34	
Calcium	ppm	ASTM D5185m	2	0	<1	
Phosphorus	ppm	ASTM D5185m		2	8	
Zinc	ppm	ASTM D5185m		8	20	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		11	9	
Potassium	ppm	ASTM D5185m	>20	3	8	
Water	%	ASTM D6304	>0.05	0.020	0.017	
ppm Water	ppm	ASTM D6304	>500	207.4	176.9	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2222	2494	
Particles >6µm		ASTM D7647	>1300	546	1128	
Particles >14µm		ASTM D7647	>80	55	82	
Particles >21µm		ASTM D7647	>20	17	14	
Particles >38µm		ASTM D7647	>4	1	1	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/13	18/17/14	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.31	0.30	



OIL ANALYSIS REPORT

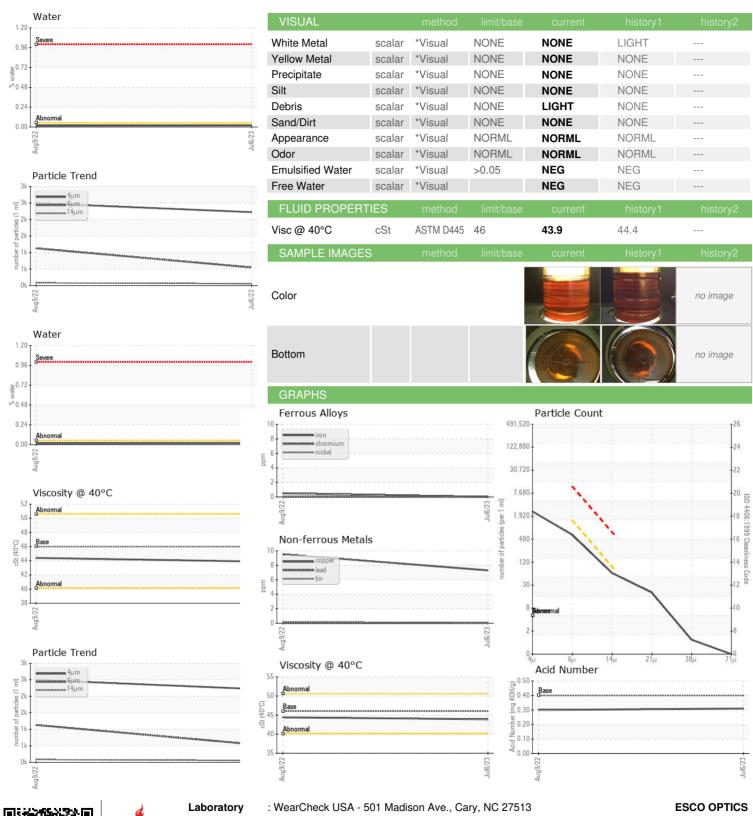





Certificate L2367

Sample No. Lab Number **Unique Number** Test Package

: KC106868 : 05901313

: IND 2

: 18 Jul 2023 Received Diagnosed : 10562669

: 20 Jul 2023 Diagnostician : Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

95 CHAMBERLAIN RD OAK RIDGE, NJ US 07438

Contact: Service Manager

T:

F: