




# PROBLEM SUMMARY


Sample Rating Trend

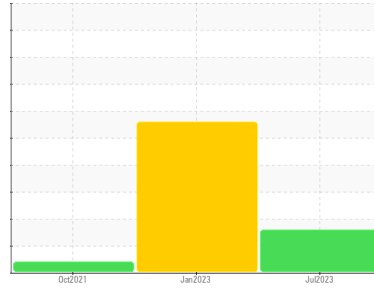

Machine Id  
**7113746 (S/N 1034)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## COMPONENT CONDITION SUMMARY

▲ Particle Trend

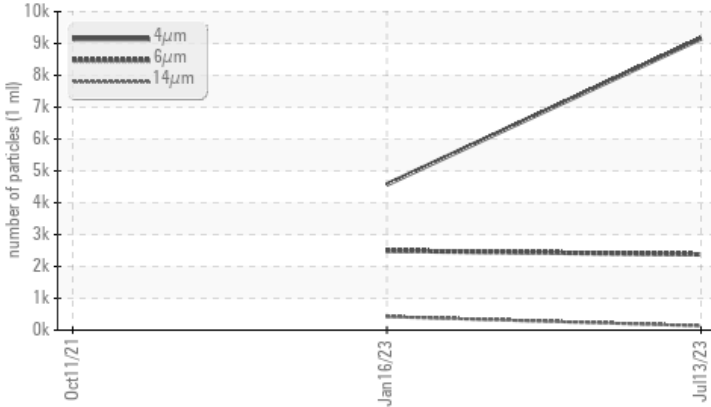

## RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	ABNORMAL	ABNORMAL
Particles >6µm	ASTM D7647	>1300	▲ 2379	2492	---
Particles >14µm	ASTM D7647	>80	▲ 136	▲ 424	---
Particles >21µm	ASTM D7647	>20	▲ 31	▲ 143	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/18/14	▲ 19/18/16	---

Customer Id: SPRADD  
 Sample No.: KCPA004625  
 Lab Number: 05901339  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

### 16 Jan 2023 Diag: Don Baldrige

#### WATER



Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition. All component wear rates are normal. There is a high amount of particulates present in the oil. Appearance is hazy. There is a moderate concentration of water present in the oil. Free water present. The AN level is acceptable for this fluid.

view report



### 11 Oct 2021 Diag: Don Baldrige

#### VIS DEBRIS



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

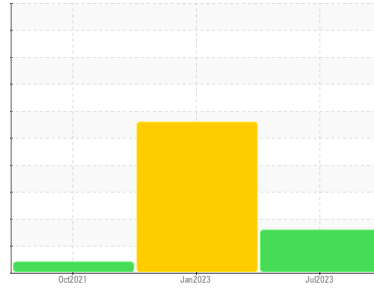

ISO



Machine Id  
**7113746 (S/N 1034)**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA004625</b>	KCP54340	KC99391
Sample Date	Client Info			<b>13 Jul 2023</b>	16 Jan 2023	11 Oct 2021
Machine Age	hrs	Client Info		<b>17333</b>	15794	10845
Oil Age	hrs	Client Info		<b>0</b>	8455	3000
Oil Changed	Client Info			<b>N/A</b>	Changed	Changed
Sample Status				<b>ATTENTION</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>&lt;1</b>	<1	<1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>3</b>	4	5
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m	>50	<b>3</b>	7	10
Tin	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	<1
Barium	ppm	ASTM D5185m	90	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m	100	<b>17</b>	14	7
Calcium	ppm	ASTM D5185m	0	<b>0</b>	2	0
Phosphorus	ppm	ASTM D5185m	0	<b>2</b>	17	3
Zinc	ppm	ASTM D5185m	0	<b>22</b>	30	21
Sulfur	ppm	ASTM D5185m	23500	<b>22693</b>	21437	15185

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	1	0
Sodium	ppm	ASTM D5185m		<b>1</b>	<1	4
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	<1	3
Water	%	ASTM D6304	>0.05	<b>0.014</b>	▲ 0.441	0.011
ppm Water	ppm	ASTM D6304	>500	<b>147.2</b>	▲ 4410	112.7

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>9157</b>	4574	---
Particles >6µm		ASTM D7647	>1300	▲ <b>2379</b>	2492	---
Particles >14µm		ASTM D7647	>80	▲ <b>136</b>	▲ 424	---
Particles >21µm		ASTM D7647	>20	▲ <b>31</b>	▲ 143	---
Particles >38µm		ASTM D7647	>4	<b>0</b>	▲ 22	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	2	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ <b>20/18/14</b>	▲ 19/18/16	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.42</b>	0.41	0.357

# OIL ANALYSIS REPORT

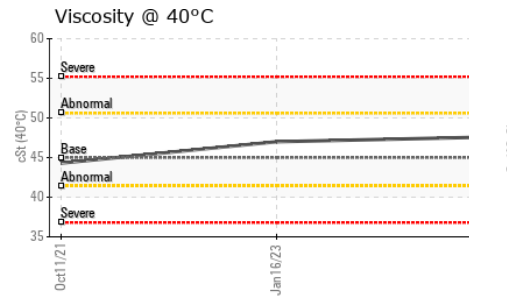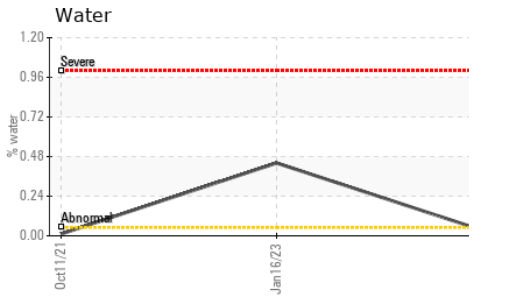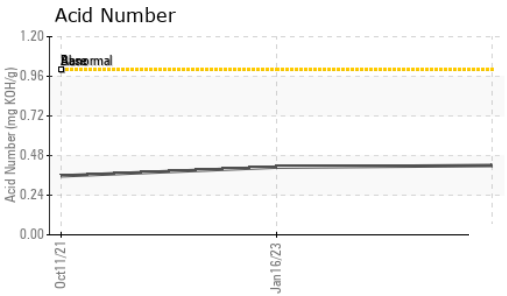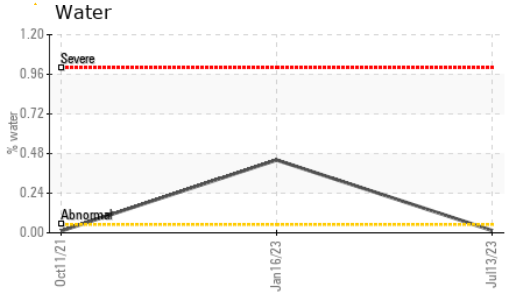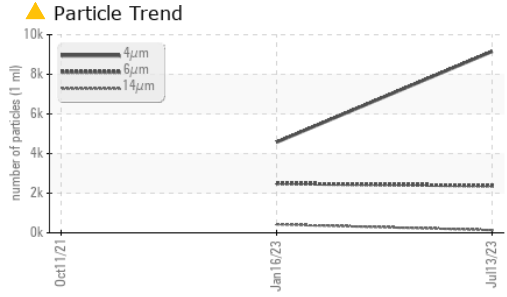






PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	▲ HAZY	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	▲ 0.2%
Free Water	scalar	*Visual		NEG	▲ 2.0

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	47.6	47.0

**SAMPLE IMAGES**

method	limit/base	current	history1	history2
Color				
Bottom				

## GRAPHS

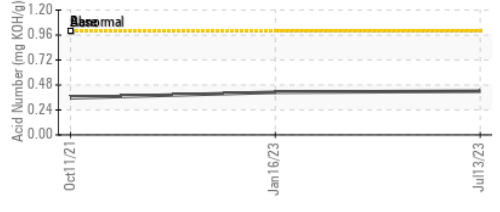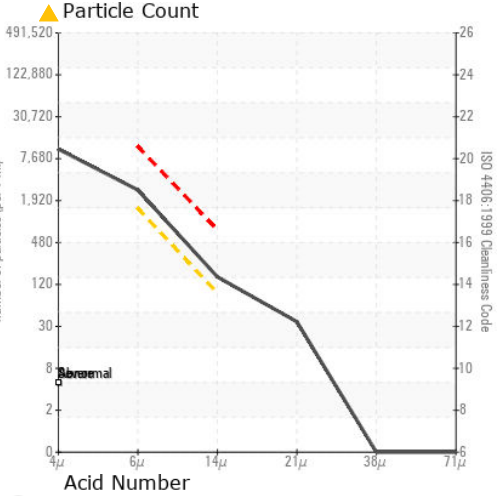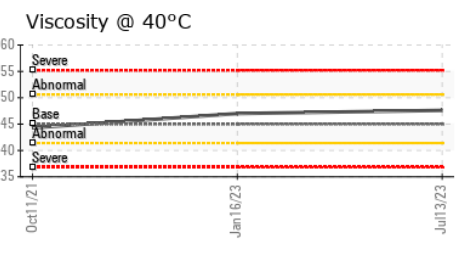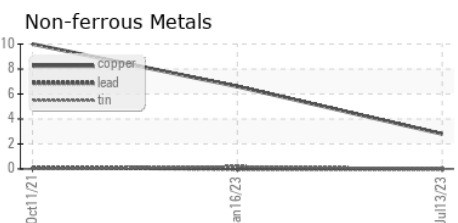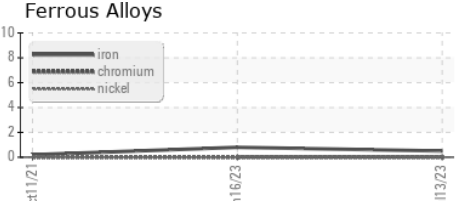

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA004625 **Received** : 18 Jul 2023  
**Lab Number** : 05901339 **Diagnosed** : 20 Jul 2023  
**Unique Number** : 10562695 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**SPROVIERI'S CUSTOM COUNTERS**  
 55 W LAURA DR  
 ADDISON, IL  
 US 60101  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)