

OIL ANALYSIS REPORT

OIL AIVAL 1010 IILI OITI

SMART OIL Machine Id HERTZ VD022070 - SIGNATURE STONE

Component

Compressor Fluid

SMARTOIL 6000 (1 GAL)

Sample Rating Trend



DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Moor

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jul2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UHK05901358		
Sample Date		Client Info		14 Jul 2023		
Machine Age	hrs	Client Info		2378		
Oil Age	hrs	Client Info		2378		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		<1		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	1		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	2		
Tin	ppm	ASTM D5185m	>15	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m	20	0		
Phosphorus	ppm	ASTM D5185m		473		
Zinc	ppm	ASTM D5185m		9		
Sulfur	ppm	ASTM D5185m		1181		
CONTAMINANTS	5	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	<1		
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.173		
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	HEAVY		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.1	NEG		
Free Water	scalar	*Visual		NEG		



OIL ANALYSIS REPORT

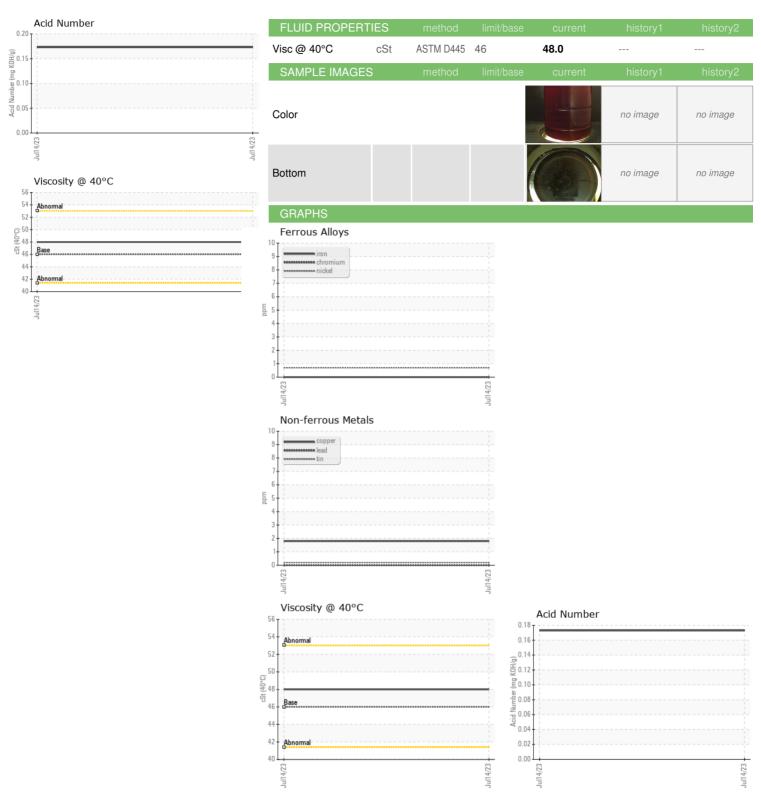





Certificate L2367

Laboratory Sample No. Lab Number

Unique Number : 10562714 Test Package : IND 2

: UHK05901358 : 05901358

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 18 Jul 2023 Diagnosed : 20 Jul 2023 Diagnostician : Don Baldridge

US 63043 Contact: KEITH BOWMAN kbow123@sbcglobal.net

MARYLAND HEIGHTS, MO

INDUSTRIAL COMPRESSOR SUPPLIES

11088 MILLPARK DRIVE SUITE 124

T: (314)426-3131 F: (314)426-3232

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)