




# FUEL REPORT

Sample Rating Trend

**NORMAL**

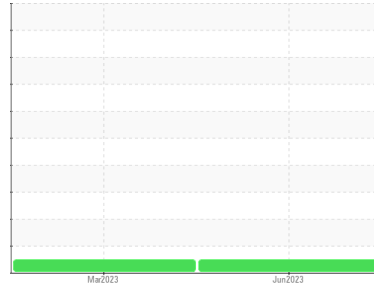

Machine Id  
**SPACE X JRTI - GEN 2**

Component  
**Tank Diesel Fuel**  
Fluid  
**DDSL (2500 GAL)**

## DIAGNOSIS

### Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 low-sulfur diesel fuel.

### Corrosion

All metal levels are normal indicating no corrosion in the system.

### Contaminants

The water content is negligible. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. There is no indication of any contamination in the fuel.

### Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC05901762</b>	WCDF4363	---
Sample Date	Client Info			<b>30 Jun 2023</b>	22 Mar 2023	---
Machine Age	mls	Client Info		<b>0</b>	0	---
Sample Status				<b>NORMAL</b>	NORMAL	---

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
ASTM Color	scalar	*ASTM D1500		<b>L4.0</b>	L4.5	---
Visc @ 40°C	cSt	ASTM D445		<b>3.09</b>	3.07	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m		<b>208</b>	11	---
Sulfur (UVF)	ppm	ASTM D5453		<b>147</b>	11	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	<b>0</b>	0	---
Sodium	ppm	ASTM D5185m	<0.1	<b>0</b>	<1	---
Potassium	ppm	ASTM D5185m	<0.1	<b>0</b>	0	---
Water	%	ASTM D6304	<0.05	<b>0.003</b>	0.003	---
ppm Water	ppm	ASTM D6304	<500	<b>38.7</b>	35.7	---
% Gasoline	%	*In-House	<0.50	<b>0.0</b>	0.0	---
% Biodiesel	%	*In-House	<20.0	<b>0.0</b>	0.0	---

HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	0	---
Nickel	ppm	ASTM D5185m	<0.1	<b>0</b>	0	---
Lead	ppm	ASTM D5185m	<0.1	<b>0</b>	0	---
Vanadium	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	0	---
Iron	ppm	ASTM D5185m	<0.1	<b>0</b>	0	---
Calcium	ppm	ASTM D5185m	<0.1	<b>0</b>	0	---
Magnesium	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	0	---
Phosphorus	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	1	---
Zinc	ppm	ASTM D5185m	<0.1	<b>0</b>	0	---




SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

Color						no image
Bottom						no image



# FUEL REPORT

## GRAPHS

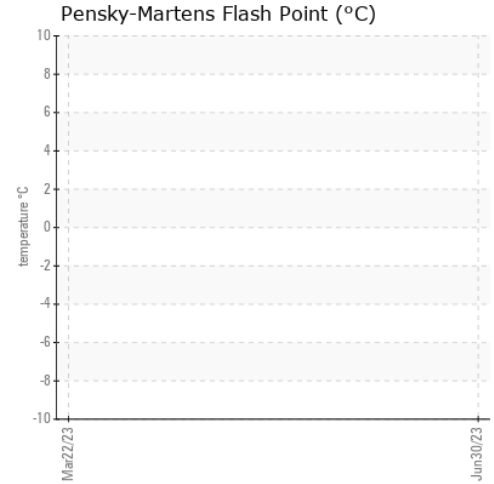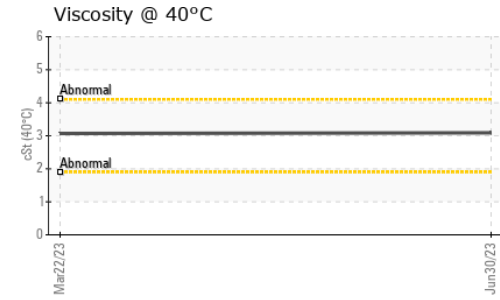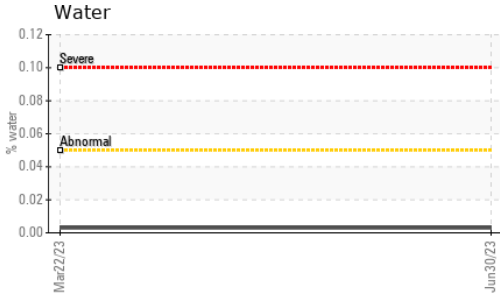

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC05901762 **Received** : 18 Jul 2023  
**Lab Number** : **05901762** **Diagnosed** : 25 Jul 2023  
**Unique Number** : 10563118 **Diagnostician** : Doug Bogart  
**Test Package** : DF-5 ( Additional Tests: Screen, Sulphur-Active )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**TANK WIZARDS**  
 1511 MASTERS RD NW  
 PALM BAY, FL  
 US 32907  
 Contact: WENDALL STRODERD  
 wendall@tankwizards.com  
 T: (321)427-5149  
 F: (321)574-4131