


PROBLEM SUMMARY

Sample Rating Trend




VP-18 (S/N C-4266)

Component **Pump** Fluid

USPI VAC 100 (--- GAL)

COMPONENT CONDITION SUMMARY

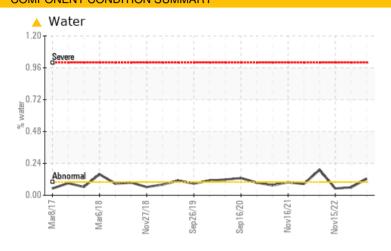

RECOMMENDATION

Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS										
Sample Status			MARGINAL	NORMAL	NORMAL					
Water	%	ASTM D6304	△ 0.124	0.059	0.051					
ppm Water	ppm	ASTM D6304 >.1	1244.3	594.3	519.7					

Customer Id: JBSBRO Sample No.: USPM27084 Lab Number: 05901884 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

28 Feb 2023 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



15 Nov 2022 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



21 Jul 2022 Diag: Jonathan Hester

WAIER




The oil is near the end of it's useful service life, recommend schedule an oil change. Resample at the next service interval to monitor. Please note that this is a corrected copy for laboratory data updates. Sample updated to update TAN value questioned by the customer. All component wear rates are normal. There is a trace of moisture present in the oil. The amount and size of particulates present in the system are acceptable. The AN level is at the top-end of the recommended limit. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend



VP-18 (S/N C-4266)

Pump

USPI VAC 100 (--- GAL)

Fluid

OCITIVAC TOO (GAE)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a trace of moisture present in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		lar2017 Ma	2018 Nov2018 Sep2	019 Sep2020 Nov2021 1	lov2022	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USPM27084	USPM26767	USPM24870
Sample Date		Client Info		17 Jul 2023	28 Feb 2023	15 Nov 2022
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				MARGINAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>90	0	<1	0
Chromium	ppm	ASTM D5185m	>5	0	0	0
Nickel	ppm	ASTM D5185m	>5	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>3	0	0	0
Aluminum	ppm	ASTM D5185m	>7	2	2	3
Lead	ppm	ASTM D5185m	>12	0	0	0
Copper	ppm	ASTM D5185m	>30	<1	0	<1
Tin	ppm	ASTM D5185m	>9	0	0	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	<1	1
Barium	ppm	ASTM D5185m	0	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	0	0	0	0
Calcium	ppm	ASTM D5185m	0	1	0	4
Phosphorus	ppm	ASTM D5185m	1800	1141	1099	1296
Zinc	ppm	ASTM D5185m	0	<1	0	0
Sulfur	ppm	ASTM D5185m	0	0	0	4
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>60	3	3	2
Sodium	ppm	ASTM D5185m		0	0	0
Potassium	ppm	ASTM D5185m	>20	<1	0	0
Water	%	ASTM D6304		△ 0.124	0.059	0.051
ppm Water	ppm	ASTM D6304	>.1	1244.3	594.3	519.7
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	669	490	632
Particles >6µm		ASTM D7647	>1300	241	155	198
Particles >14µm		ASTM D7647	>160	22	9	12
Particles >21µm		ASTM D7647	>40	4	1	3
Particles >38µm		ASTM D7647	>10	1	0	1
Particles >71μm		ASTM D7647	>3	1	0	0
Oil Cleanliness		ISO 4406 (c)	>19/17/14	17/15/12	16/14/10	16/15/11
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.05	1.07	0.90	0.83



OIL ANALYSIS REPORT

