




# PROBLEM SUMMARY

## Sample Rating Trend

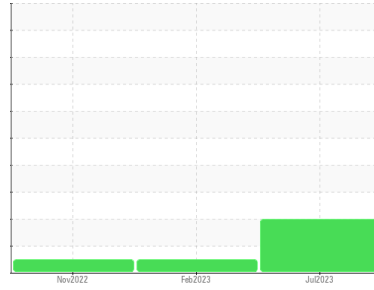


ISO



Machine Id  
**VP-26**  
 Component  
**Pump**  
 Fluid  
**USPI VAC 100 (--- GAL)**

## COMPONENT CONDITION SUMMARY

### ▲ Particle Trend

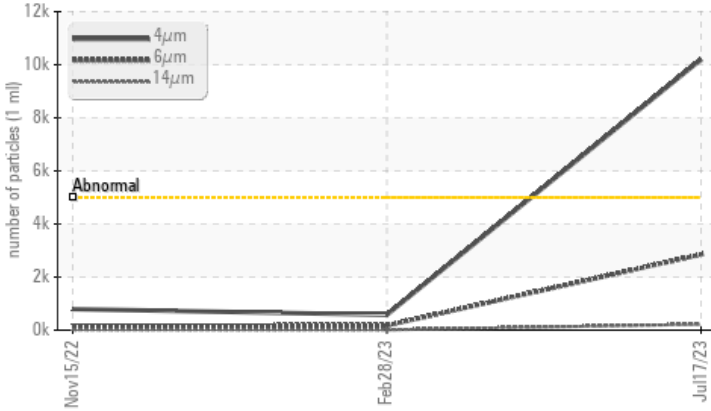

## RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status	ASTM D7647	ASTM D7647	ABNORMAL	NORMAL	NORMAL
Particles >4µm	ASTM D7647	>5000	▲ <b>10200</b>	579	795
Particles >6µm	ASTM D7647	>1300	▲ <b>2849</b>	175	165
Particles >14µm	ASTM D7647	>160	▲ <b>222</b>	11	15
Particles >21µm	ASTM D7647	>40	▲ <b>65</b>	1	4
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ <b>21/19/15</b>	16/15/11	17/15/11

Customer Id: JBSBRO  
 Sample No.: USPM27093  
 Lab Number: 05901890  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Doug Bogart +1 (800)237-1369 x4016  
[dougb@wearcheckusa.com](mailto:dougb@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.

## HISTORICAL DIAGNOSIS

### 28 Feb 2023 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 15 Nov 2022 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





# OIL ANALYSIS REPORT

## Sample Rating Trend

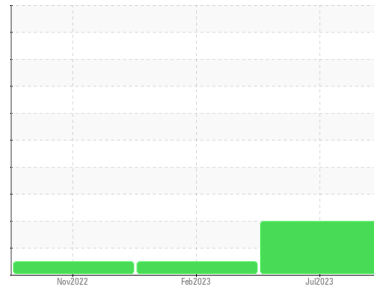

ISO



Machine Id  
**VP-26**  
 Component  
**Pump**  
 Fluid  
**USPI VAC 100 (--- GAL)**

### DIAGNOSIS

#### ▲ Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### ▲ Contamination

There is a high amount of particulates present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>USPM27093</b>	USPM26775	USPM24879
Sample Date	Client Info	<b>17 Jul 2023</b>	28 Feb 2023	15 Nov 2022
Machine Age	hrs	Client Info	<b>0</b>	0
Oil Age	hrs	Client Info	<b>0</b>	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>ABNORMAL</b>	NORMAL	NORMAL

### WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >90	<b>1</b>	0	1
Chromium	ppm	ASTM D5185m >5	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >5	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >7	<b>2</b>	<1	<1
Lead	ppm	ASTM D5185m >12	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m >30	<b>&lt;1</b>	0	0
Tin	ppm	ASTM D5185m >9	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

### ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m 0	<b>0</b>	0	2
Phosphorus	ppm	ASTM D5185m 1800	<b>1200</b>	1091	775
Zinc	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	0
Sulfur	ppm	ASTM D5185m 0	<b>43</b>	47	347

### CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >60	<b>2</b>	1	1
Sodium	ppm	ASTM D5185m	<b>0</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	0
Water	%	ASTM D6304	<b>0.086</b>	0.033	0.011
ppm Water	ppm	ASTM D6304 >.1	<b>869.1</b>	334.3	117.0

### FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >5000	<b>▲ 10200</b>	579	795
Particles >6µm	ASTM D7647 >1300	<b>▲ 2849</b>	175	165
Particles >14µm	ASTM D7647 >160	<b>▲ 222</b>	11	15
Particles >21µm	ASTM D7647 >40	<b>▲ 65</b>	1	4
Particles >38µm	ASTM D7647 >10	<b>3</b>	0	0
Particles >71µm	ASTM D7647 >3	<b>1</b>	0	0
Oil Cleanliness	ISO 4406 (c) >19/17/14	<b>▲ 21/19/15</b>	16/15/11	17/15/11

### FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.05	<b>0.167</b>	0.054	0.11



# OIL ANALYSIS REPORT

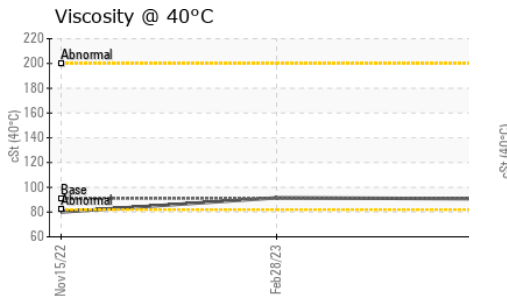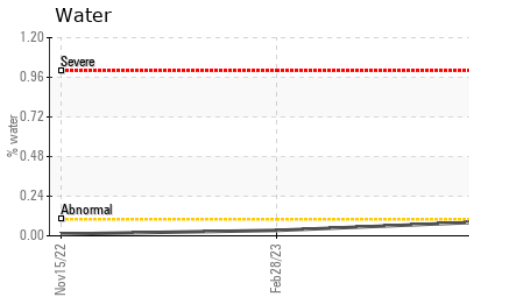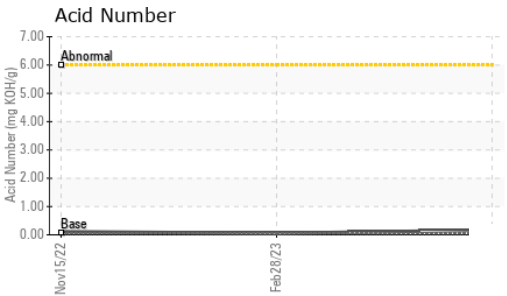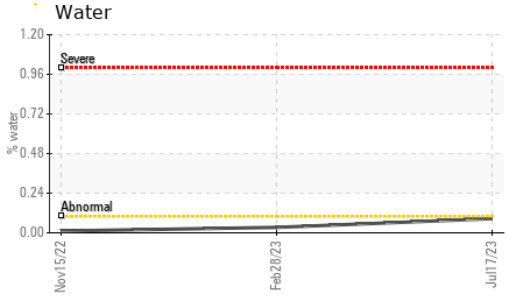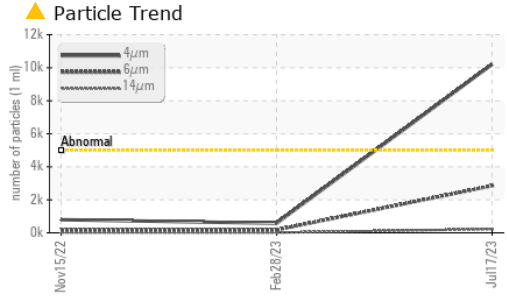





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 91	90.7	91.5	80.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------



## GRAPHS

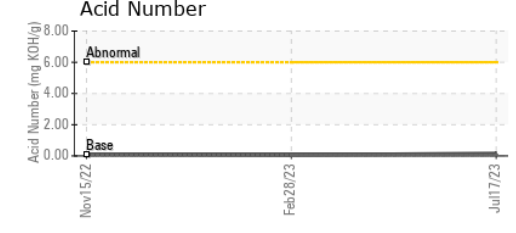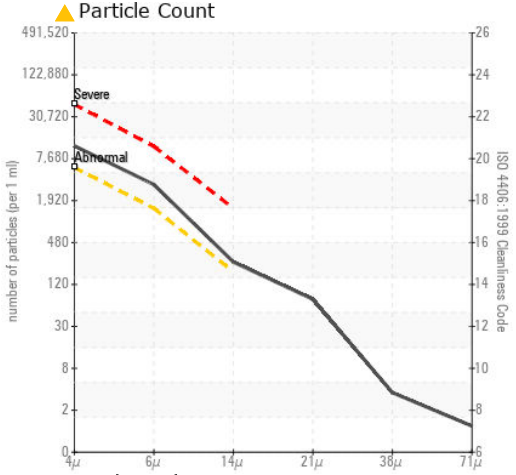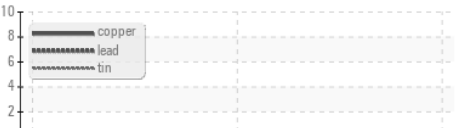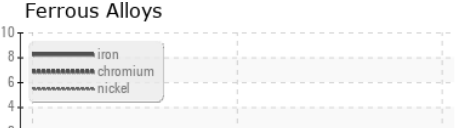

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USPM27093 **Received** : 18 Jul 2023  
**Lab Number** : 05901890 **Diagnosed** : 19 Jul 2023  
**Unique Number** : 10563246 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**JBS FOODS**  
 BROOKS, AB  
 CA T1R 1C6  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)