




# PROBLEM SUMMARY

Sample Rating Trend




**WATER**



Area  
**[23-00343619-000]**  
 Machine Id  
**HOMOGENIZER HTST 1**  
 Component  
**Hydraulic System**  
 Fluid  
**MOBIL DTE 26 (--- GAL)**

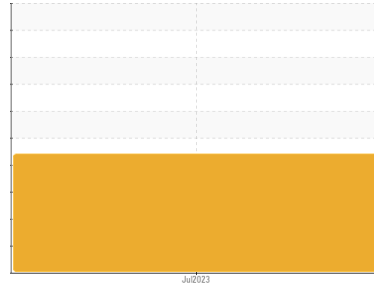

## COMPONENT CONDITION SUMMARY

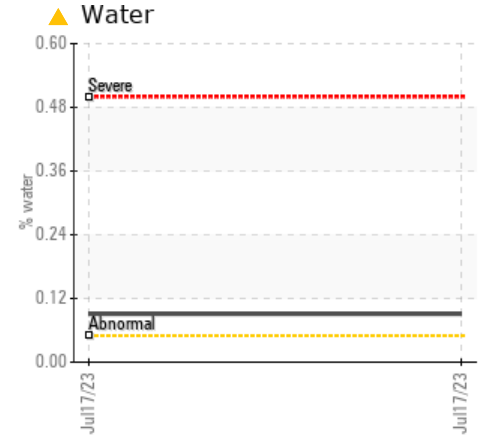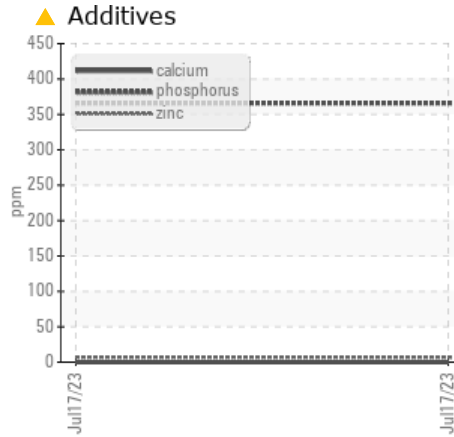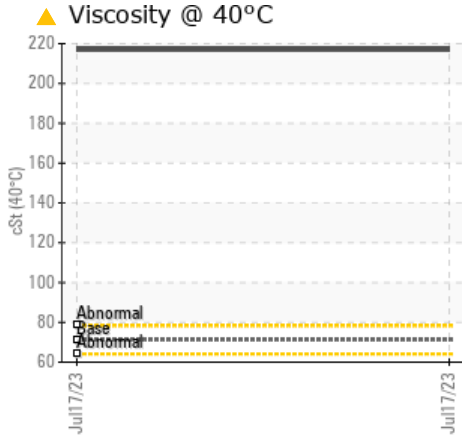

## RECOMMENDATION

We advise that you follow the water drain-off procedure for this component. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status	Value	Unit	ASTM	Limit	Result	Severity
Calcium	0	ppm	ASTM D5185m	>0.05	▲ 0	---
Zinc	217	ppm	ASTM D5185m	>500	▲ 217	---
Water	0.091	%	ASTM D6304	>0.05	▲ 0.091	---
ppm Water	910	ppm	ASTM D6304	>500	▲ 910	---
Free Water	>10%	scalar	*Visual	>10%	▲ >10%	---
Visc @ 40°C	217	cSt	ASTM D445	71.2	▲ 217	---

Customer Id: JACHUT  
 Sample No.: USP245349  
 Lab Number: 05901892  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Doug Bogart +1 (800)237-1369 x4016  
[dougb@wearcheckusa.com](mailto:dougb@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Water Drain-off	---	---	?	We advise that you follow the water drain-off procedure for this component.

## HISTORICAL DIAGNOSIS




# OIL ANALYSIS REPORT

Sample Rating Trend

**WATER**



Area  
**[23-00343619-000]**  
 Machine Id  
**HOMOGENIZER HTST 1**  
 Component  
**Hydraulic System**  
 Fluid  
**MOBIL DTE 26 (--- GAL)**

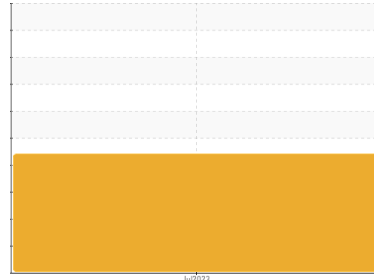

## DIAGNOSIS

**Recommendation**  
 We advise that you follow the water drain-off procedure for this component. Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 Excessive free water present. The amount and size of particulates present in the system are acceptable.

**Fluid Condition**  
 The oil viscosity is higher than normal. This plus the additive levels indicates the addition of a different brand or type of oil. Confirmed. The AN level is acceptable for this fluid.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>USP245349</b>	---	---
Sample Date	Client Info	<b>17 Jul 2023</b>	---	---
Machine Age	hrs Client Info	<b>0</b>	---	---
Oil Age	hrs Client Info	<b>0</b>	---	---
Oil Changed	Client Info	<b>N/A</b>	---	---
Sample Status		<b>ABNORMAL</b>	---	---

## WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>20	<b>8</b>	---	---
Chromium ppm ASTM D5185m	>20	<b>&lt;1</b>	---	---
Nickel ppm ASTM D5185m	>20	<b>0</b>	---	---
Titanium ppm ASTM D5185m		<b>0</b>	---	---
Silver ppm ASTM D5185m		<b>0</b>	---	---
Aluminum ppm ASTM D5185m	>20	<b>2</b>	---	---
Lead ppm ASTM D5185m	>20	<b>6</b>	---	---
Copper ppm ASTM D5185m	>20	<b>2</b>	---	---
Tin ppm ASTM D5185m	>20	<b>1</b>	---	---
Vanadium ppm ASTM D5185m		<b>0</b>	---	---
Cadmium ppm ASTM D5185m		<b>0</b>	---	---

## ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m		<b>0</b>	---	---
Barium ppm ASTM D5185m		<b>0</b>	---	---
Molybdenum ppm ASTM D5185m		<b>0</b>	---	---
Manganese ppm ASTM D5185m		<b>0</b>	---	---
Magnesium ppm ASTM D5185m		<b>&lt;1</b>	---	---
Calcium ppm ASTM D5185m		<b>▲ 0</b>	---	---
Phosphorus ppm ASTM D5185m		<b>366</b>	---	---
Zinc ppm ASTM D5185m		<b>▲ 7</b>	---	---
Sulfur ppm ASTM D5185m		<b>2292</b>	---	---

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>15	<b>6</b>	---	---
Sodium ppm ASTM D5185m		<b>0</b>	---	---
Potassium ppm ASTM D5185m	>20	<b>1</b>	---	---
Water % ASTM D6304	>0.05	<b>▲ 0.091</b>	---	---
ppm Water ppm ASTM D6304	>500	<b>▲ 910</b>	---	---

## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm ASTM D7647		<b>23408</b>	---	---
Particles >6µm ASTM D7647	>5000	<b>2860</b>	---	---
Particles >14µm ASTM D7647	>640	<b>34</b>	---	---
Particles >21µm ASTM D7647	>160	<b>6</b>	---	---
Particles >38µm ASTM D7647	>40	<b>0</b>	---	---
Particles >71µm ASTM D7647	>10	<b>0</b>	---	---
Oil Cleanliness ISO 4406 (c)	>--/19/16	<b>22/19/12</b>	---	---


## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045		<b>0.42</b>	---	---




# OIL ANALYSIS REPORT


## Additives

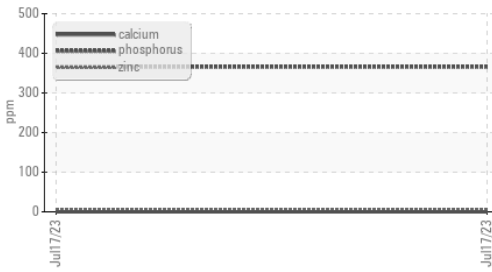


## Water

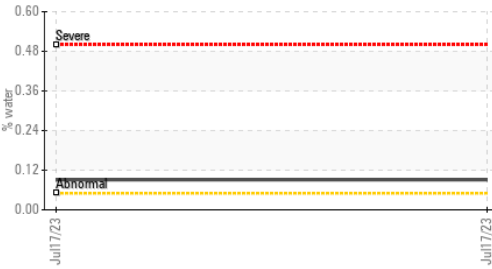


## Particle Trend

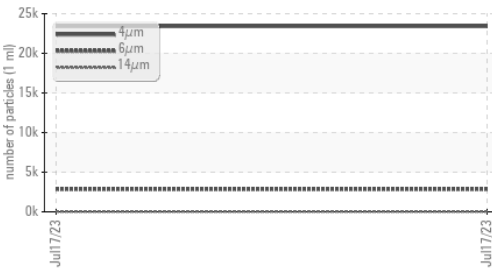

## Particle Count

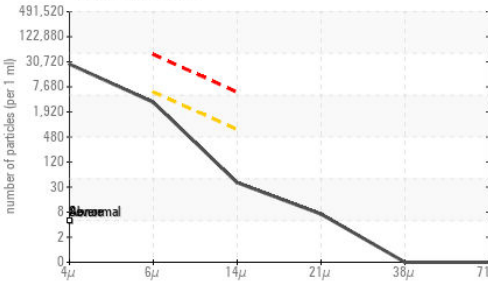


## Acid Number

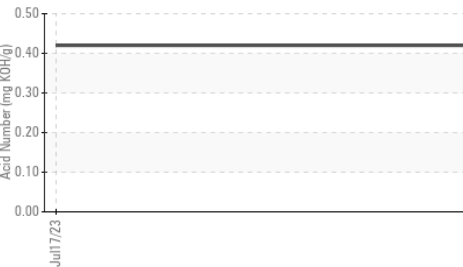






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	0.2%	---
Free Water	scalar	*Visual		▲ >10%	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	71.2	▲ 217	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

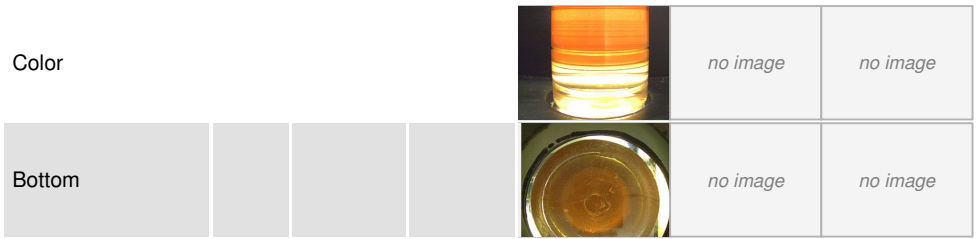

## GRAPHS

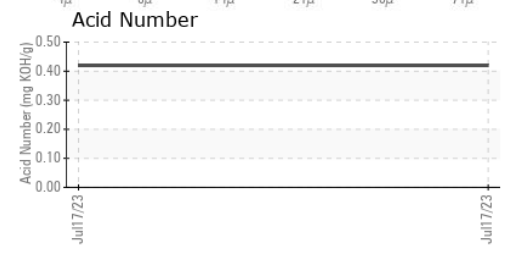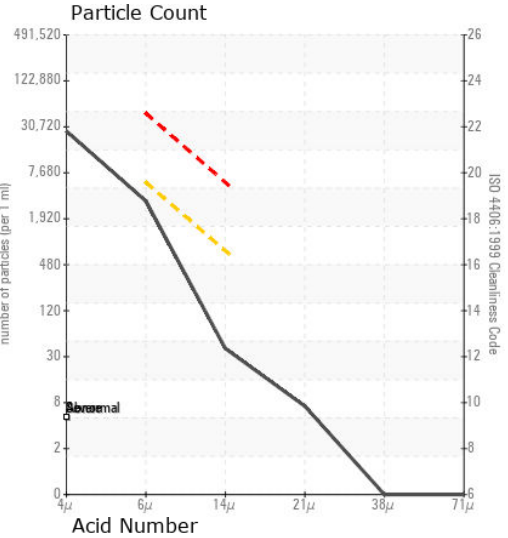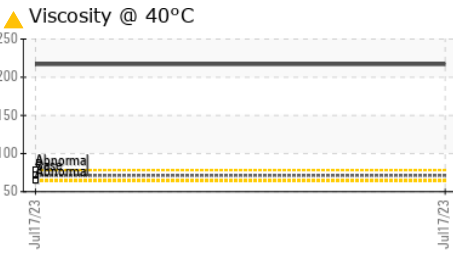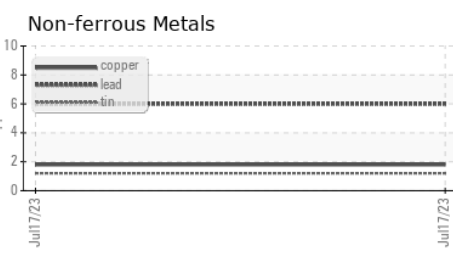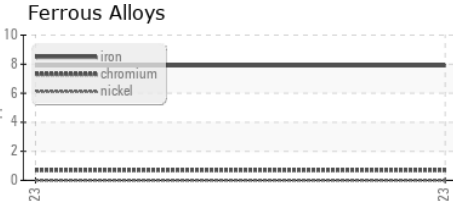

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP245349 **Received** : 18 Jul 2023  
**Lab Number** : 05901892 **Diagnosed** : 20 Jul 2023  
**Unique Number** : 10563248 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**JACKSON DAIRY - KROGER**  
 2600 E 4TH  
 HUTCHINSON, KS  
 US 67501  
 Contact: Jason Stanley  
 jason.stanley@kroger.com  
 T: (620)694-6922  
 F: (620)663-5135

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)