




PROBLEM SUMMARY

Sample Rating Trend

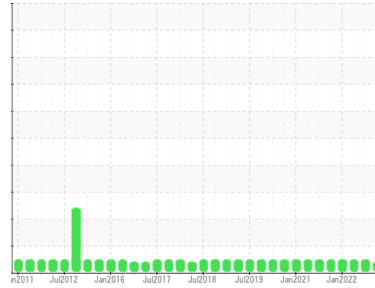


VISCOSITY



Area
[23-00343619-000]
 Machine Id
070-COMPAIR-06 (S/N S287233)
 Component
Air Compressor
 Fluid
AEON 6000 (14 GAL)

COMPONENT CONDITION SUMMARY

▲ Viscosity @ 40°C

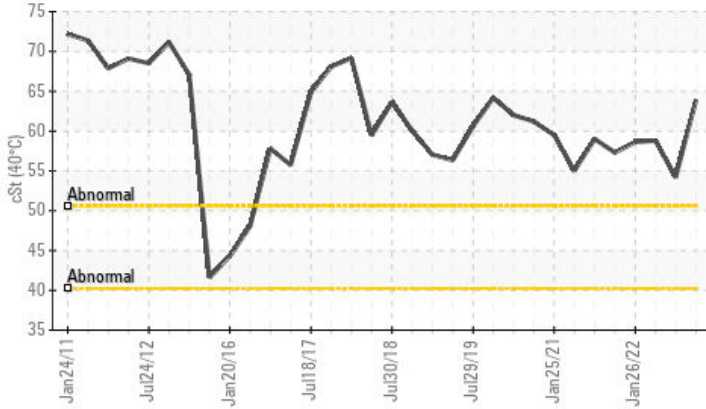

RECOMMENDATION

Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status		ATTENTION	NORMAL	NORMAL	
Visc @ 40°C	cSt	ASTM D445	▲ 63.9	54.2	58.8

Customer Id: JACHUT
 Sample No.: USP245345
 Lab Number: 05901900
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

25 Jul 2022 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



25 Apr 2022 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



26 Jan 2022 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

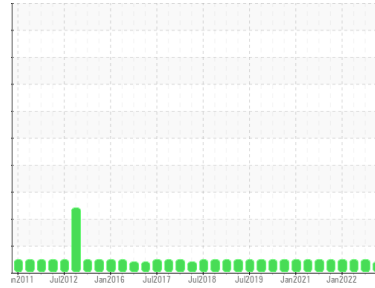

VISCOSITY



Area
[23-00343619-000]
 Machine Id
070-COMPAIR-06 (S/N S287233)
 Component
Air Compressor
 Fluid
AEON 6000 (14 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The oil viscosity is higher than normal. Confirmed. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	USP245345	USP231485	USP228528
Sample Date	Client Info	17 Jul 2023	25 Jul 2022	25 Apr 2022
Machine Age	hrs	Client Info	0	86844
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ATTENTION	NORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	0
Chromium	ppm	ASTM D5185m >4	0	0
Nickel	ppm	ASTM D5185m >4	0	0
Titanium	ppm	ASTM D5185m	0	0
Silver	ppm	ASTM D5185m	0	<1
Aluminum	ppm	ASTM D5185m >10	2	0
Lead	ppm	ASTM D5185m >20	0	0
Copper	ppm	ASTM D5185m >40	0	0
Tin	ppm	ASTM D5185m >5	0	<1
Antimony	ppm	ASTM D5185m	---	---
Vanadium	ppm	ASTM D5185m	0	0
Cadmium	ppm	ASTM D5185m	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<1
Barium	ppm	ASTM D5185m	0	0
Molybdenum	ppm	ASTM D5185m	0	0
Manganese	ppm	ASTM D5185m	0	0
Magnesium	ppm	ASTM D5185m	0	0
Calcium	ppm	ASTM D5185m	0	0
Phosphorus	ppm	ASTM D5185m	308	289
Zinc	ppm	ASTM D5185m	2	0
Sulfur	ppm	ASTM D5185m	470	348

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	0
Sodium	ppm	ASTM D5185m	0	0
Potassium	ppm	ASTM D5185m >20	<1	0
Water	%	ASTM D6304 >0.6	0.002	0.002
ppm Water	ppm	ASTM D6304 >6000	23.8	20.6

FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	1464	203	418
Particles >6µm	ASTM D7647 >2500	292	47	91
Particles >14µm	ASTM D7647 >320	13	9	12
Particles >21µm	ASTM D7647 >80	4	2	3
Particles >38µm	ASTM D7647 >20	1	0	0
Particles >71µm	ASTM D7647 >4	0	0	0
Oil Cleanliness	ISO 4406 (c) >--/18/15	18/15/11	15/13/10	16/14/11

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.11	0.078




OIL ANALYSIS REPORT

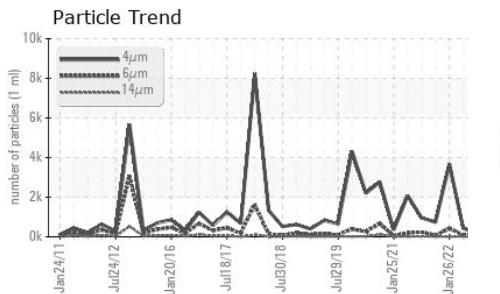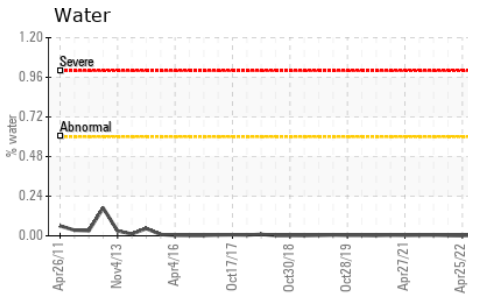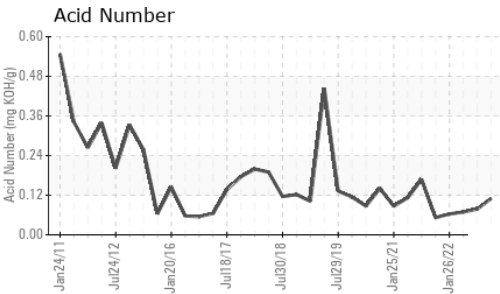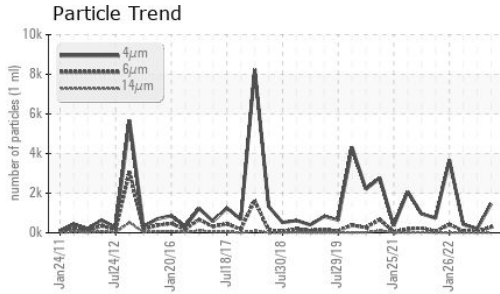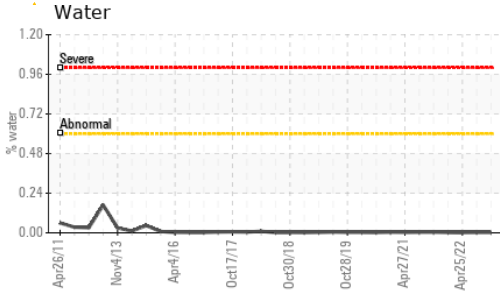






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	▲ 63.9	54.2	58.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

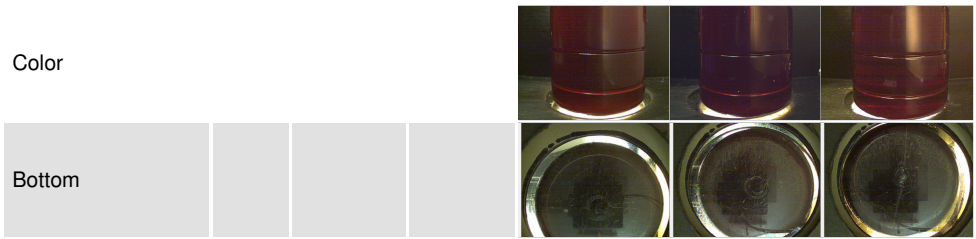

GRAPHS

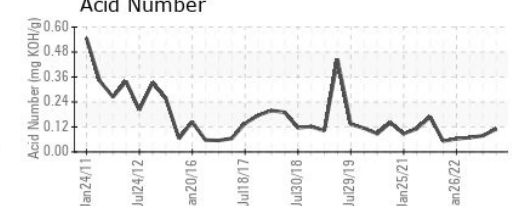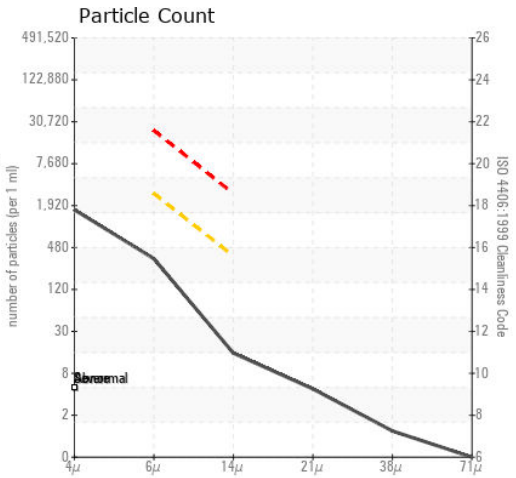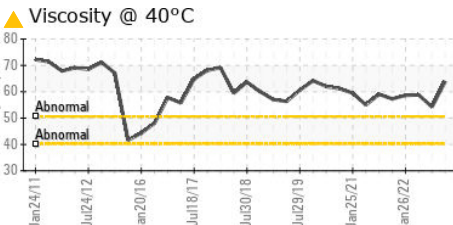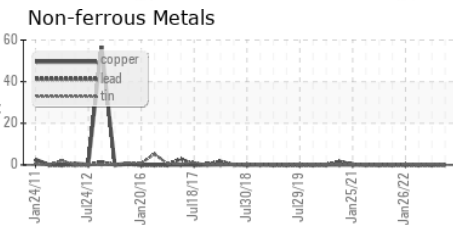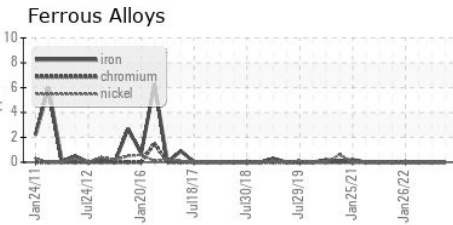

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USP245345 **Received** : 18 Jul 2023
Lab Number : 05901900 **Diagnosed** : 20 Jul 2023
Unique Number : 10563256 **Diagnostician** : Doug Bogart
Test Package : IND 2

JACKSON DAIRY - KROGER
 2600 E 4TH
 HUTCHINSON, KS
 US 67501
 Contact: Jason Stanley
 jason.stanley@kroger.com
 T: (620)694-6922
 F: (620)663-5135

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)