




PROBLEM SUMMARY

Sample Rating Trend

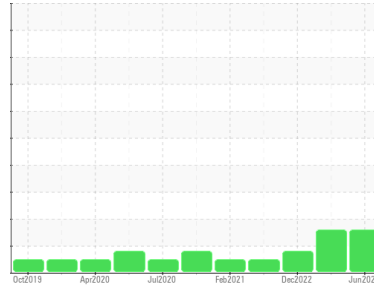

ISO




Machine Id
KAESER DSD 175T 6933810 (S/N 1041)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

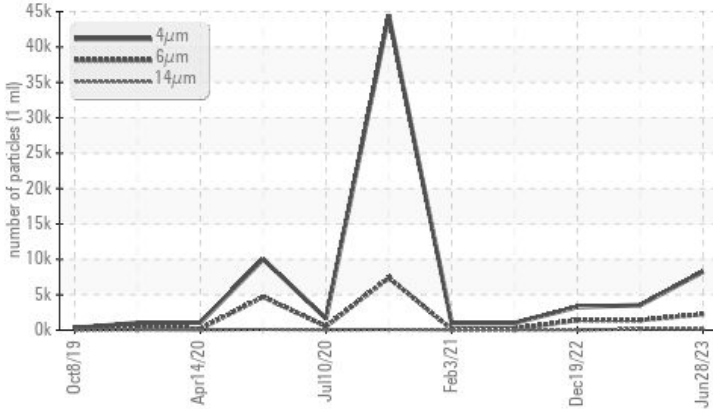

RECOMMENDATION

No corrective action is recommended at this time.
Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	ABNORMAL	ATTENTION
Particles >6µm	ASTM D7647	>1300	▲ 2258	▲ 1397	▲ 1418
Particles >14µm	ASTM D7647	>80	▲ 126	▲ 161	12
Particles >21µm	ASTM D7647	>20	▲ 27	▲ 40	1
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/18/14	▲ 19/18/15	▲ 19/18/11

Customer Id: FANTAM
Sample No.: KC101111
Lab Number: 05901903
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

07 Mar 2023 Diag: Don Baldrige

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



19 Dec 2022 Diag: Don Baldrige

ISO



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



18 Aug 2022 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

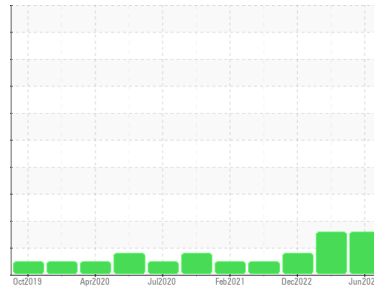

ISO



Machine Id
KAESER DSD 175T 6933810 (S/N 1041)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KC101111	KC111146	KC95671
Sample Date	Client Info	28 Jun 2023	07 Mar 2023	19 Dec 2022
Machine Age	hrs	10531	9475	8850
Oil Age	hrs	2792	0	1107
Oil Changed	Client Info	Not Chngd	Not Chngd	Not Chngd
Sample Status		ATTENTION	ABNORMAL	ATTENTION

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	<1
Chromium	ppm	ASTM D5185m >10	0	0
Nickel	ppm	ASTM D5185m >3	0	0
Titanium	ppm	ASTM D5185m >3	0	0
Silver	ppm	ASTM D5185m >2	0	0
Aluminum	ppm	ASTM D5185m >10	2	<1
Lead	ppm	ASTM D5185m >10	0	0
Copper	ppm	ASTM D5185m >50	7	6
Tin	ppm	ASTM D5185m >10	0	0
Vanadium	ppm	ASTM D5185m	0	0
Cadmium	ppm	ASTM D5185m	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0
Barium	ppm	ASTM D5185m 90	0	0
Molybdenum	ppm	ASTM D5185m	0	0
Manganese	ppm	ASTM D5185m	0	0
Magnesium	ppm	ASTM D5185m 90	5	17
Calcium	ppm	ASTM D5185m 2	0	0
Phosphorus	ppm	ASTM D5185m	<1	3
Zinc	ppm	ASTM D5185m	21	31

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	0	<1
Sodium	ppm	ASTM D5185m	0	10
Potassium	ppm	ASTM D5185m >20	1	2
Water	%	ASTM D6304 >0.05	0.006	0.020
ppm Water	ppm	ASTM D6304 >500	69.7	201.2






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	8238	3533	3282
Particles >6µm	ASTM D7647 >1300	▲ 2258	▲ 1397	▲ 1418
Particles >14µm	ASTM D7647 >80	▲ 126	▲ 161	12
Particles >21µm	ASTM D7647 >20	▲ 27	▲ 40	1
Particles >38µm	ASTM D7647 >4	0	1	0
Particles >71µm	ASTM D7647 >3	0	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 20/18/14	▲ 19/18/15	▲ 19/18/11

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.39	0.35


OIL ANALYSIS REPORT

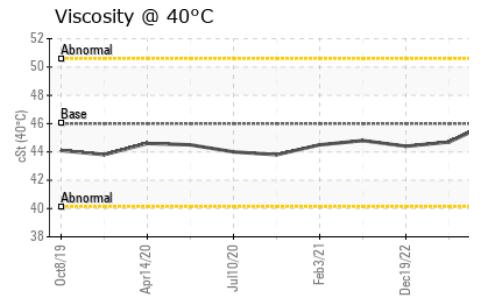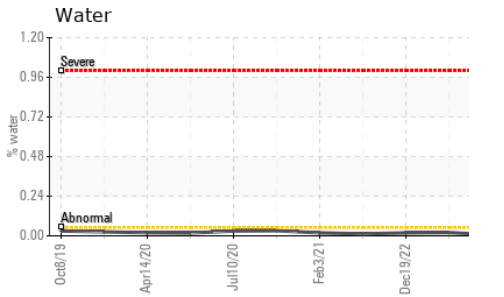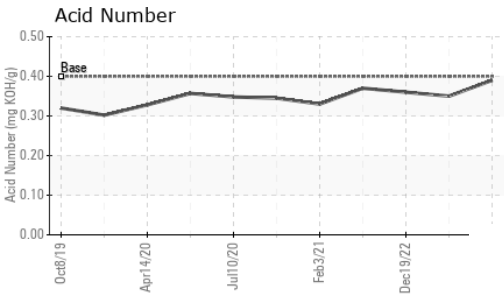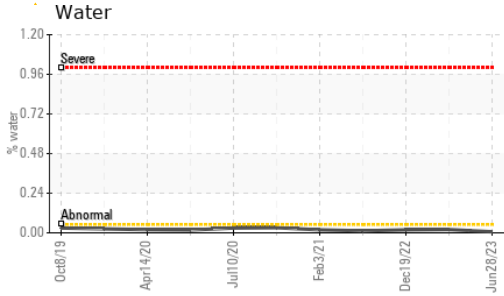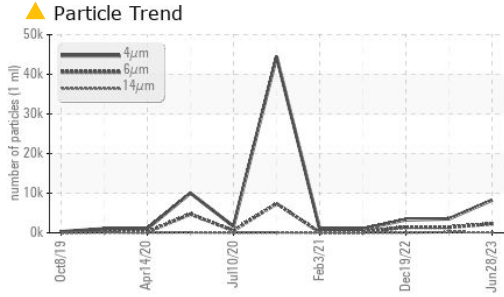





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	46.1	44.7	44.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

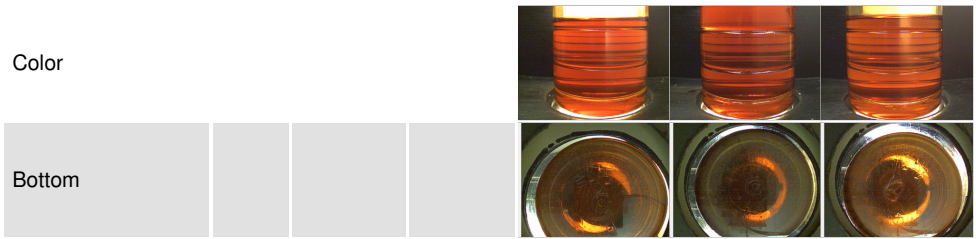

GRAPHS

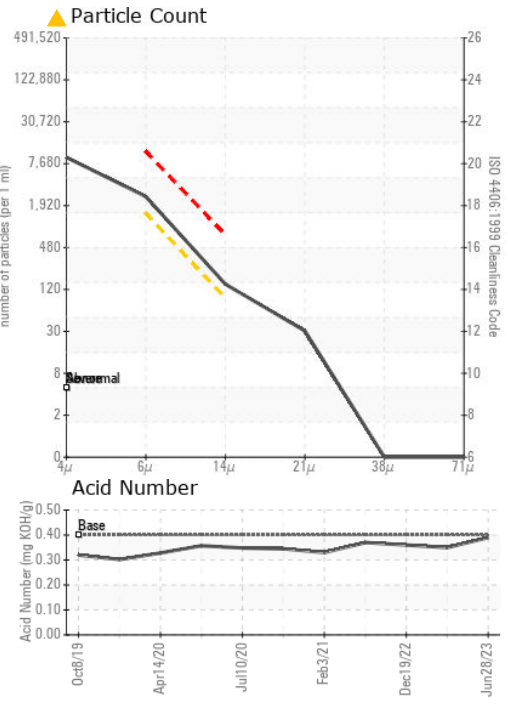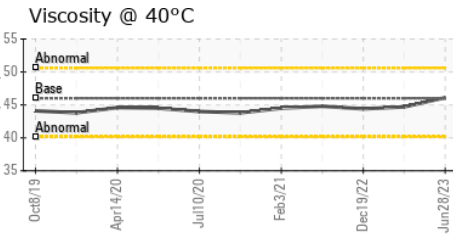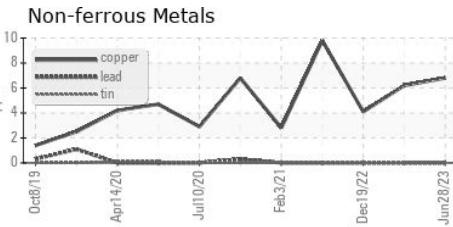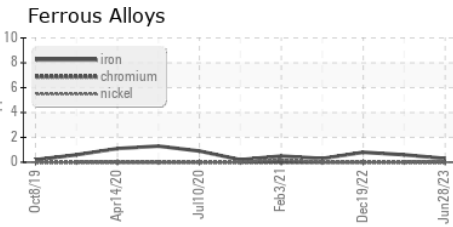

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC101111 **Received** : 18 Jul 2023
Lab Number : 05901903 **Diagnosed** : 20 Jul 2023
Unique Number : 10563259 **Diagnostician** : Don Baldrige
Test Package : IND 2

FANATICS INC
 4408 W LINEBAUGH AVE
 TAMPA, FL
 US 33624
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: