




# PROBLEM SUMMARY

Sample Rating Trend

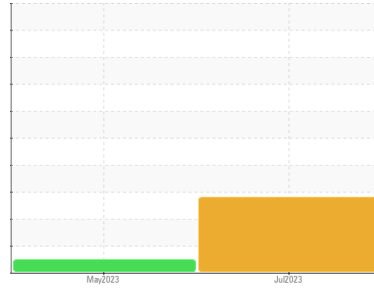

**WATER**




Machine Id  
**KAESER 8435979**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## COMPONENT CONDITION SUMMARY

▲ Water

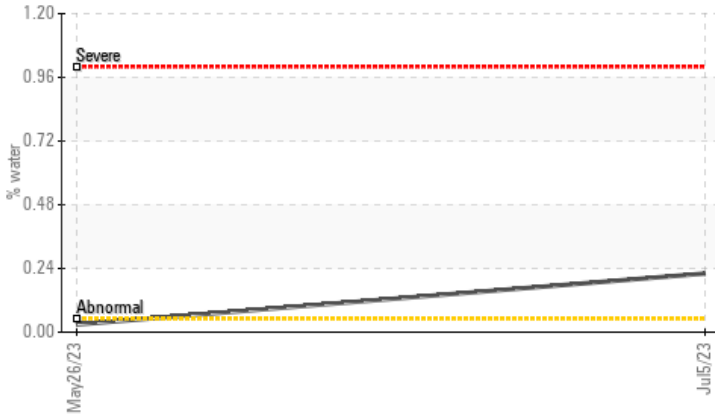

## RECOMMENDATION

Oil and filter change at the time of sampling has been noted. We were unable to perform a particle count due to a high concentration of particles present in this sample. We recommend an early resample in 500 hours to monitor this condition.

## PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	NORMAL	---
Water	%	ASTM D6304	>0.05	▲ <b>0.221</b>	0.029	---
ppm Water	ppm	ASTM D6304	>500	▲ <b>2210</b>	294.6	---
Debris	scalar	*Visual	NONE	▲ <b>MODER</b>	NONE	---
Appearance	scalar	*Visual	NORML	▲ <b>HAZY</b>	NORML	---
Emulsified Water	scalar	*Visual	>0.05	▲ <b>0.2%</b>	NEG	---

Customer Id: FANRIV  
Sample No.: KC101061  
Lab Number: 05901905  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.
Alert	---	---	?	We were unable to perform a particle count due to a high concentration of particles present in this sample.

## HISTORICAL DIAGNOSIS

**26 May 2023 Diag: Don Baldrige**

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

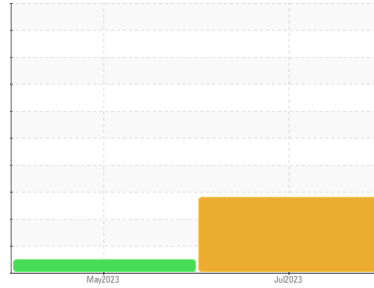

**WATER**



Machine Id  
**KAESER 8435979**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

Oil and filter change at the time of sampling has been noted. We were unable to perform a particle count due to a high concentration of particles present in this sample. We recommend an early resample in 500 hours to monitor this condition.

### Wear

All component wear rates are normal.

### ▲ Contamination

Moderate concentration of visible dirt/debris present in the oil. There is a light concentration of water present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC101061</b>	KC102785	---
Sample Date	Client Info			<b>05 Jul 2023</b>	26 May 2023	---
Machine Age	hrs	Client Info		<b>1756</b>	1456	---
Oil Age	hrs	Client Info		<b>1756</b>	1456	---
Oil Changed	Client Info			<b>Changed</b>	Not Changd	---
Sample Status				<b>ABNORMAL</b>	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>1</b>	2	---
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	---
Lead	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	---
Copper	ppm	ASTM D5185m	>50	<b>6</b>	3	---
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	---
Barium	ppm	ASTM D5185m	90	<b>0</b>	7	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	---
Magnesium	ppm	ASTM D5185m	90	<b>44</b>	67	---
Calcium	ppm	ASTM D5185m	2	<b>2</b>	2	---
Phosphorus	ppm	ASTM D5185m		<b>2</b>	3	---
Zinc	ppm	ASTM D5185m		<b>0</b>	3	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	---
Sodium	ppm	ASTM D5185m		<b>7</b>	14	---
Potassium	ppm	ASTM D5185m	>20	<b>9</b>	9	---
Water	%	ASTM D6304	>0.05	<b>▲ 0.221</b>	0.029	---
ppm Water	ppm	ASTM D6304	>500	<b>▲ 2210</b>	294.6	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		---	2176	---
Particles >6µm		ASTM D7647	>1300	---	900	---
Particles >14µm		ASTM D7647	>80	---	57	---
Particles >21µm		ASTM D7647	>20	---	12	---
Particles >38µm		ASTM D7647	>4	---	1	---
Particles >71µm		ASTM D7647	>3	---	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	---	18/17/13	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.27</b>	0.31	---

# OIL ANALYSIS REPORT

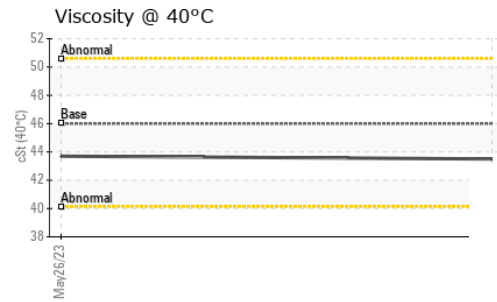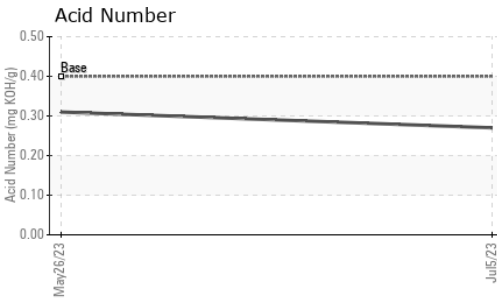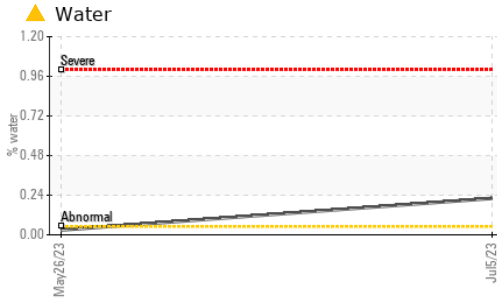





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>NONE</b>	LIGHT	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Debris	scalar	*Visual	NONE	<b>▲ MODER</b>	NONE	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual	NORML	<b>▲ HAZY</b>	NORML	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual	>0.05	<b>▲ 0.2%</b>	NEG	---
Free Water	scalar	*Visual		<b>NEG</b>	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	<b>43.5</b>	43.7	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------



## GRAPHS

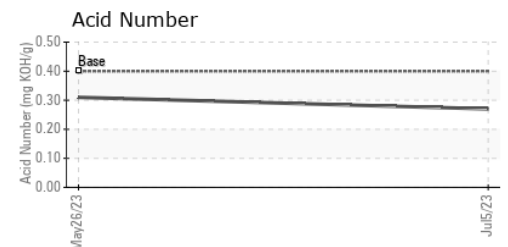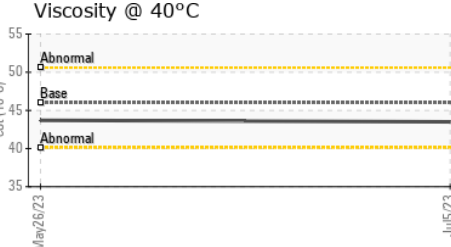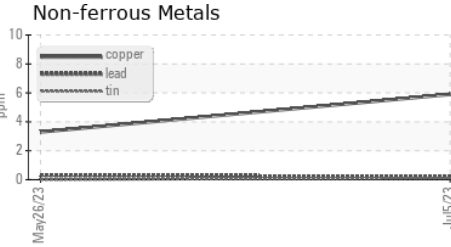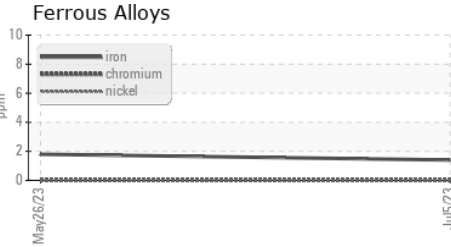

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC101061 **Received** : 18 Jul 2023  
**Lab Number** : **05901905** **Diagnosed** : 20 Jul 2023  
**Unique Number** : 10563261 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**FANATICS INC**  
 8221 EAGLE PALM DR  
 RIVERVIEW, FL  
 US 33569  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: