


OIL ANALYSIS REPORT

SYNOIL 8K FG 1092 - BEL BRANDS

Component

Compressor





Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Jul2021 Jul2022 Jul2023						
SAMPLE INFORM	MOITAN	method	limit/base	current	history1	history2
Sample Number		Client Info		UCZ05901915	UCZ05589631	UCZ05309605
Sample Date		Client Info		05 Jul 2023	06 Jul 2022	21 Jul 2021
Machine Age	hrs	Client Info		76017	75687	75509
Oil Age	hrs	Client Info		330	100	200
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	<1
Chromium	ppm	ASTM D5185m	>5	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	<1	0
Aluminum	ppm	ASTM D5185m	>15	<1	1	0
Lead	ppm	ASTM D5185m	>65	0	<1	0
Copper	ppm	ASTM D5185m	>65	<1	<1	0
Tin	ppm	ASTM D5185m	>10	0	<1	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	1	0	<1	<1
Barium	ppm	ASTM D5185m	0.3	0	2	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0	0
Magnesium	ppm	ASTM D5185m	0	<1	0	0
Calcium	ppm	ASTM D5185m	0.5	0	0	0
Phosphorus	ppm	ASTM D5185m	536	519	436	488
Zinc	ppm	ASTM D5185m	0.2	7	4	4
Sulfur	ppm	ASTM D5185m	649	1452	649	446
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	0	1	<1
Sodium	ppm	ASTM D5185m		0	0	0
Potassium	ppm	ASTM D5185m	>20	<1	<1	0
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.337	0.30	0.27	0.375
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
Fran Motor		*\ /! 1	,	NEC		LIMPADADE

1: DENEGSCHAD - UNZORGRE



OIL ANALYSIS REPORT

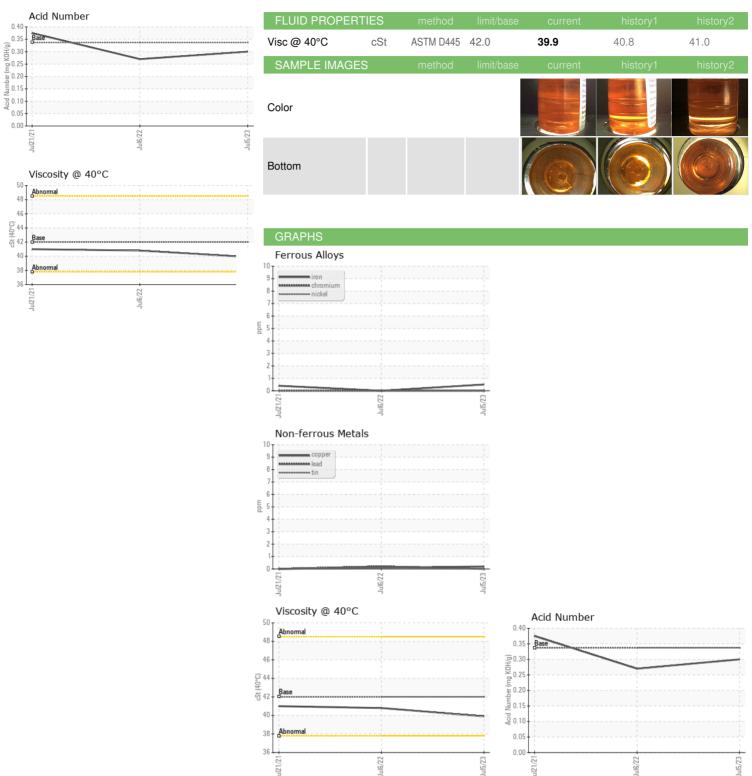





Certificate L2367

Laboratory Sample No.

Lab Number

: 05901915 Unique Number : 10563271 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UCZ05901915 Received : 18 Jul 2023

Diagnosed : 20 Jul 2023 Diagnostician : Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

ZORN COMP & EQUIPMENT CO (GB)

Contact/Location: DEAN SCHAD - UCZORGRE

733 POTTS AVE GREEN BAY, WI US 54304

Contact: DEAN SCHAD dean.schad@zornair.com

T: (920)391-8121

F: (920)499-1168