




# OIL ANALYSIS REPORT

Sample Rating Trend

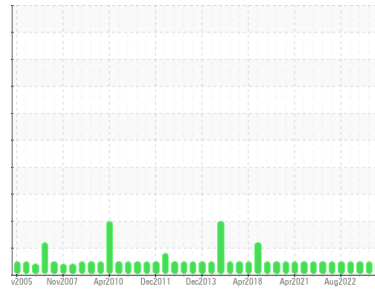

**NORMAL**



Area  
**SPLITTER 2**  
 Machine Id  
**055CM12002**  
 Component  
**Turbine**  
 Fluid  
**ROYAL PURPLE SYNFILM 32 (500 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>RP0027129</b>	RP0027121	RP0019536
Sample Date	Client Info		<b>18 Jul 2023</b>	12 Apr 2023	16 Jan 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >15	<b>&lt;1</b>	0	0
Chromium	ppm	ASTM D5185m >4	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >2	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>1</b>	0	0
Lead	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m >5	<b>1</b>	0	<1
Tin	ppm	ASTM D5185m >5	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m 90	<b>54</b>	53	59
Calcium	ppm	ASTM D5185m	<b>0</b>	0	<1
Phosphorus	ppm	ASTM D5185m	<b>0</b>	<1	38
Zinc	ppm	ASTM D5185m	<b>0</b>	0	13

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>1</b>	<1	<1
Sodium	ppm	ASTM D5185m	<b>0</b>	3	3
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	0
Water	%	ASTM D6304 >0.03	<b>0.014</b>	0.012	0.007
ppm Water	ppm	ASTM D6304 >300	<b>143.0</b>	126.5	79.5






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>386</b>	3342	806
Particles >6µm	ASTM D7647 >1300		<b>100</b>	667	181
Particles >14µm	ASTM D7647 >160		<b>9</b>	10	5
Particles >21µm	ASTM D7647 >40		<b>3</b>	3	2
Particles >38µm	ASTM D7647 >10		<b>0</b>	1	0
Particles >71µm	ASTM D7647 >3		<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/14	<b>16/14/10</b>	19/17/10	17/15/10

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.35</b>	0.35	0.38


# OIL ANALYSIS REPORT

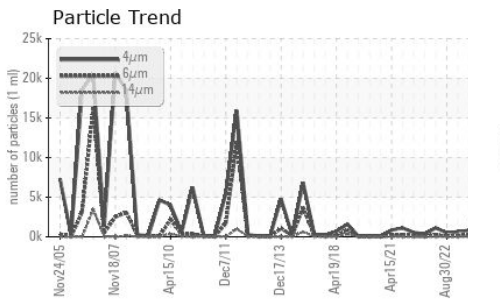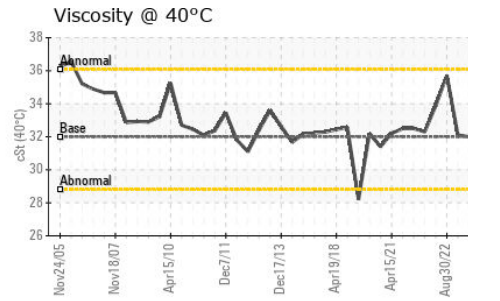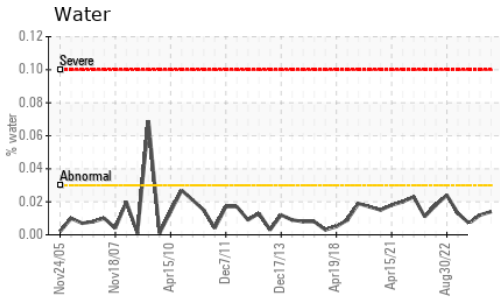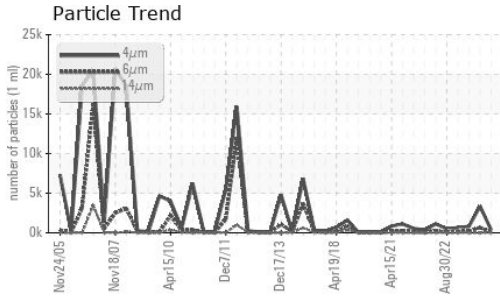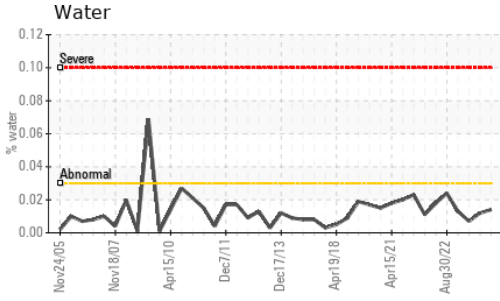






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.03	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	32	32.0	32.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

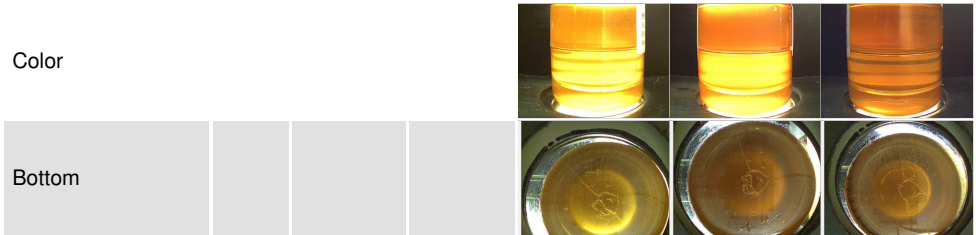

## GRAPHS

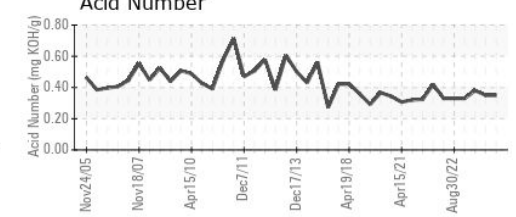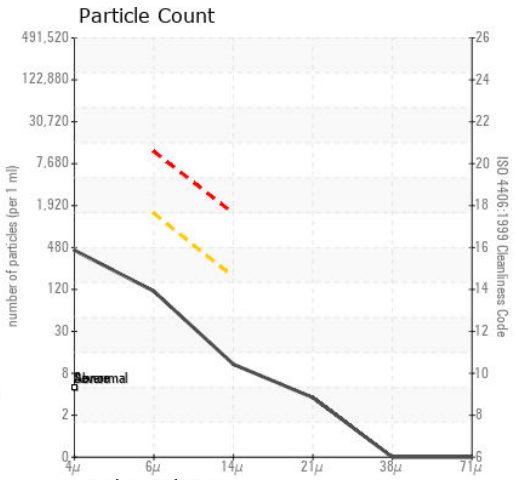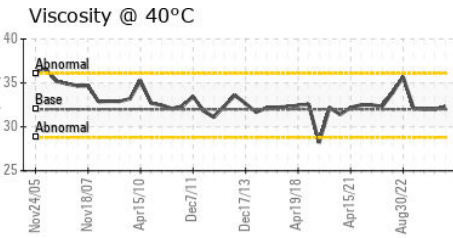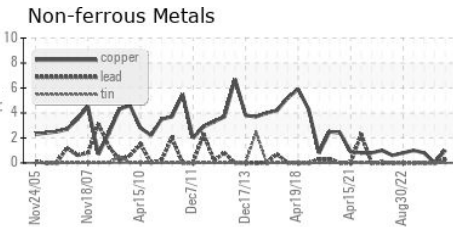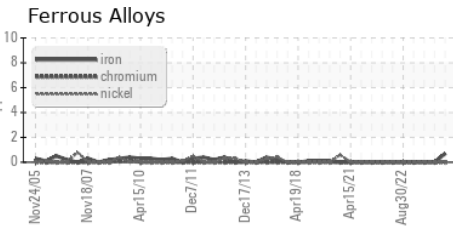

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0027129 **Received** : 19 Jul 2023  
**Lab Number** : 05902293 **Diagnosed** : 21 Jul 2023  
**Unique Number** : 10563649 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: PrtCount )

**ENTERPRISE PRODUCTS**  
P.O. BOX 573  
MONT BELVIEU, TX  
US 77580  
Contact: TOMMY EDWARDS  
tedwards@eprod.com  
T: (281)217-1411  
F: (281)385-4327

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)