


## **OIL ANALYSIS REPORT**

### **Sample Rating Trend**



NORMAL



# COMP 2 (S/N 96096031)

Component

**Refrigeration Compressor** 

USPI 1009-68 SC (--- GAL)

#### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Apr202	2 Jul2022	Nov2022	Jul2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP255334	USP247852	USP240703
Sample Date		Client Info		18 Jul 2023	22 Nov 2022	24 Jul 2022
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	<1	0	0
Chromium	ppm	ASTM D5185m	>2	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	<1	0	0
Lead	ppm	ASTM D5185m	>2	0	0	<1
Copper	ppm	ASTM D5185m	>8	0	0	0
Tin	ppm	ASTM D5185m	>4	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		<1	0	0
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		0	0	0
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m	50	24	18	6
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	3	<1	0
Sodium	ppm	ASTM D5185m		0	0	0
Potassium	ppm	ASTM D5185m	>20	<1	0	<1
Water	%	ASTM D6304	>0.01	0.003	0.002	0.001
ppm Water	ppm	ASTM D6304	>100	33.5	22.4	6.2
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	5612	1430	<b>▲</b> 43332
Particles >6µm		ASTM D7647	>2500	714	291	<u>▲</u> 10700
Particles >14µm		ASTM D7647	>640	14	21	243
Particles >21µm		ASTM D7647	>160	3	4	24
Particles >38µm		ASTM D7647	>40	0	1	0
Particles >71µm		ASTM D7647	>10	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/16	20/17/11	18/15/12	<u>△</u> 23/21/15
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
A si al Niversala au (ANI)	I/OII/-	ACTM DOZA	0.005	0.012	0.014	0.015

Acid Number (AN)

0.014


0.013

mg KOH/g ASTM D974 0.005

0.015



## **OIL ANALYSIS REPORT**

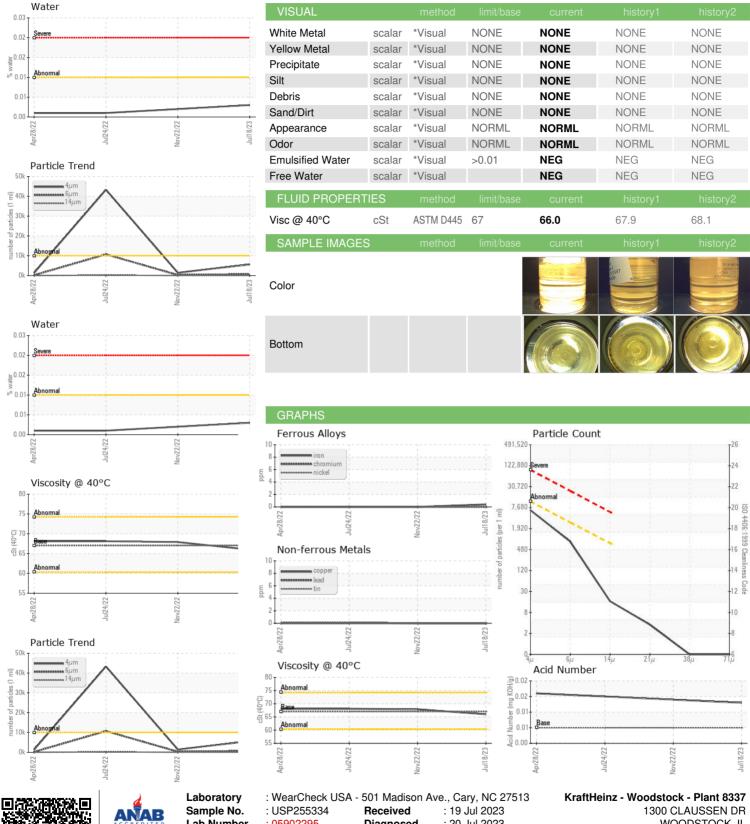





Certificate L2367

Lab Number **Unique Number** 

Test Package

: 05902295

: 10563651

Diagnosed : 20 Jul 2023 Diagnostician

: Doug Bogart

WOODSTOCK, IL US 60098

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

: IND 2

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: