

# **OIL ANALYSIS REPORT**

Sample Rating Trend

**NORMAL** 



# Machine Id KAESER SX 7.5 8355436 (S/N 1311)

Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

## Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

## Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jul2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC101692		
Sample Date		Client Info		12 Jul 2023		
Machine Age	hrs	Client Info		5737		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
			11 11 11			1:
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	16		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	90	13		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		<1		
Zinc	ppm	ASTM D5185m		48		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		5		
Potassium	ppm	ASTM D5185m	>20	2		
Water	%	ASTM D6304		0.021		
ppm Water	ppm	ASTM D6304	>500	211.0		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2040		
Particles >6µm		ASTM D7647	>1300	652		
Particles >14µm		ASTM D7647	>80	56		
Particles >21µm		ASTM D7647	>20	16		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm						
I ditiolog // Idili		ASTM D7647	>3	0		
Oil Cleanliness		ASTM D7647 ISO 4406 (c)	>3 >/17/13	0 18/17/13		


Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.22



## **OIL ANALYSIS REPORT**

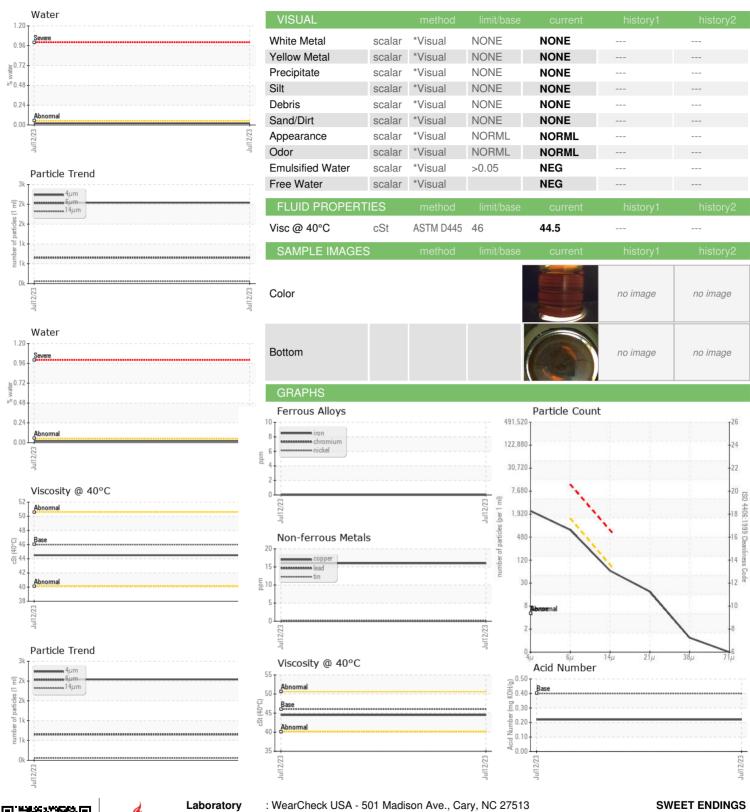





Certificate L2367

Sample No. Lab Number **Unique Number** Test Package

: KC101692 : 05902324 : 10563680 : IND 2

: 19 Jul 2023 Received Diagnosed : 21 Jul 2023 Diagnostician

: Don Baldridge

1220 OLD OKEECHOBEE ROAD

WEST PALM BEACH, FL US 33401

Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: