




# OIL ANALYSIS REPORT

Sample Rating Trend

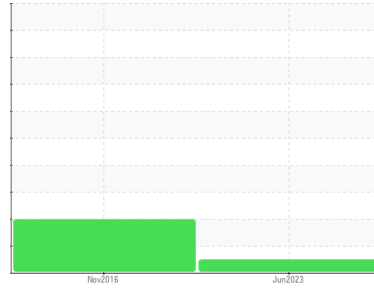

Machine Id  
**KAESER SK 15 5342238 (S/N 1806)**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA003306</b>	KCP60658	---
Sample Date	Client Info		<b>28 Jun 2023</b>	22 Nov 2016	---
Machine Age	hrs	Client Info	<b>18912</b>	3653	---
Oil Age	hrs	Client Info	<b>0</b>	3653	---
Oil Changed	Client Info		<b>N/A</b>	N/A	---
Sample Status			<b>NORMAL</b>	ABNORMAL	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>&lt;1</b>	<1	---
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m >3	<b>0</b>	<1	---
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m >10	<b>1</b>	<1	---
Lead	ppm	ASTM D5185m >10	<b>0</b>	<1	---
Copper	ppm	ASTM D5185m >50	<b>4</b>	10	---
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	---
Antimony	ppm	ASTM D5185m	<b>---</b>	<1	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	---
Barium	ppm	ASTM D5185m 90	<b>0</b>	3	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	---
Magnesium	ppm	ASTM D5185m 90	<b>42</b>	34	---
Calcium	ppm	ASTM D5185m 2	<b>0</b>	<1	---
Phosphorus	ppm	ASTM D5185m	<b>&lt;1</b>	3	---
Zinc	ppm	ASTM D5185m	<b>22</b>	37	---
Sulfur	ppm	ASTM D5185m	<b>19157</b>	16632	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	<1	---
Sodium	ppm	ASTM D5185m	<b>8</b>	11	---
Potassium	ppm	ASTM D5185m >20	<b>2</b>	9	---
Water	%	ASTM D6304 >0.05	<b>0.021</b>	0.020	---
ppm Water	ppm	ASTM D6304 >500	<b>215.9</b>	200	---





## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>554</b>	2448	---
Particles >6µm	ASTM D7647 >1300		<b>181</b>	▲ 1333	---
Particles >14µm	ASTM D7647 >80		<b>26</b>	▲ 227	---
Particles >21µm	ASTM D7647 >20		<b>13</b>	▲ 76	---
Particles >38µm	ASTM D7647 >4		<b>1</b>	▲ 11	---
Particles >71µm	ASTM D7647 >3		<b>0</b>	1	---
Oil Cleanliness	ISO 4406 (c) >--/17/13		<b>16/15/12</b>	▲ 18/15	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.39</b>	0.343	---


# OIL ANALYSIS REPORT

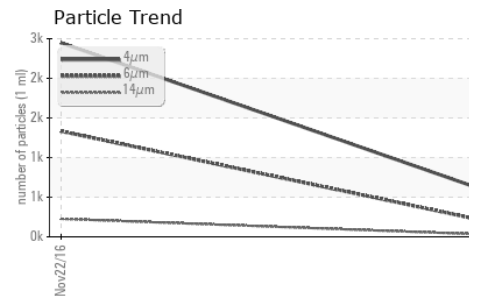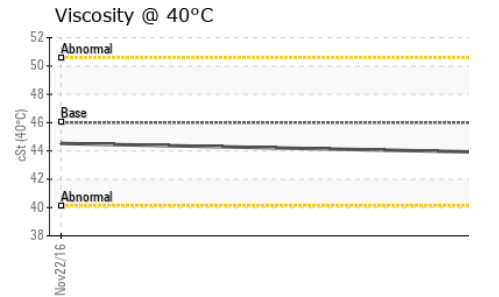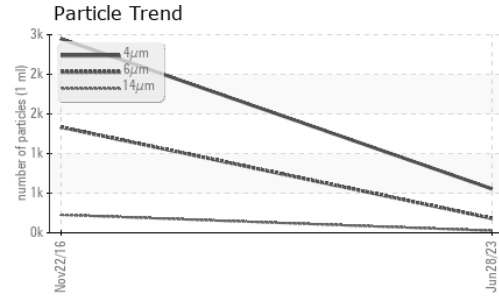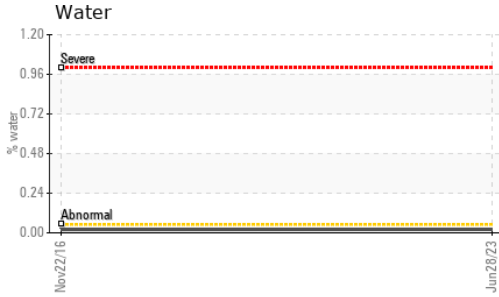





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	43.9	44.53	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

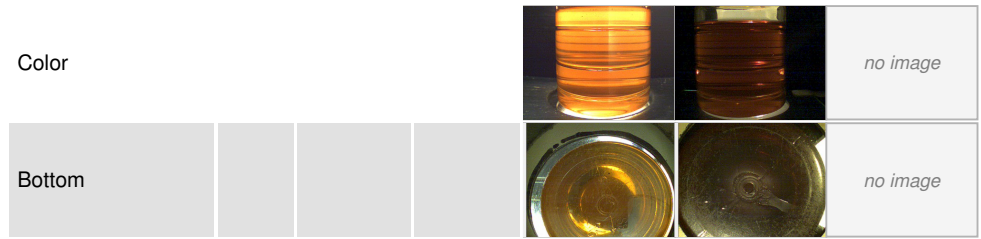

## GRAPHS

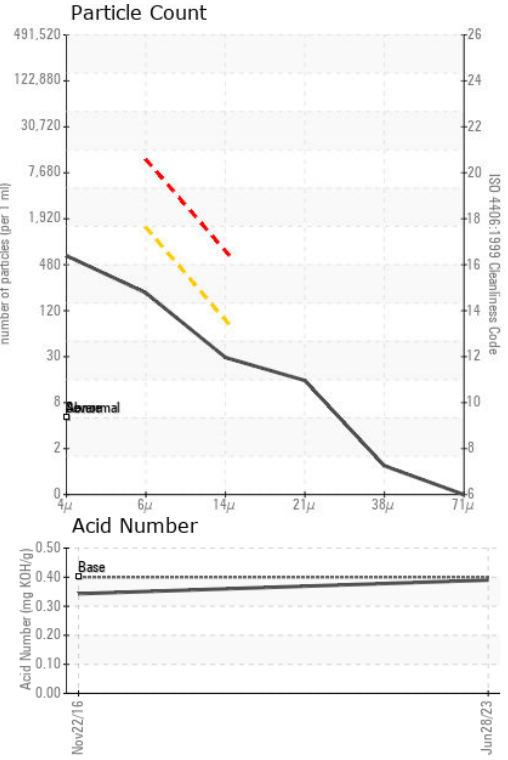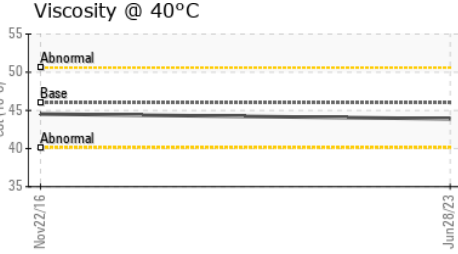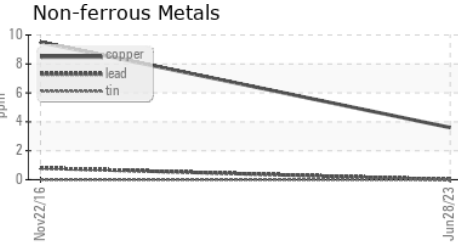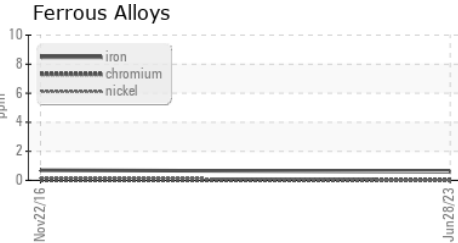

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA003306 **Received** : 19 Jul 2023  
**Lab Number** : 05902331 **Diagnosed** : 25 Jul 2023  
**Unique Number** : 10563687 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**AMSPEC**  
 3800 HWY 225  
 PASADENA, TX  
 US 77503  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)