


S-460 [5618]

# **OIL ANALYSIS REPORT**

# KAESER 1540 - TEMPCO ELECRIC HEATER CORP

Compressor





## Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the

## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		Jan202	2 Jul2022	Jan 2023 J	uI2023	
SAMPLE INFORM	MOITAN	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH05902397	UCH05762196	UCH05596116
Sample Date		Client Info		11 Jul 2023	23 Jan 2023	13 Jul 2022
Machine Age	hrs	Client Info		13018	11678	10075
Oil Age	hrs	Client Info		900	3000	4511
Oil Changed		Client Info		Changed	Changed	Not Changd
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	0	0	<1
Lead	ppm	ASTM D5185m	>10	0	0	<1
Copper	ppm	ASTM D5185m	>50	14	2	22
Tin	ppm	ASTM D5185m	>10	0	<1	2
Antimony	ppm	ASTM D5185m	7.0			
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
	ррш		11 11 11			-
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	90	<1	<1	<1
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		0	5	11
Zinc	ppm	ASTM D5185m		4	0	0
Sulfur	ppm	ASTM D5185m		20077	13490	17963
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	2	4
Sodium	ppm	ASTM D5185m		4	0	0
Potassium	ppm	ASTM D5185m	>20	0	0	1
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.48	0.43	0.45
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Trac Mate:		*\/:		NEC	CHART ÆEDDIS	


: NEG


CHANTEGFERRIS - UNDELDOW




## **OIL ANALYSIS REPORT**

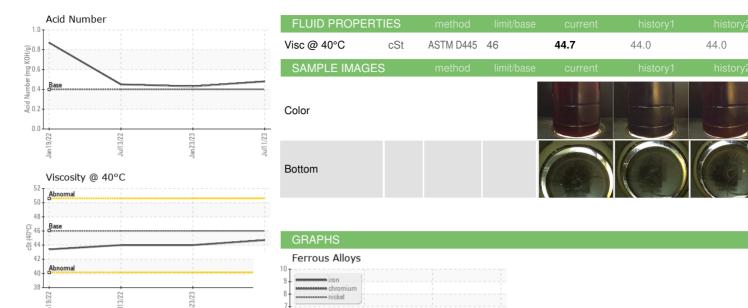











Certificate L2367

Laboratory Sample No.

Lab Number Unique Number : 10563753

: UCH05902397 : 05902397 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 19 Jul 2023 Diagnosed : 21 Jul 2023

Diagnostician : Angela Borella

**DELTA INDUSTRIES - DOWNERS GROVE** 

2201 CURTISS STREET DOWNERS GROVE, IL US 60515

Contact: MICHAEL FERRIS

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (630)960-3931