




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

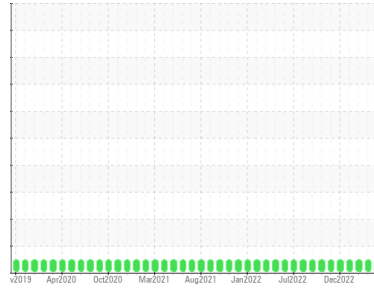

Area
No. 3 Paper Machine
 Machine Id
3 PM FAN PUMP (S/N 10378-P)
 Component
Pump
 Fluid
ROYAL PURPLE SYNFILM 100 (25 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	RP0031079	RP0031085	RP0031091
Sample Date	Client Info	17 Jul 2023	17 Mar 2023	17 Feb 2023
Machine Age	hrs Client Info	0	0	0
Oil Age	hrs Client Info	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		NORMAL	NORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>90	4	<1	1
Chromium ppm ASTM D5185m	>5	<1	0	0
Nickel ppm ASTM D5185m	>5	0	0	0
Titanium ppm ASTM D5185m	>3	0	0	0
Silver ppm ASTM D5185m	>3	0	0	0
Aluminum ppm ASTM D5185m	>7	<1	<1	<1
Lead ppm ASTM D5185m	>12	1	0	<1
Copper ppm ASTM D5185m	>30	4	2	2
Tin ppm ASTM D5185m	>9	<1	0	<1
Vanadium ppm ASTM D5185m		0	0	0
Cadmium ppm ASTM D5185m		0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m		0	0	0
Barium ppm ASTM D5185m		0	0	0
Molybdenum ppm ASTM D5185m		0	0	0
Manganese ppm ASTM D5185m		<1	<1	<1
Magnesium ppm ASTM D5185m	90	82	83	80
Calcium ppm ASTM D5185m		21	<1	4
Phosphorus ppm ASTM D5185m		9	1	25
Zinc ppm ASTM D5185m		8	0	2

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>60	4	4	3
Sodium ppm ASTM D5185m		12	12	12
Potassium ppm ASTM D5185m	>20	2	0	0
Water % ASTM D6304		0.015	0.010	0.009
ppm Water ppm ASTM D6304	>.1	152.2	109.1	95.0






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm ASTM D7647	>5000	58	142	55
Particles >6µm ASTM D7647	>1300	25	36	24
Particles >14µm ASTM D7647	>160	9	5	4
Particles >21µm ASTM D7647	>40	2	1	3
Particles >38µm ASTM D7647	>10	0	0	0
Particles >71µm ASTM D7647	>3	0	0	0
Oil Cleanliness ISO 4406 (c)	>19/17/14	13/12/10	14/12/10	13/12/9

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045	0.25	0.47	0.34	0.32

OIL ANALYSIS REPORT

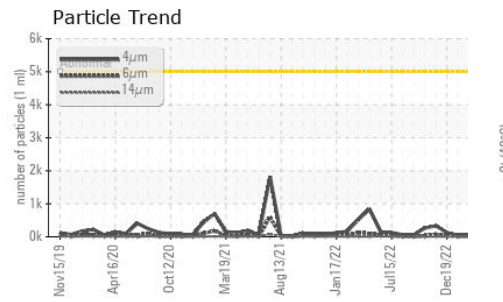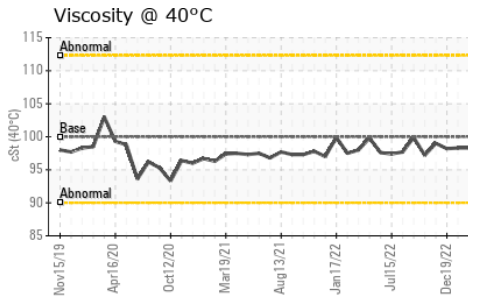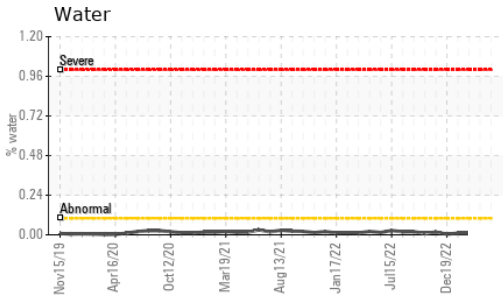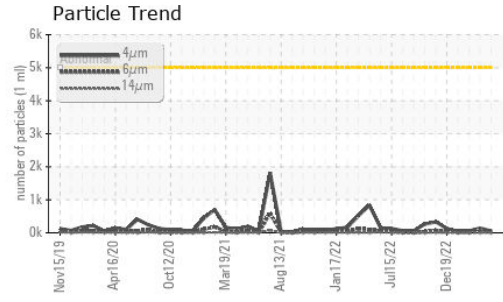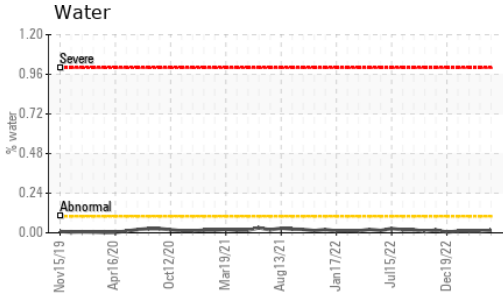






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	100	97.5	98.0	98.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------



GRAPHS

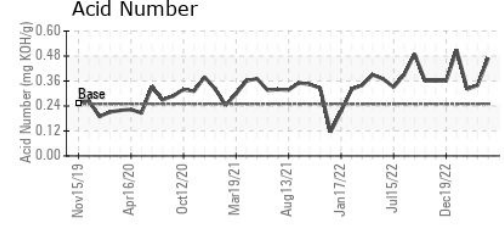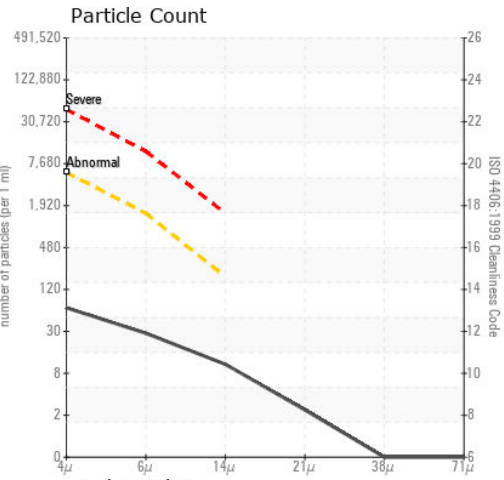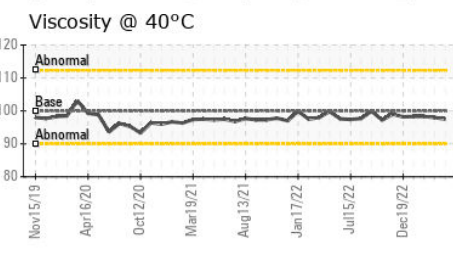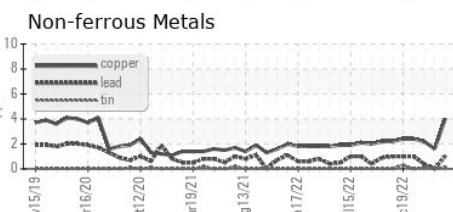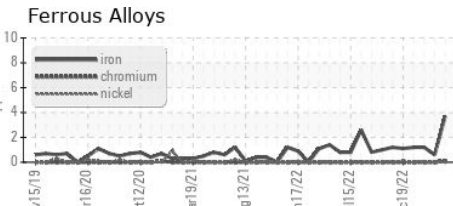

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0031079 **Received** : 19 Jul 2023
Lab Number : 05902844 **Diagnosed** : 21 Jul 2023
Unique Number : 10564200 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: PrtCount)

GRAPHIC PACKAGING INTERNATIONAL
 9978 FM 3129
 QUEEN CITY, TX
 US 75572
 Contact: DAVID COTHREN
 david.cothren@graphicpkg.com
 T: (903)796-1690
 F: (903)796-1969

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)