




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Machine Id  
**CATERPILLAR MATTHEW T**  
 Component  
**Starboard Genset**  
 Fluid  
**KENDALL SUPER-D XA 15W40 (--- GAL)**

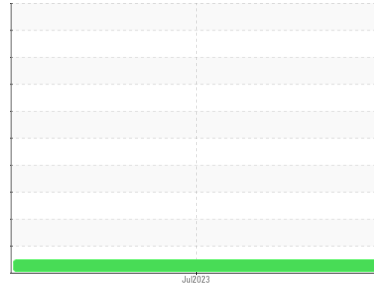

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC05902917</b>	---	---
Sample Date	Client Info		<b>18 Jul 2023</b>	---	---
Machine Age	hrs	Client Info	<b>4822</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>NORMAL</b>	---	---

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<b>&lt;1.0</b>	---	---
Glycol	WC Method		<b>NEG</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >25	<b>9</b>	---	---
Chromium	ppm	ASTM D5185m >5	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m >5	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m	<b>22</b>	---	---
Silver	ppm	ASTM D5185m >5	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >10	<b>2</b>	---	---
Lead	ppm	ASTM D5185m >10	<b>&lt;1</b>	---	---
Copper	ppm	ASTM D5185m >20	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m >5	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 50	<b>47</b>	---	---
Barium	ppm	ASTM D5185m	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m	<b>21</b>	---	---
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m 270	<b>141</b>	---	---
Calcium	ppm	ASTM D5185m 1900	<b>2979</b>	---	---
Phosphorus	ppm	ASTM D5185m 1000	<b>1010</b>	---	---
Zinc	ppm	ASTM D5185m 1260	<b>1258</b>	---	---
Sulfur	ppm	ASTM D5185m 3400	<b>4790</b>	---	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>3</b>	---	---
Sodium	ppm	ASTM D5185m	<b>4</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>5</b>	---	---

## INFRA-RED



	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	<b>0.1</b>	---	---
Nitration	Abs/cm	*ASTM D7624 >20	<b>9.2</b>	---	---
Sulfation	Abs/.1mm	*ASTM D7415 >30	<b>18.9</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	<b>14.4</b>	---	---
Base Number (BN)	mg KOH/g	ASTM D2896 9.5	<b>7.93</b>	---	---







# OIL ANALYSIS REPORT

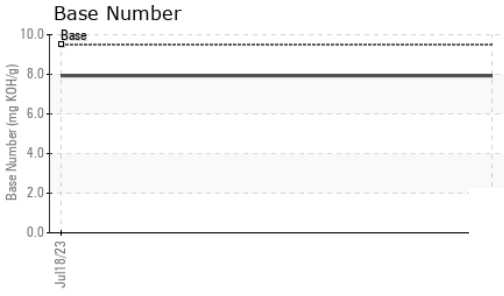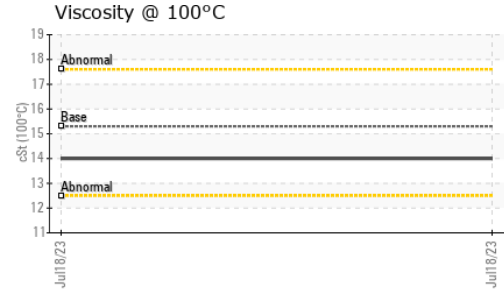

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	15.3	<b>14.0</b>	---	---

### GRAPHS

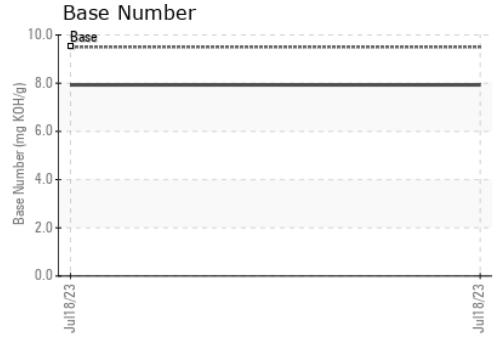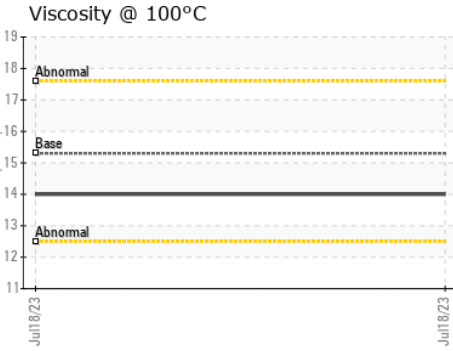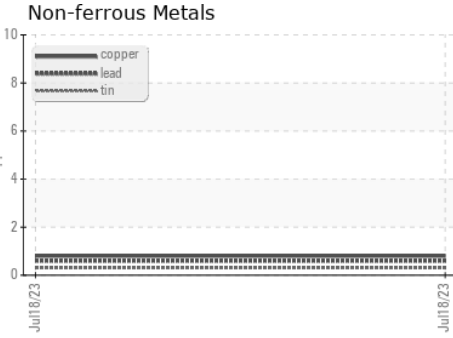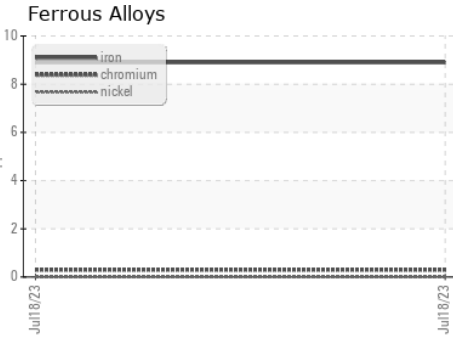

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC05902917     **Received** : 19 Jul 2023  
**Lab Number** : **05902917**     **Diagnosed** : 21 Jul 2023  
**Unique Number** : 10564273     **Diagnostician** : Sean Felton  
**Test Package** : MAR 2

**SUPERIOR MARINE WAYS**  
 5852 CO RD 1  
 SOUTH POINT, OH  
 US 45680  
 Contact: DARRELL KEARNS  
 darrellkerns@superiormarineinc.com  
 T: (740)894-6224  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)