




# FUEL REPORT

Sample Rating Trend

**NORMAL**

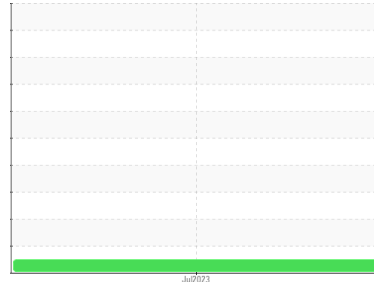

Machine Id  
**KIOTI PN6700054**

Component  
**Diesel Fuel**  
Fluid  
**NOT GIVEN (--- GAL)**

## DIAGNOSIS

### Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

### Corrosion

All metal levels are normal indicating no corrosion in the system.

### Contaminants

The water content is negligible. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. There is no indication of any contamination in the fuel. The amount and size of particulates present in the system are acceptable.

### Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KT0000627</b>	---	---
Sample Date	Client Info			<b>12 Jul 2023</b>	---	---
Machine Age	hrs	Client Info		<b>737</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Specific Gravity		*ASTM D1298		<b>0.853</b>	---	---
Fuel Color	text	*Visual Screen		<b>Yellow</b>	---	---
ASTM Color	scalar	*ASTM D1500		<b>L2.5</b>	---	---
Visc @ 40°C	cSt	ASTM D445		<b>2.66</b>	---	---
Pensky-Martens Flash Point	°C	*PMCC Calculated		<b>60</b>	---	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m		<b>0</b>	---	---
Sulfur (UVF)	ppm	ASTM D5453		<b>15</b>	---	---






DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86		<b>167</b>	---	---
5% Distillation Point	°C	ASTM D86		<b>194</b>	---	---
10% Distill Point	°C	ASTM D86		<b>205</b>	---	---
15% Distillation Point	°C	ASTM D86		<b>216</b>	---	---
20% Distill Point	°C	ASTM D86		<b>224</b>	---	---
30% Distill Point	°C	ASTM D86		<b>238</b>	---	---
40% Distill Point	°C	ASTM D86		<b>252</b>	---	---
50% Distill Point	°C	ASTM D86		<b>265</b>	---	---
60% Distill Point	°C	ASTM D86		<b>279</b>	---	---
70% Distill Point	°C	ASTM D86		<b>292</b>	---	---
80% Distill Point	°C	ASTM D86		<b>307</b>	---	---
85% Distillation Point	°C	ASTM D86		<b>316</b>	---	---
90% Distill Point	°C	ASTM D86		<b>326</b>	---	---
95% Distillation Point	°C	ASTM D86		<b>343</b>	---	---
Final Boiling Point	°C	ASTM D86		<b>351</b>	---	---
Distillation Residue	%	ASTM D86		<b>1.4</b>	---	---
Distillation Loss	%	ASTM D86		<b>0.8</b>	---	---

IGNITION QUALITY		method	limit/base	current	history1	history2
API Gravity		ASTM D7777		<b>34.4</b>	---	---
Cetane Index		ASTM D4737	<40.0	<b>44.6</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	<b>0</b>	---	---
Sodium	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	---	---
Potassium	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---
Water	%	ASTM D6304	<0.05	<b>0.003</b>	---	---
ppm Water	ppm	ASTM D6304	<500	<b>26.5</b>	---	---
% Gasoline	%	*In-House	<0.50	<b>0.0</b>	---	---
% Biodiesel	%	*In-House	<20.0	<b>0.0</b>	---	---



# FUEL REPORT

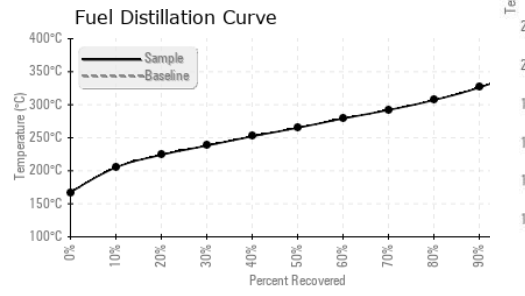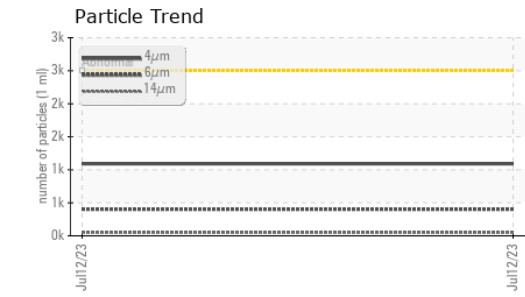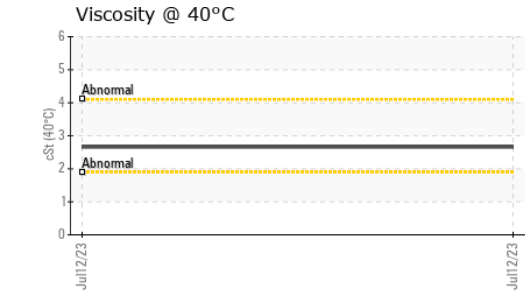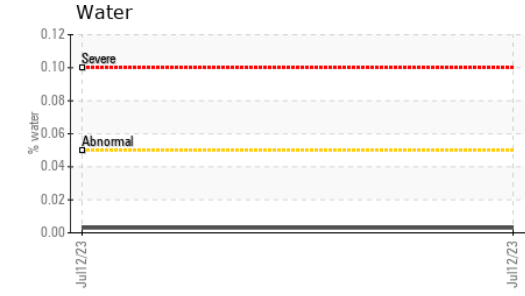
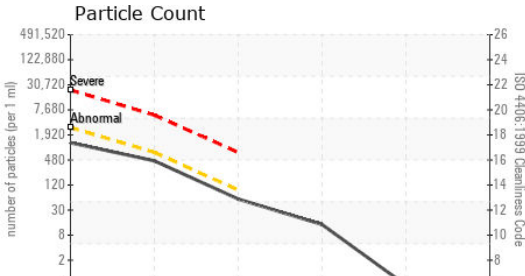


FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	<b>1091</b>	---	---
Particles >6µm	ASTM D7647	>640	<b>403</b>	---	---
Particles >14µm	ASTM D7647	>80	<b>49</b>	---	---
Particles >21µm	ASTM D7647	>20	<b>12</b>	---	---
Particles >38µm	ASTM D7647	>4	<b>0</b>	---	---
Particles >71µm	ASTM D7647	>3	<b>0</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>18/16/13	<b>17/16/13</b>	---	---

HEAVY METALS	method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m <0.1	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m <0.1	<b>0</b>	---	---
Lead	ppm	ASTM D5185m <0.1	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m <0.1	<b>&lt;1</b>	---	---
Iron	ppm	ASTM D5185m <0.1	<b>0</b>	---	---
Calcium	ppm	ASTM D5185m <0.1	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m <0.1	<b>&lt;1</b>	---	---
Phosphorus	ppm	ASTM D5185m <0.1	<b>0</b>	---	---
Zinc	ppm	ASTM D5185m <0.1	<b>0</b>	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

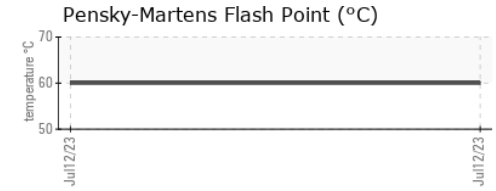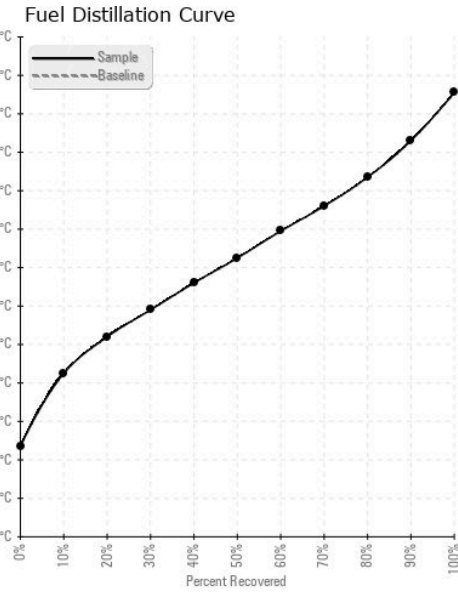

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KT0000627 **Received** : 19 Jul 2023  
**Lab Number** : **05902947** **Diagnosed** : 26 Jul 2023  
**Unique Number** : 10564303 **Diagnostician** : Doug Bogart  
**Test Package** : DF-2 ( Additional Tests: Screen )

**JORDAN SALES AND SERVICE**  
 715 N PLEASANT VIEW RD  
 POST FALLS, ID  
 US 83854  
 Contact: Service Manager  
 SERVICE@JORDANSALES.COM  
 T:  
 F:

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)