




OIL ANALYSIS REPORT

Sample Rating Trend

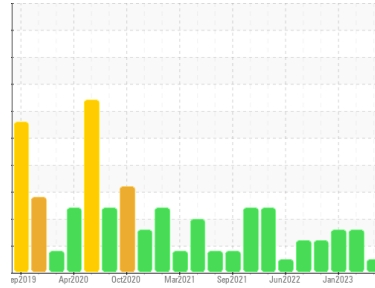

NORMAL



Area
GP-112
 Machine Id
B38329 - PUMP VACUUM BUSCH MODEL 1000 COOK IN BAG (S/N 42490-9908)
 Component
Pump
 Fluid
PETRO CANADA PURITY FG SYNTHETIC 100 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0826108	WC0774958	WC0765478
Sample Date	Client Info		15 Jul 2023	01 Apr 2023	26 Jan 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			NORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >90	3	0	<1
Chromium	ppm	ASTM D5185m >5	0	0	0
Nickel	ppm	ASTM D5185m >5	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >3	<1	0	0
Aluminum	ppm	ASTM D5185m >7	0	<1	0
Lead	ppm	ASTM D5185m >12	0	0	0
Copper	ppm	ASTM D5185m >30	<1	0	<1
Tin	ppm	ASTM D5185m >9	0	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	1	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	<1	0
Magnesium	ppm	ASTM D5185m	<1	2	0
Calcium	ppm	ASTM D5185m	2	0	0
Phosphorus	ppm	ASTM D5185m	528	409	381
Zinc	ppm	ASTM D5185m	4	0	<1
Sulfur	ppm	ASTM D5185m	1613	946	1220

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >60	1	1	1
Sodium	ppm	ASTM D5185m	0	0	<1
Potassium	ppm	ASTM D5185m >20	<1	0	0
Water	%	ASTM D6304	0.080	---	0.016
ppm Water	ppm	ASTM D6304 >.1	800	---	160

FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	4767	▲ 42337	▲ 65782
Particles >6µm	ASTM D7647	>2500	1260	▲ 13595	▲ 19772
Particles >14µm	ASTM D7647	>320	78	▲ 368	▲ 494
Particles >21µm	ASTM D7647	>80	18	23	87
Particles >38µm	ASTM D7647	>20	2	1	10
Particles >71µm	ASTM D7647	>4	0	0	1
Oil Cleanliness	ISO 4406 (c)	>20/18/15	19/17/13	▲ 23/21/16	▲ 23/21/16

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.5	0.081	0.122	0.058



OIL ANALYSIS REPORT

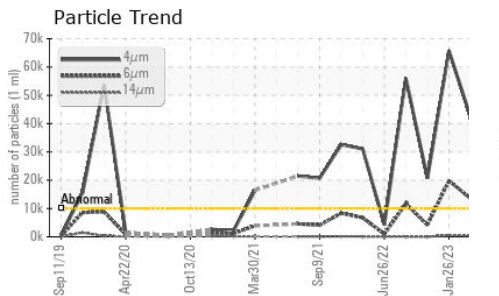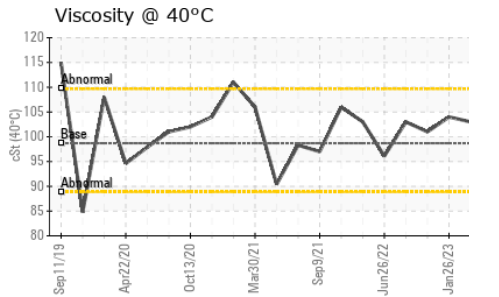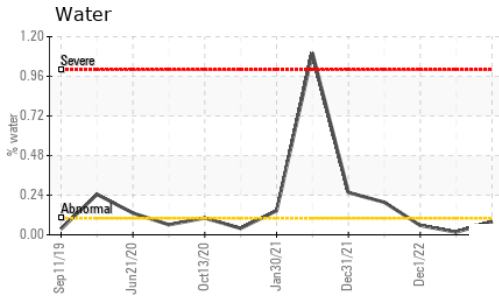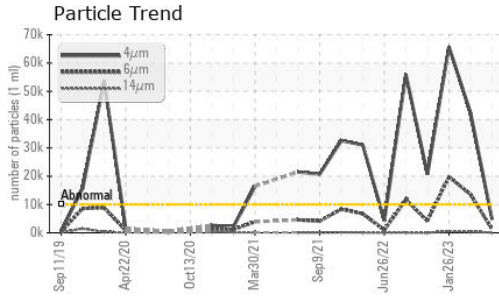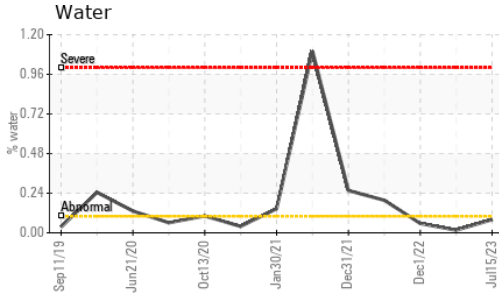





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	0.2%	NEG	0.2%
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	98.7	96.0	103

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------



GRAPHS

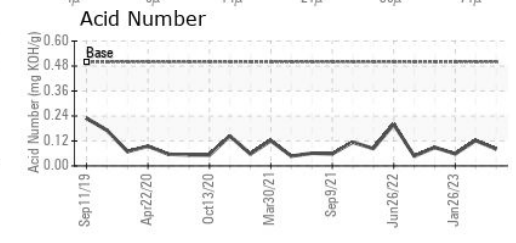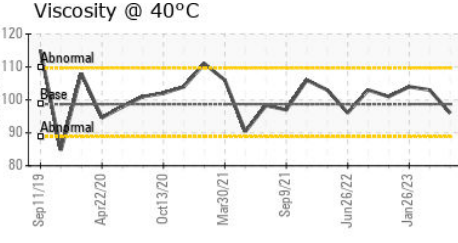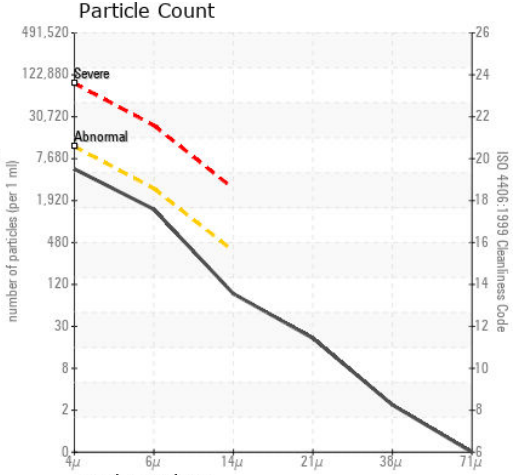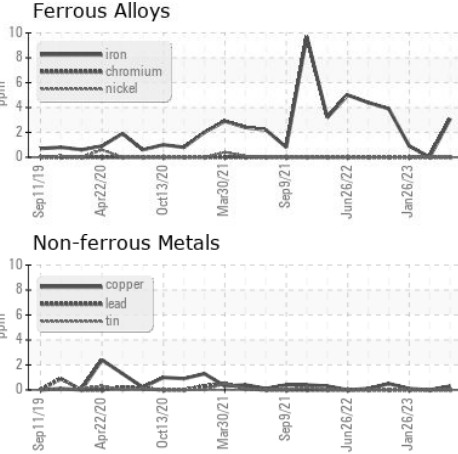

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0826108 **Received** : 20 Jul 2023
Lab Number : 05903191 **Diagnosed** : 27 Jul 2023
Unique Number : 10564547 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

HORMEL FOODS - AUSTIN
 1101 NORTH MAIN ST
 AUSTIN, MN
 US 55912
 Contact: RYAN LOWE
 rslowe@hormel.com
 T: (507)437-5674
 F: (507)437-9805

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)