


PROBLEM SUMMARY

Machine Id INGERSOLL RAND EVIS I/R 100HP EAST (S/N CK7278U06203) Component Air Compressor

USPI AIR 46 (--- GAL)

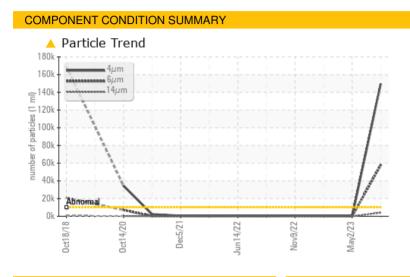

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Sample Rating Trend

PROBLEMATIC TEST RESULTS								
Sample Status		1	ABNORMAL	NORMAL	NORMAL			
Particles >4µm	ASTM D7647 >	10000	149747	111	594			
Particles >6µm	ASTM D7647 >2	2500 🧹	6 57865	43	93			
Particles >14µm	ASTM D7647 >3	320	4028	4	9			
Particles >21µm	ASTM D7647 >8	80 🖌	<mark> </mark> 800	2	4			
Particles >38µm	ASTM D7647 >2	20 🖌	<mark> </mark> 23	0	0			
Oil Cleanliness	ISO 4406 (c) >2	20/18/15 🤺	4/23/19	14/13/9	16/14/10			

Customer Id: TYSBLOAL Sample No.: USPM29020 Lab Number: 05903282 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 <u>dougb@wearcheckusa.com</u>

To change component or sample information: Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u>

RECOMMENDED ACTIONS					
Action	Status	Date	Done By	Description	
Change Filter			?	We recommend you service the filters on this component.	

HISTORICAL DIAGNOSIS



Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.




view report

08 Feb 2023 Diag: Doug Bogart

02 May 2023 Diag: Doug Bogart



Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.







OIL ANALYSIS REPORT

Machine Id INGERSOLL RAND EVIS I/R 100HP EAST (S/N CK7278U06203)

Air Compressor

Fluid USPI AIR 46 (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

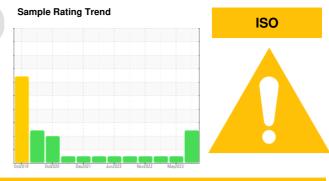

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USPM29020	USPM28831	USPM26434
Sample Date		Client Info		19 Jul 2023	02 May 2023	08 Feb 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	<1
Chromium	ppm	ASTM D5185m	>4	0	0	0
Nickel	ppm	ASTM D5185m	>4	0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		<1	0	0
Aluminum	ppm	ASTM D5185m	>10	0	0	0
Lead	ppm	ASTM D5185m	>20	0	0	0
Copper	ppm	ASTM D5185m		<1	0	0
Tin	ppm	ASTM D5185m	>5	0	0	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	0	2	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	<1
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	0	0	0	0
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	1	0	<1	2
Zinc	ppm	ASTM D5185m	0	0	0	0
Sulfur	ppm	ASTM D5185m	0	6	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	<1
Sodium	ppm	ASTM D5185m		0	0	<1
Potassium	ppm	ASTM D5185m	>20	<1	<1	0
Water	%	ASTM D6304	>0.2	0.130	0.073	0.053
ppm Water	ppm	ASTM D6304	>2000	1308.0	736.4	538.8
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	149747	111	594
Particles >6µm		ASTM D7647	>2500	6 57865	43	93
Particles >14µm		ASTM D7647	>320	4028	4	9
Particles >21µm		ASTM D7647	>80	<u> </u>	2	4
Particles >38µm		ASTM D7647	>20	<u> </u>	0	0
Particles >71µm		ASTM D7647	>4	2	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	A 24/23/19	14/13/9	16/14/10
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.05	0.21	0.184	0.05



200

(1 ml) 150

E 100

50

0

vater 1.0

0.5

0.0

3 1

3.0 (B/HOX B 2.0 Acid Number (1.0

0

0.1 Vater

0.5

0.0 0ct18/

65

60 (0°C) (40°C)

> 50 Ba

45 Abnorma

41

4/20

S

A

Water

OIL ANALYSIS REPORT

method

*Visual

*Visual

*Visual

*Visual

*Visual

*Visua *Visual

*Visual

method

ASTM D445

method

limit/base

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

>0.2

current

NONE

NONE

NONE

NONE

NONE


NONE

NORML

NORML

NEG

NEG

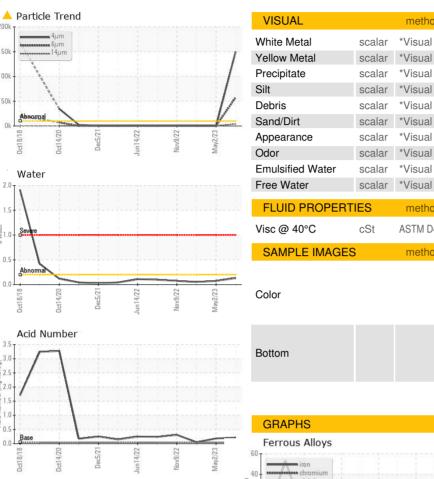



history1

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

NEG

NEG

history2

NONE

NONE

NONE

NONE

NONE


NONE

NORML

NORML

NEG

NEG

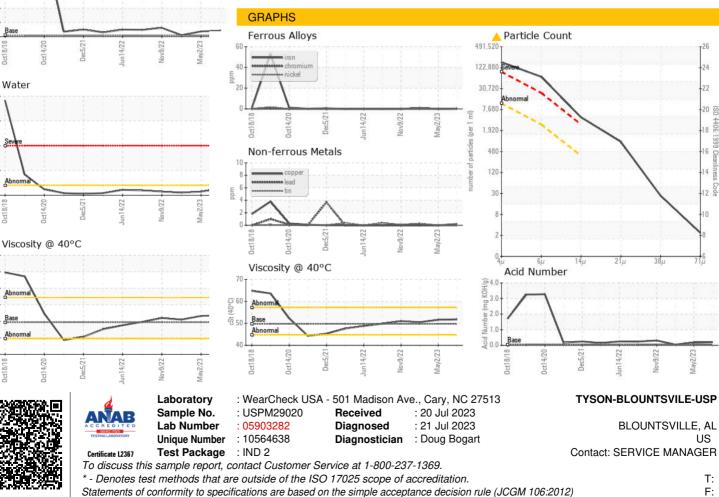

Contact/Location: SERVICE MANAGER - TYSBLOAL