


PROBLEM SUMMARY

INGERSOLL RAND EVIS I/R 100HP WEST (S/N CK7965U07297) Component **Air Compressor** Fluic

USPI AIR 46 (--- GAL)

COMPONENT CONDITION SUMMARY

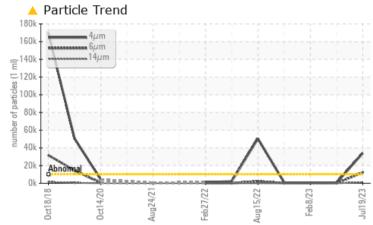

RECOMMENDATION

Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS							
Sample Status			ABNORMAL	NORMAL	NORMAL		
Particles >4µm	ASTM D7647	>10000	A 33953	475	447		
Particles >6µm	ASTM D7647	>2500	🔺 12143	133	100		
Particles >14µm	ASTM D7647	>320	🔺 1194	13	5		
Particles >21µm	ASTM D7647	>80	A 328	4	1		
Oil Cleanliness	ISO 4406 (c)	>20/18/15	22/21/17	16/14/11	16/14/10		


Customer Id: TYSBLOAL Sample No.: USPM29017 Lab Number: 05903284 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

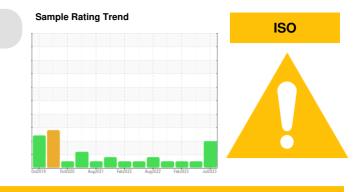

RECOMMENDED ACTIONS						
Action	Status	Date	Done By	Description		
Change Filter			?	We recommend you service the filters on this component.		

HISTORICAL DIAGNOSIS



Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



view report

08 Feb 2023 Diag: Doug Bogart

02 May 2023 Diag: Doug Bogart



Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

09 Nov 2022 Diag: Jonathan Hester

Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.









OIL ANALYSIS REPORT

Machine Id INGERSOLL RAND EVIS I/R 100HP WEST (S/N CK7965U07297)

Air Compressor

Fluid USPI AIR 46 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

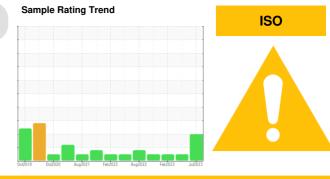

SAMPLE INFORM	/IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USPM29017	USPM28832	USPM26435
Sample Date		Client Info		19 Jul 2023	02 May 2023	08 Feb 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>4	0	0	0
Nickel	ppm	ASTM D5185m	>4	0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		<1	0	0
Aluminum	ppm	ASTM D5185m	>10	0	0	0
Lead	ppm	ASTM D5185m	>20	0	0	0
Copper	ppm	ASTM D5185m		<1	0	<1
Tin	ppm		>5	<1	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	0	1	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	0	0	<1	0
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	1	<1	2	21
Zinc	ppm	ASTM D5185m	0	0	0	2
Sulfur	ppm	ASTM D5185m	0	0	0	0
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	2
Sodium	ppm	ASTM D5185m		0	0	1
Potassium	ppm	ASTM D5185m	>20	<1	<1	1
Water	%	ASTM D6304	>0.2	0.140	0.077	0.049
ppm Water	ppm	ASTM D6304	>2000	1409.6	774.3	491.0
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	A 33953	475	447
Particles >6µm		ASTM D7647	>2500	<u> </u>	133	100
Particles >14µm		ASTM D7647	>320	🔺 1194	13	5
Particles >21µm		ASTM D7647	>80	<u> </u>	4	1
Particles >38µm		ASTM D7647	>20	11	1	0
Particles >71µm		ASTM D7647	>4	1	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	A 22/21/17	16/14/11	16/14/10
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.05	0.14	0.354	0.09



0.0

3.5


3.0

0ct18/18

Dct14

Acid Number

OIL ANALYSIS REPORT




CULCY

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	49.7	50.4	50.7	49.0
SAMPLE IMAGES	6	method	limit/base	current	history1	history2
				A I		





Bottom

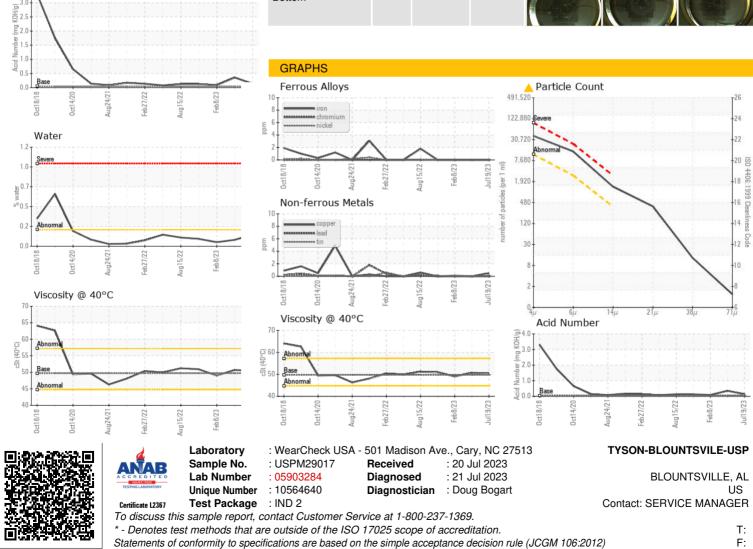

Contact/Location: SERVICE MANAGER - TYSBLOAL