

PROBLEM SUMMARY


Sample Rating Trend

ISO

Machine Id KAESER SFC 55T 4416636 (S/N 1016)


Compressor

KAESER SIGMA (OEM) S-460 (--- LTR)





COMPONENT CONDITION SUMMARY

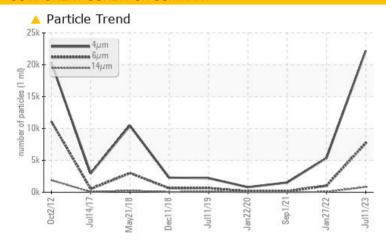

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ABNORMAL	NORMAL	NORMAL				
Particles >6µm	ASTM D7647	>1300	<u></u> 7716	1023	154				
Particles >14μm	ASTM D7647	>80	A 821	77	6				
Particles >21µm	ASTM D7647	>20	^ 236	23	3				
Particles >38μm	ASTM D7647	>4	<u> </u>	3	0				
Oil Cleanliness	ISO 4406 (c)	>/17/13	<u>^ 22/20/17</u>	17/13	14/10				

Customer Id: STOENG Sample No.: KCPA003364 Lab Number: 05903302 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

27 Jan 2022 Diag: Angela Borella

NORMAL



The oil change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



01 Sep 2021 Diag: Angela Borella

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



22 Jan 2020 Diag: Don Baldridge

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend



KAESER SFC 55T 4416636 (S/N 1016)

Compressor

KAESER SIGMA (OEM) S-460 (--- LTR)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Oct2012 Jul	2017 May2018 Dec2018	Jul2019 Jan2020 Sep2021 Jan202	2 Jul2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA003364	KCP35095	KCP42490
Sample Date		Client Info		11 Jul 2023	27 Jan 2022	01 Sep 2021
Machine Age	hrs	Client Info		97355	84667	81117
Oil Age	hrs	Client Info		0	3549	6256
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				ABNORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	0
Aluminum	ppm	ASTM D5185m	>10	0	0	0
Lead	ppm	ASTM D5185m	>10	<1	0	0
Copper	ppm	ASTM D5185m	>50	10	12	15
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m			0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	0
Barium	ppm	ASTM D5185m	90	2	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	3	0	0
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		0	7	<1
Zinc	ppm	ASTM D5185m		1	0	0
Sulfur	ppm	ASTM D5185m		20920	15000	14602
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	0
Sodium	ppm	ASTM D5185m		0	0	0
Potassium	ppm	ASTM D5185m	>20	2	0	0
Water	%	ASTM D6304	>0.05	0.00	0.004	0.008
ppm Water	ppm	ASTM D6304	>500	0.00	40.0	86.9
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		22207	5375	1529
Particles >6µm		ASTM D7647	>1300	7716	1023	154
Particles >14μm		ASTM D7647	>80	A 821	77	6
Particles >21µm		ASTM D7647	>20	236	23	3
Particles >38µm		ASTM D7647	>4	14	3	0
Particles >71μm		ASTM D7647	>3	1	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	22/20/17	17/13	14/10
FLUID DEGRADA	TION	method	limit/base	current	history1	history2



OIL ANALYSIS REPORT

