


# **PROBLEM SUMMARY**

# KAESER BSD 50 5619309 (S/N 1542)

Compressor

### KAESER SIGMA (OEM) M-460 (--- QTS)

### COMPONENT CONDITION SUMMARY

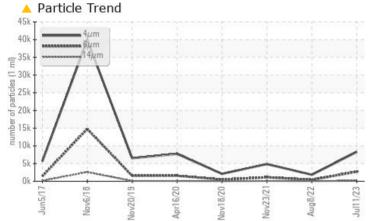

### RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS							
Sample Status		ABNORMAL	NORMAL	ATTENTION			
Particles >6µm	ASTM D7647 >1300	<b>A</b> 2706	430	1125			
Particles >14µm	ASTM D7647 >80	🔺 159	43	<u> </u>			
Particles >21µm	ASTM D7647 >20	<b>A</b> 33	13	<u> </u>			
Oil Cleanliness	ISO 4406 (c) >/17/13	3 🔺 20/19/14	18/16/13	<b>1</b> 7/14			


Customer Id: HOHFOR Sample No.: KCPA004866 Lab Number: 05903312 Test Package: IND 2



To manage this report scan the QR code

*To discuss the diagnosis or test data:* Don Baldridge +1 <u>don.b505@comcast.net</u>

*To change component or sample information:* Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u>

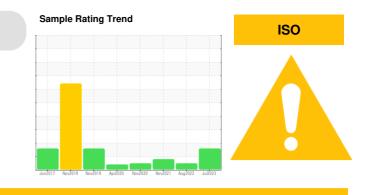

### **RECOMMENDED ACTIONS**

There are no recommended actions for this sample.

### **HISTORICAL DIAGNOSIS**

### 08 Aug 2022 Diag: Doug Bogart



Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### 23 Nov 2021 Diag: Jonathan Hester



Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

18 Nov 2020 Diag: Jonathan Hester



Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



/iew repor

view report





# **OIL ANALYSIS REPORT**

### Machine Id KAESER BSD 50 5619309 (S/N 1542) Component

Compressor Fluid

KAESER SIGMA (OEM) M-460 (--- QTS)

### DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear


All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

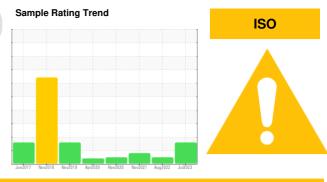


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA004866	KCP40696	KCP43637
Sample Date		Client Info		11 Jul 2023	08 Aug 2022	23 Nov 2021
Machine Age	hrs	Client Info		39130	33161	28796
Oil Age	hrs	Client Info		0	4635	4091
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				ABNORMAL	NORMAL	ATTENTION
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	0	0	<1
Nickel	ppm	ASTM D5185m	>3	<1	<1	<1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	<1
Aluminum	ppm	ASTM D5185m	>10	0	2	0
Lead	ppm	ASTM D5185m	>10	0	0	<1
Copper	ppm	ASTM D5185m	>50	32	22	19
Tin	ppm	ASTM D5185m	>10	0	<1	0
Antimony	ppm	ASTM D5185m	210			0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium		ASTM D5185m		0	0	0
	ppm				-	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	1
Barium	ppm	ASTM D5185m	90	1	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	100	<1	0	<1
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	0	0	14	4
Zinc	ppm	ASTM D5185m	0	4	24	23
Sulfur	ppm	ASTM D5185m	23500	20835	19225	17470
CONTAMINANTS	6	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	2
Sodium	ppm	ASTM D5185m		0	0	0
Potassium	ppm	ASTM D5185m	>20	<1	0	0
Water	%	ASTM D6304	>0.05	0.006	0.007	0.007
ppm Water	ppm	ASTM D6304	>500	67.5	77.5	71.0
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		8305	1830	4859
Particles >6µm		ASTM D7647	>1300	<u> </u>	430	1125
Particles >14µm		ASTM D7647	>80	<b>人</b> 159	43	<u> </u>
Particles >21µm		ASTM D7647	>20	<u> </u>	13	<b>A</b> 24
Particles >38µm		ASTM D7647	>4	1	1	1
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u> </u>	18/16/13	▲ 17/14
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.43	0.44	0.474
		. 10 111 000-10		ot/Location: SEE		


Report Id: HOHFOR [WUSCAR] 05903312 (Generated: 07/24/2023 10:49:34) Rev: 1


Contact/Location: SERVICE MANAGER ? - HOHFOR





# **OIL ANALYSIS REPORT**













ð

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	TIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	52.2	51.1	50.7
SAMPLE IMAGES	S	method	limit/base	current	history1	history2

Color



Bottom

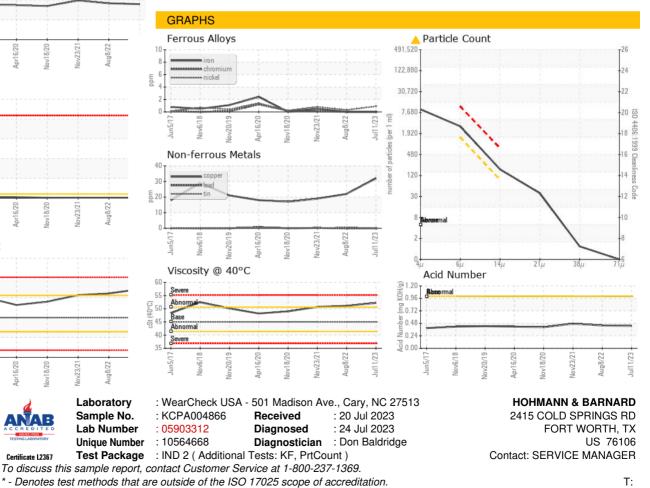

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: SERVICE MANAGER ? - HOHFOR

F: