

PROBLEM SUMMARY

Sample Rating Trend

VISCOSITY

Machine Id


KAESER BSD 50 6208388 (S/N 1808)


Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

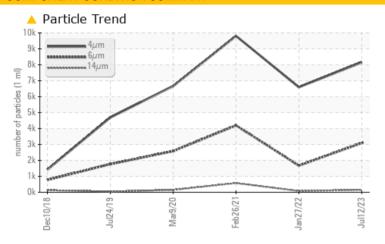

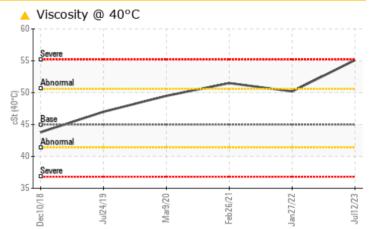

RECOMMENDATION

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS											
Sample Status				ABNORMAL	ATTENTION	ABNORMAL					
Particles >6µm		ASTM D7647	>1300	△ 3093	<u>▲</u> 1675	4200					
Particles >14µm		ASTM D7647	>80	<u> </u>	80	<u></u> 575					
Particles >21µm		ASTM D7647	>20	^ 30	19	<u>▲</u> 182					
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u> </u>	<u></u> 18/13	1 9/16					
Visc @ 40°C	cSt	ASTM D445	45	△ 55.1	50.2	51.5					

Customer Id: ARADAL Sample No.: KCPA003238 Lab Number: 05903317 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

27 Jan 2022 Diag: Don Baldridge

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



26 Feb 2021 Diag: Doug Bogart

150



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



09 Mar 2020 Diag: Angela Borella

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend



KAESER BSD 50 6208388 (S/N 1808)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition


The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

		Dec2018	Jul2019 Mar2020	FebŽ021 JanŽ022	Jul2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA003238	KCP40844	KCP27987
Sample Date		Client Info		12 Jul 2023	27 Jan 2022	26 Feb 2021
Machine Age	hrs	Client Info		27036	18225	13142
Oil Age	hrs	Client Info		0	5300	3612
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				ABNORMAL	ATTENTION	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	<1
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	<1	<1	0
Aluminum	ppm	ASTM D5185m	>10	0	0	<1
Lead	ppm	ASTM D5185m	>10	0	0	<1
Copper	ppm	ASTM D5185m	>50	10	10	8
Tin	ppm	ASTM D5185m	>10	<1	0	<1
Antimony	ppm	ASTM D5185m			0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	<1	10
Barium	ppm	ASTM D5185m	90	1	19	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	100	0	20	0
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	0	0	11	6
Zinc	ppm	ASTM D5185m	0	0	0	0
Sulfur	ppm	ASTM D5185m	23500	17236	15858	16268
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	11	0
Sodium	ppm	ASTM D5185m		0	<1	0
Potassium	ppm	ASTM D5185m	>20	<1	<1	<1
Water	%	ASTM D6304	>0.05	0.005	0.010	0.008
ppm Water	ppm	ASTM D6304	>500	55.3	104.7	81.1
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		8155	6597	9812
Particles >6µm		ASTM D7647	>1300	△ 3093	<u>▲</u> 1675	4200
Particles >14µm		ASTM D7647	>80	<u> </u>	80	<u></u> 575
Particles >21µm		ASTM D7647	>20	△ 30	19	<u></u> 182
Particles >38µm		ASTM D7647	>4	1	1	<u>^</u> 7
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 20/19/14	△ 18/13	△ 19/16
FLUID DEGRADA	TION	method	limit/base	current	history1	history2

0.41



OIL ANALYSIS REPORT

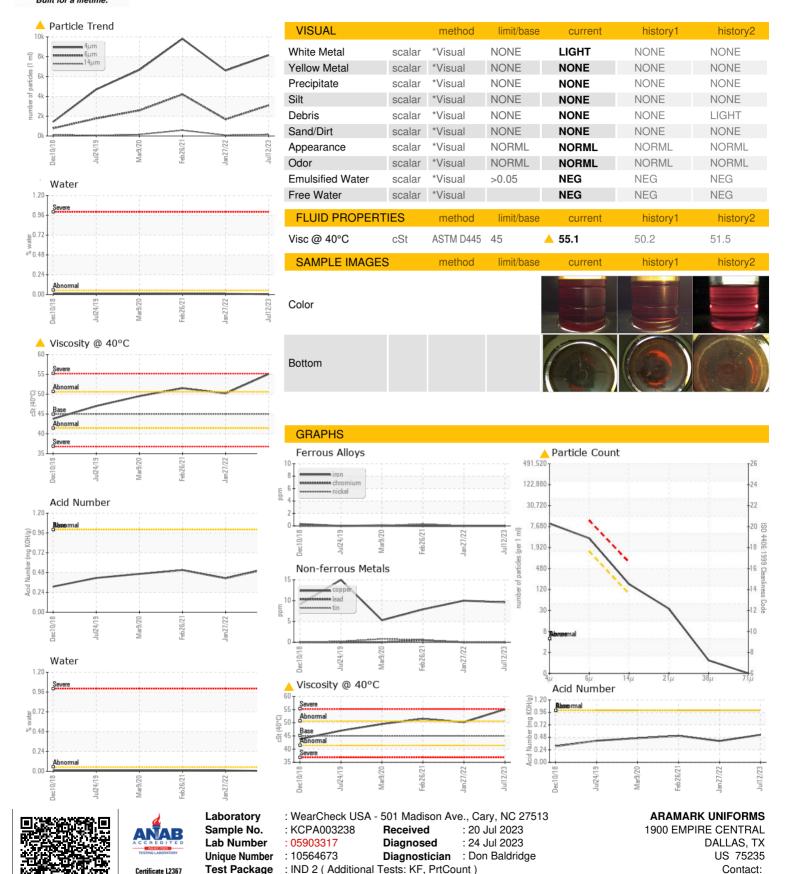

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: